

# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

## **KAESER 8334763**

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2023	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number	,,,,,,,,,,	Client Info	mmesacc	KCPA017658	KCPA005178	
Sample Number		Client Info		09 May 2024	18 Aug 2023	
Machine Age	hrs	Client Info		30074	636	
Oil Age	hrs	Client Info		0	0	
Oil Changed	1115	Client Info		Changed	N/A	
Sample Status		Ciletit itilo		NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m		2	0	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m		4	2	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	31	47	
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	71	36	
Calcium	ppm	ASTM D5185m	0	7	0	
Phosphorus	ppm	ASTM D5185m	0	6	3	
Zinc	ppm	ASTM D5185m	0	8	5	
Sulfur	ppm	ASTM D5185m	23500	23051	19774	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	
Sodium	ppm	ASTM D5185m		13	2	
Potassium	ppm	ASTM D5185m	>20	14	4	
Water	%	ASTM D6304	>0.05	0.022	<b>△</b> 0.278	
ppm Water	ppm	ASTM D6304	>500	222	<b>△</b> 2780	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		3352	1244	
Particles >6µm		ASTM D7647	>1300	995	678	
Particles >14μm		ASTM D7647	>80	45	115	
Particles >21µm		ASTM D7647	>20	9	<b>39</b>	
Particles >38µm		ASTM D7647	>4	1	6	
Particles >71μm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	17/17/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.33	0.30	



## **OIL ANALYSIS REPORT**

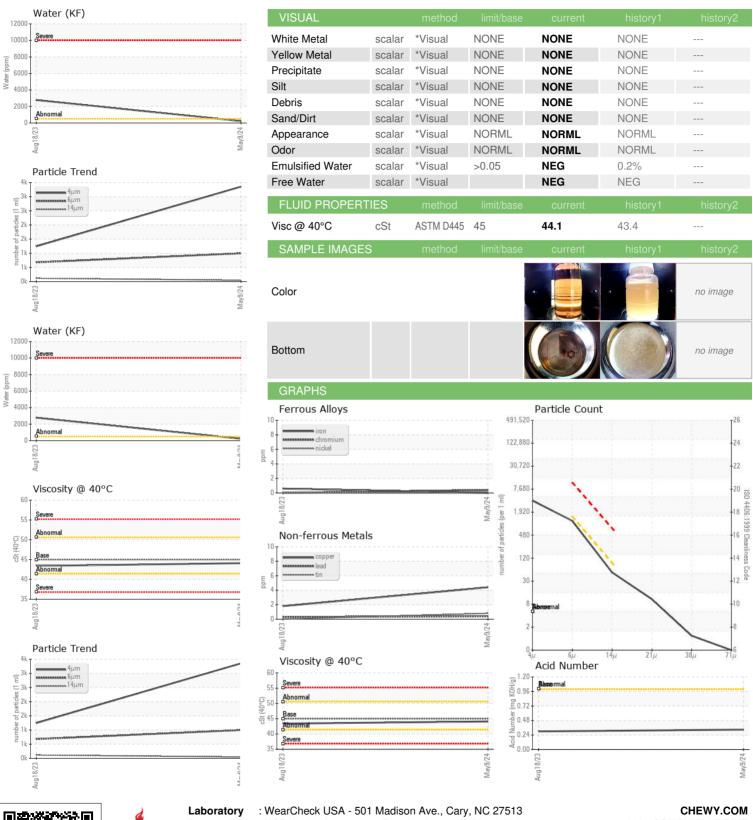



Certificate 12367

Sample No.

: KCPA017658 Lab Number : 06177720 Unique Number : 11023773

Received : 13 May 2024 **Tested** 

: 14 May 2024 Diagnosed : 15 May 2024 - Angela Borella Test Package : IND 2 ( Additional Tests: KF, PrtCount )

1281 COUCHVILLE PIKE MT JOLIET, TN US 37122

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) T:

F: