




OIL ANALYSIS REPORT

Sample Rating Trend

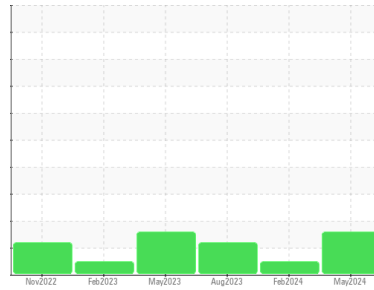

ISO



Machine Id
KAESER 8487212 (S/N 1964)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC129355D	KC06090249	KC111557
Sample Date	Client Info		09 May 2024	09 Feb 2024	03 Aug 2023
Machine Age	hrs	Client Info	6643	6050	4609
Oil Age	hrs	Client Info	4500	0	0
Oil Changed	Client Info		Not Chngd	N/A	N/A
Sample Status			ABNORMAL	NORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	2	0	<1
Lead	ppm	ASTM D5185m >10	<1	<1	<1
Copper	ppm	ASTM D5185m >50	13	9	10
Tin	ppm	ASTM D5185m >10	<1	<1	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	4	0	37
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 90	7	9	45
Calcium	ppm	ASTM D5185m 2	3	<1	0
Phosphorus	ppm	ASTM D5185m	5	0	0
Zinc	ppm	ASTM D5185m	6	0	4

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	<1
Sodium	ppm	ASTM D5185m	0	1	7
Potassium	ppm	ASTM D5185m >20	2	<1	4
Water	%	ASTM D6304 >0.05	0.007	0.008	0.026
ppm Water	ppm	ASTM D6304 >500	73	86	262.3






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		44279	3976	3944
Particles >6µm	ASTM D7647 >1300		▲ 10851	908	● 1390
Particles >14µm	ASTM D7647 >80		▲ 812	38	● 101
Particles >21µm	ASTM D7647 >20		▲ 158	9	20
Particles >38µm	ASTM D7647 >4		1	0	0
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/17	19/17/12	● 19/18/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.35	0.35	0.37

OIL ANALYSIS REPORT

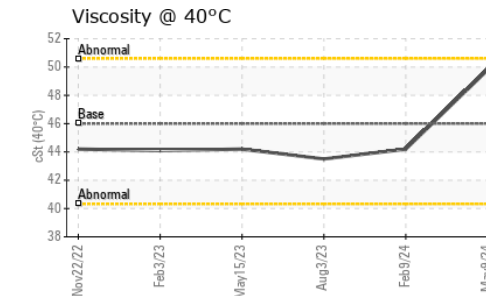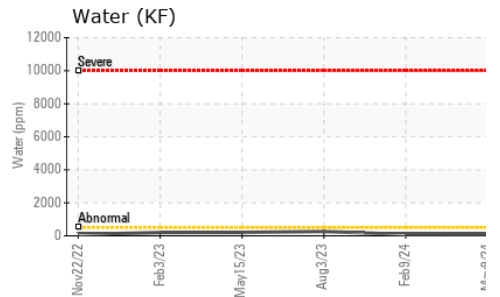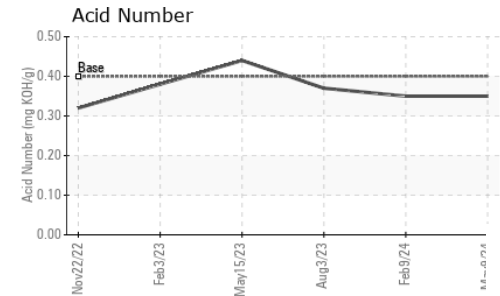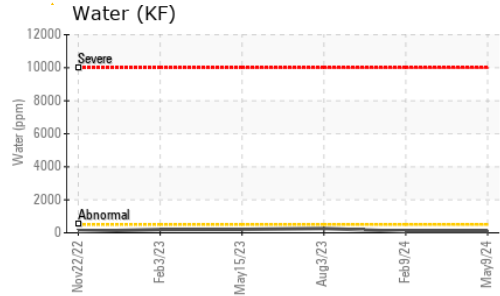
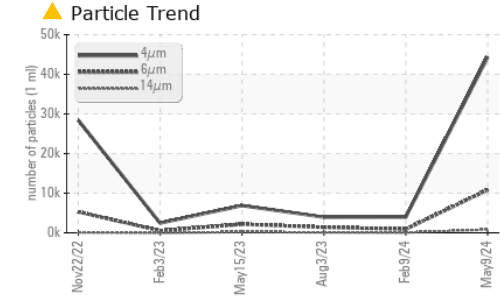


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	49.8	44.2	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

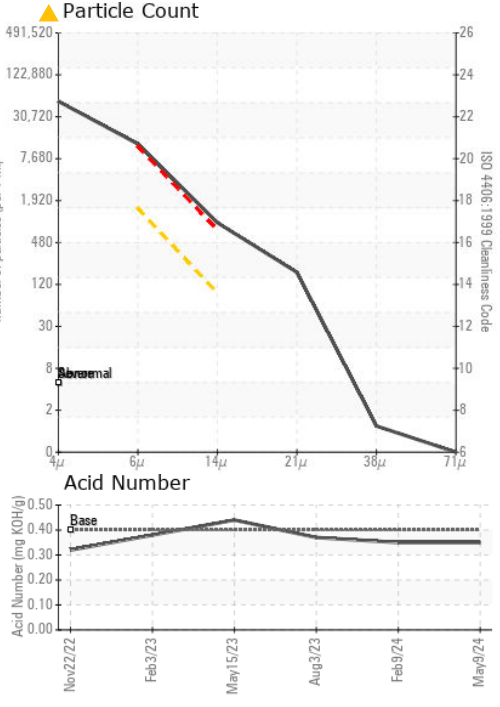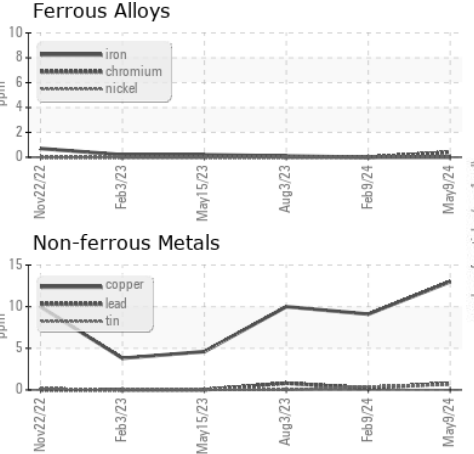

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC129355D **Received** : 13 May 2024
Lab Number : 06177722 **Tested** : 14 May 2024
Unique Number : 11023775 **Diagnosed** : 15 May 2024 - Angela Borella
Test Package : IND 2

CHARLOTTE ANODIZING PRODUCTS
 591 E PACKARD HWY
 CHARLOTTE, MI
 US 48813
 Contact: PRODUCTION
 production@charlotte-anodizing.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)