


OIL ANALYSIS REPORT

Sample Rating Trend

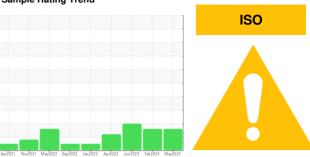

Machine Id

7384046 (S/N 1016)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Apr2021 No	v2021 May2022 Sep2022	Jan 2023 Apr 2023 Jun 2023 Feb 20	24 May2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128423	KC125724	KC101151
Sample Date		Client Info		02 May 2024	01 Feb 2024	28 Jun 2023
Machine Age	hrs	Client Info		24769	23136	19476
Oil Age	hrs	Client Info		4988	0	7094
Oil Changed		Client Info		Not Changd	N/A	Not Changd
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	3	8	6
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	2	0	6
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	3	0	12
Calcium	ppm	ASTM D5185m	2	3	<1	0
Phosphorus	ppm	ASTM D5185m		76	0	5
Zinc	ppm	ASTM D5185m		53	0	10
CONTAMINANTS	i e	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		0	2	2
Potassium	ppm	ASTM D5185m	>20	2	2	<1
Water	%	ASTM D6304	>0.05	0.006	0.009	0.012
ppm Water	ppm	ASTM D6304	>500	62	93	125.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10563	6423	45502
Particles >6µm		ASTM D7647	>1300	<u>2795</u>	0 2014	<u>▲</u> 14036
Particles >14μm		ASTM D7647	>80	<u> </u>	129	▲ 1021
Particles >21µm		ASTM D7647	>20	<u>41</u>	3 0	<u>^</u> 260
Particles >38μm		ASTM D7647	>4	1	2	<u></u> 11
Particles >71µm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/15	20/18/14	<u>△</u> 23/21/17
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.29	0.39	0.37



OIL ANALYSIS REPORT





40



Certificate 12367

Laboratory

Sample No. : KC128423 Lab Number : 06177733 Unique Number : 11023786

50

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 13 May 2024 Tested : 15 May 2024

Diagnosed : 15 May 2024 - Angela Borella Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

(B 0.50 W 0.40

Ē 0.30 흗 0.20 ≥ 0.10

00.00 PG

T: F:

NORRIS

US 33762

4680 110TH AVE W

CLEARWATER, FL

Contact: Service Manager