

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

Machine Id

KAESER 8387827

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2023	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017659	KCPA005179	
Sample Date		Client Info		09 May 2024	18 Aug 2023	
Machine Age	hrs	Client Info		3434	377	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum		ASTM D5185m	>10	2	0	
	ppm					
Lead	ppm	ASTM D5185m	>10	<1 2	0	
Copper	ppm	ASTM D5185m		_	<1	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	41	54	
Molybdenum	ppm	ASTM D5185m	0	<1	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	100	69	38	
Calcium	ppm	ASTM D5185m	0	7	0	
Phosphorus	ppm	ASTM D5185m	0	5	3	
Zinc	ppm	ASTM D5185m	0	8	4	
Sulfur	ppm	ASTM D5185m	23500	21951	19868	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		15	3	
Potassium	ppm	ASTM D5185m	>20	12	4	
Water	%	ASTM D6304	>0.05	0.020	<u>0.351</u>	
ppm Water	ppm	ASTM D6304	>500	208	△ 3510	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3621	896	
Particles >6µm		ASTM D7647	>1300	1089	488	
Particles >14µm		ASTM D7647	>80	41	83	
Particles >21µm		ASTM D7647	>20	4	28	
Particles >38µm		ASTM D7647	>4	0	4	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13	17/16/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.32	0.30	



OIL ANALYSIS REPORT

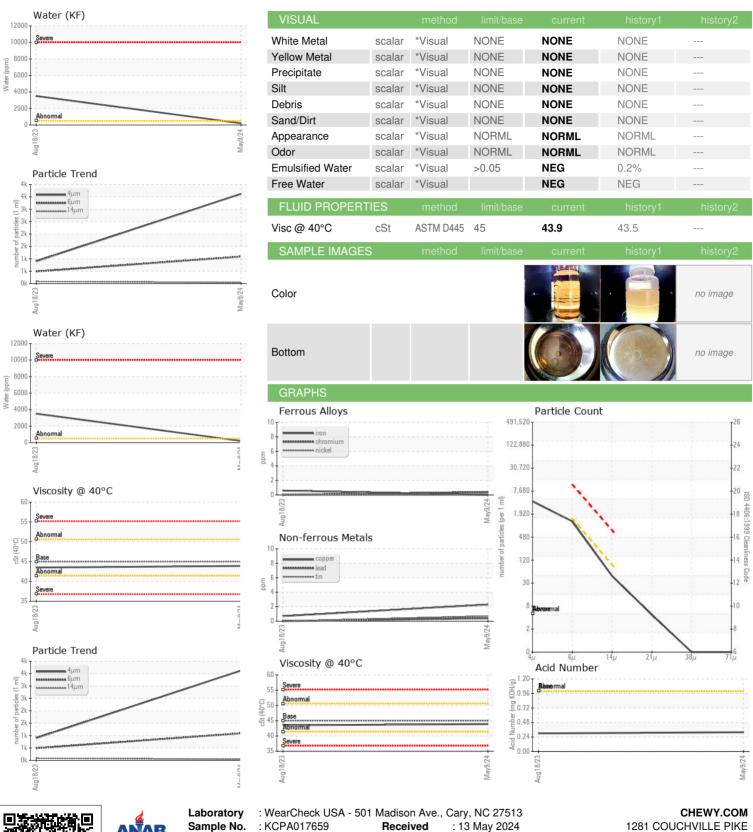



Sample No.

Lab Number : 06177734

: KCPA017659 Unique Number : 11023787

Received **Tested** : 15 May 2024 Diagnosed

: 15 May 2024 - Angela Borella Test Package : IND 2 (Additional Tests: KF, PrtCount)

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MT JOLIET, TN

Contact: Service Manager

US 37122

T:

F: