


OIL ANALYSIS REPORT

Sample Rating Trend

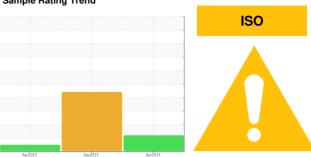

Machine Id

KAESER 8461104 (S/N 1346)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Ap	2023	Sep2023 Apr20	24	
SAMPLE INFORM	ΙΔΤΙΩΝ	method	limit/base	current	history1	history2
	MATION	Client Info	IIIIIIVDase	KC126061	KC125447	KC97267
Sample Number Sample Date		Client Info		30 Apr 2024	24 Sep 2023	10 Apr 2023
Machine Age	hrs	Client Info		3818	2143	763
Oil Age	hrs	Client Info		0	0	763
Oil Changed	1110	Client Info		N/A	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	0
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	17	2	9
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	1	28	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	11	31	26
Calcium	ppm	ASTM D5185m	2	3	4	0
Phosphorus	ppm	ASTM D5185m		4	<1	4
Zinc	ppm	ASTM D5185m		49	3	42
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	<1
Sodium	ppm	ASTM D5185m		3	5	9
Potassium	ppm	ASTM D5185m	>20	3	<1	7
Water	%	ASTM D6304	>0.05	0.010	△ 0.735	0.016
ppm Water	ppm	ASTM D6304	>500	107	<u></u> 7350	164.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		14448		2590
Particles >6µm		ASTM D7647	>1300	<u>^</u> 6687		1088
Particles >14μm		ASTM D7647	>80	<u> </u>		41
Particles >21μm		ASTM D7647		15		7
Particles >38µm		ASTM D7647	>4	0		0
Particles >71μm		ASTM D7647		0		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>21/20/15</u>		19/17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.27	0.25	0.23



OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No. Lab Number

: KC126061 : 06177737 Unique Number : 11023790 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 13 May 2024 Tested : 15 May 2024

: 15 May 2024 - Angela Borella Diagnosed

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: Contact/Location: Service Manager - CLATAM

9437 CORPORATE LAKE DR

Contact: Service Manager

TAMPA, FL

US 33634

T: