




# OIL ANALYSIS REPORT

Sample Rating Trend

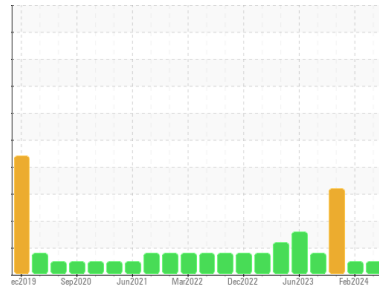

**NORMAL**



Machine Id  
**INK4\_U2120 INK4\_U2120\_M2120**  
 Component  
**Drive End Bearing**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

The water content is negligible. There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0029050</b>	RP0025909	RP0026155
Sample Date	Client Info			<b>10 May 2024</b>	20 Feb 2024	15 Nov 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	0	0
Lead	ppm	ASTM D5185m	>20	<b>19</b>	17	19
Copper	ppm	ASTM D5185m	>20	<b>4</b>	3	3
Tin	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>5</b>	0	6
Calcium	ppm	ASTM D5185m		<b>3</b>	0	<1
Phosphorus	ppm	ASTM D5185m		<b>10</b>	0	4
Zinc	ppm	ASTM D5185m		<b>24</b>	4	9

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>0</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	1
Water	%	ASTM D6304	>0.05	<b>0.090</b>	0.006	▲ 1.12
ppm Water	ppm	ASTM D6304	>500	<b>900</b>	67	▲ 11200

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.46</b>	0.52	0.461

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	▲ MODER
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>HAZY</b>	NORML	● HAZY
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>0.2%</b>	NEG	▲ 0.2%
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG


# OIL ANALYSIS REPORT

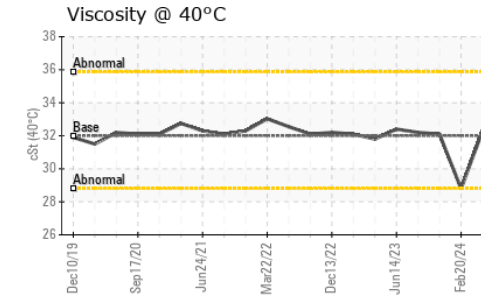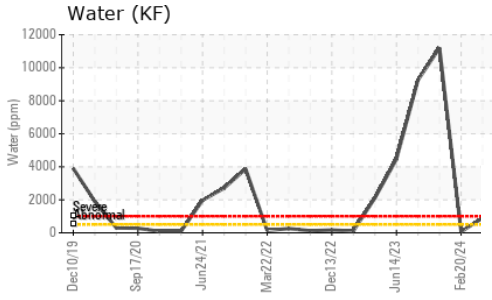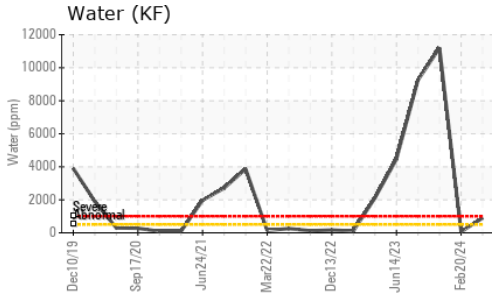

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	<b>32.3</b>	28.8	32.1





SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color

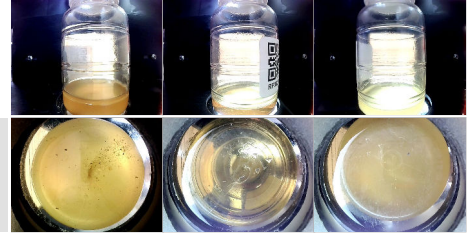

Bottom

## GRAPHS

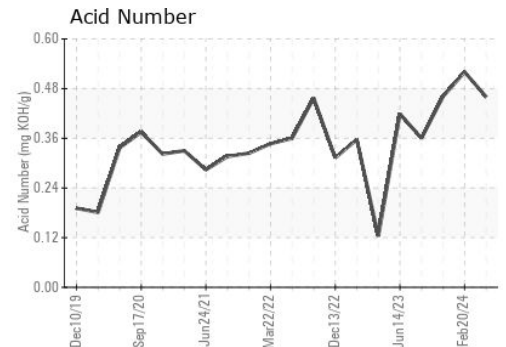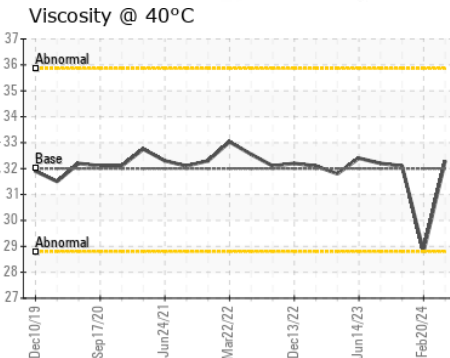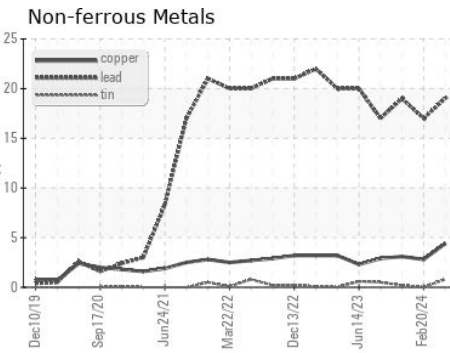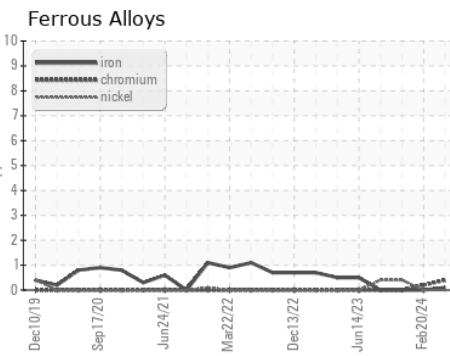

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0029050  
**Lab Number** : 06177768  
**Unique Number** : 11029094  
**Test Package** : PLANT

**Received** : 13 May 2024  
**Tested** : 17 May 2024  
**Diagnosed** : 17 May 2024 - Jonathan Hester

**ENERGY TRANSFER - INKSTER**  
 7155 INKSTER ROAD  
 TAYOR, MI  
 US 48180

Contact: NATHAN HOLMES  
 nathan.holmes@energytransfer.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: