





# OIL ANALYSIS REPORT

Sample Rating Trend

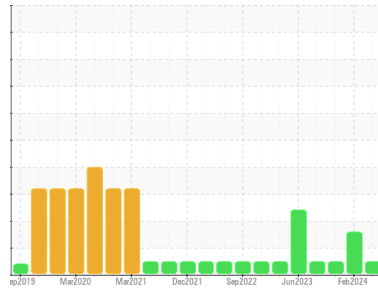

Machine Id  
**CARL\_U2120 CARL\_U2120\_SS2120**  
 Component  
**Drive End Seal Pot**  
 Fluid  
**ROYAL PURPLE BARRIER FLUID FDA22 (--- GAL)**

## DIAGNOSIS

- Recommendation**  
 Resample at the next service interval to monitor.
- Wear**  
 All component wear rates are normal.
- Contamination**  
 The water content is negligible. There is no indication of any contamination in the oil.
- Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>RP0034099</b>	RP0025826	RP0034100
Sample Date	Client Info			<b>09 May 2024</b>	20 Feb 2024	15 Nov 2023
Machine Age	hrs	Client Info		<b>2358</b>	2358	2358
Oil Age	hrs	Client Info		<b>2358</b>	2358	2358
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Calcium	ppm	ASTM D5185m		<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>5</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>2</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	---
Water	%	ASTM D6304	>0.05	<b>0.003</b>	▲ 0.062	0.008
ppm Water	ppm	ASTM D6304	>500	<b>29</b>	▲ 629	84

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.063</b>	---	0.056


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT


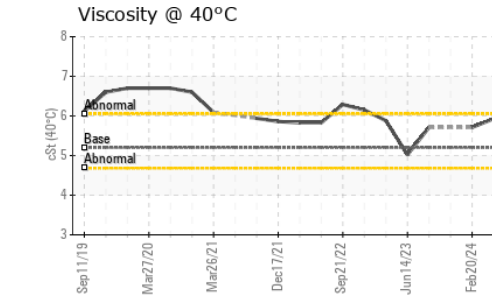
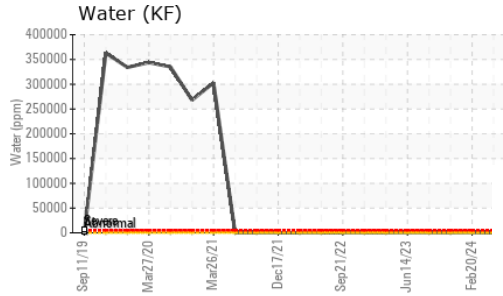
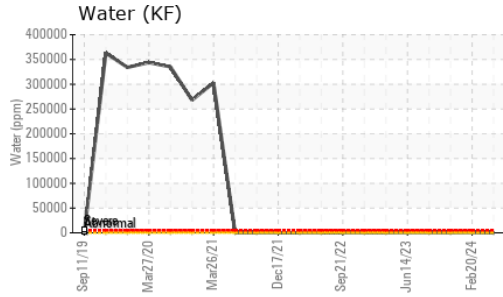


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	5.2	<b>5.93</b>	5.71	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

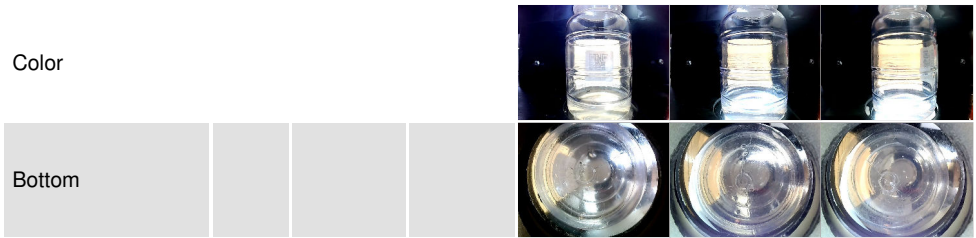

## GRAPHS

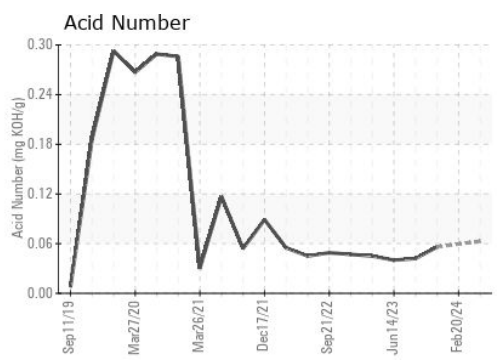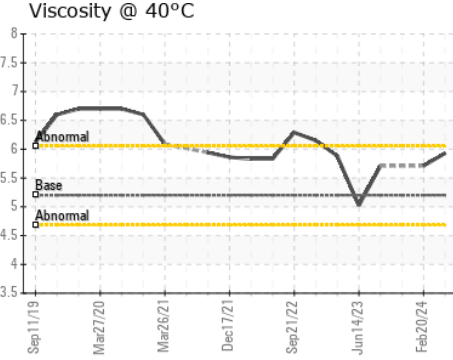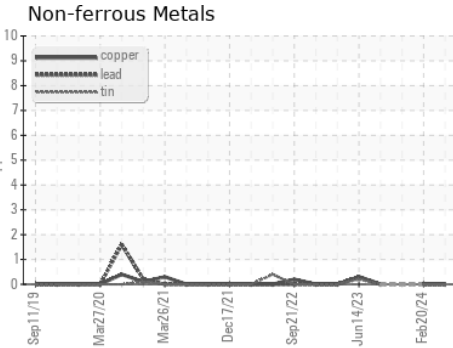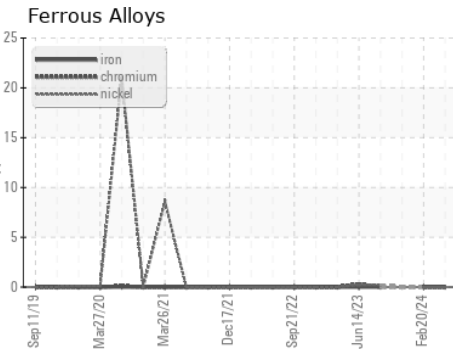

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0034099  
**Lab Number** : **06178263**  
**Unique Number** : 11029589  
**Test Package** : IND 2  
**Received** : 13 May 2024  
**Tested** : 22 May 2024  
**Diagnosed** : 22 May 2024 - Jonathan Hester

**ENERGY TRANSFER - CARLTON**  
 11500 FRESSNER ROAD  
 CARLTON, MI  
 US 48117  
 Contact: SCOTT VERHELLE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (313)580-0267  
 F: