




OIL ANALYSIS REPORT

Sample Rating Trend

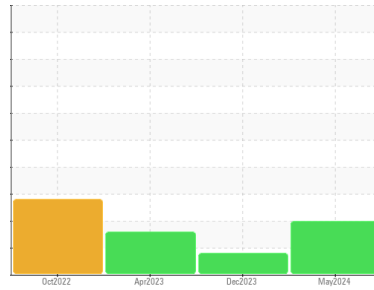

WEAR



Area

HOTLINE/120 MILL

Machine Id

120 STAND 4B GEN EAST BRG 1415-036-0111

Component

Bearing

Fluid

ROYAL PURPLE SYNFILM GT 68 (25 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

The lead level is abnormal. All other component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KFS0005161	KFS0003131	KFS0003469
Sample Date	Client Info		10 May 2024	20 Dec 2023	17 Apr 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	0	<1
Chromium	ppm	ASTM D5185m	>20	<1	<1
Nickel	ppm	ASTM D5185m	>20	0	0
Titanium	ppm	ASTM D5185m		0	0
Silver	ppm	ASTM D5185m		0	0
Aluminum	ppm	ASTM D5185m	>20	0	2
Lead	ppm	ASTM D5185m	>20	52	59
Copper	ppm	ASTM D5185m	>20	0	<1
Tin	ppm	ASTM D5185m	>20	3	0
Vanadium	ppm	ASTM D5185m		0	0
Cadmium	ppm	ASTM D5185m		0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0
Barium	ppm	ASTM D5185m		2	0
Molybdenum	ppm	ASTM D5185m		0	0
Manganese	ppm	ASTM D5185m		0	<1
Magnesium	ppm	ASTM D5185m	90	79	79
Calcium	ppm	ASTM D5185m		4	2
Phosphorus	ppm	ASTM D5185m		23	31
Zinc	ppm	ASTM D5185m		0	0
Sulfur	ppm	ASTM D5185m		21525	19586

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	1
Sodium	ppm	ASTM D5185m		0	1
Potassium	ppm	ASTM D5185m	>20	0	<1


FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	165382	254	35001
Particles >6µm	ASTM D7647	>2500	17384	85	1521
Particles >14µm	ASTM D7647	>160	101	17	18
Particles >21µm	ASTM D7647	>40	16	5	4
Particles >38µm	ASTM D7647	>10	0	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	25/21/14	15/14/11	22/18/11


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.37	0.38	0.34


▲ Particle Trend

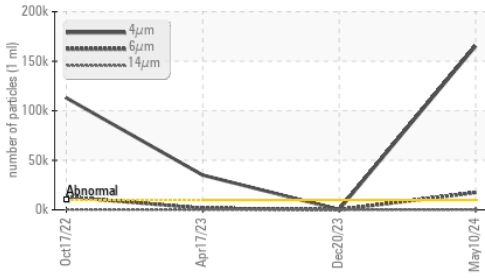


▲ Particle Trend

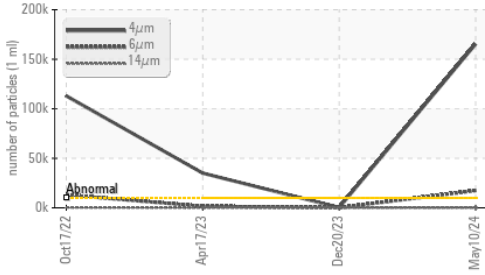


▲ Non-ferrous Metals

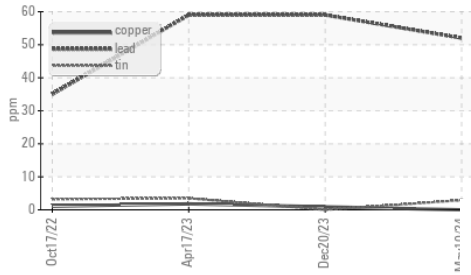

Acid Number

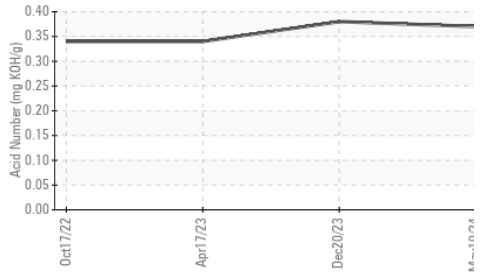


Viscosity @ 40°C

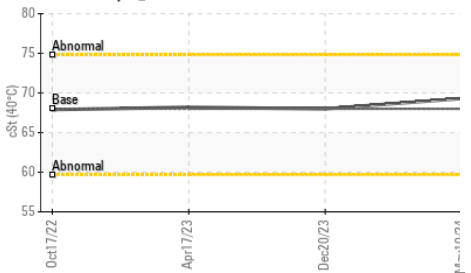

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	69.3	68.0	68.2

SAMPLE IMAGES

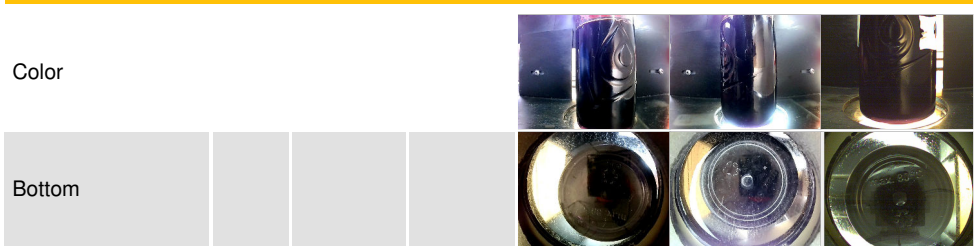


GRAPHS


Ferrous Alloys

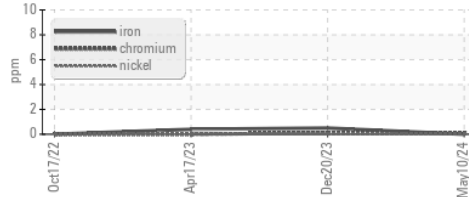


Non-ferrous Metals

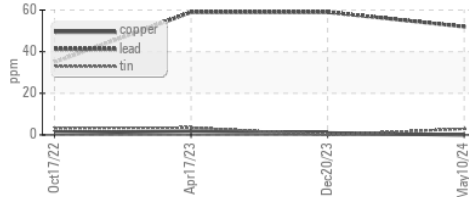


Viscosity @ 40°C

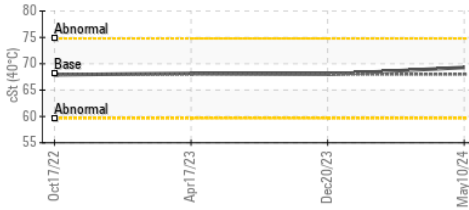

▲ Particle Count

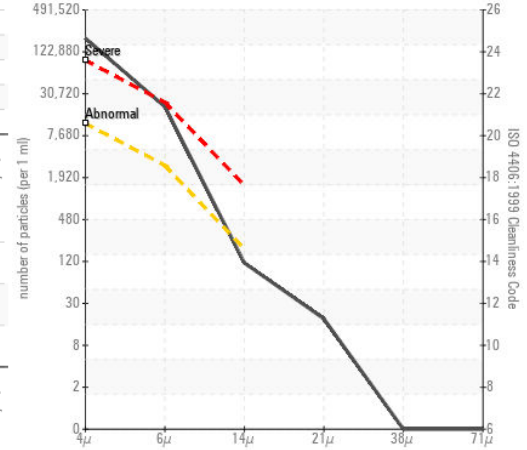

Acid Number

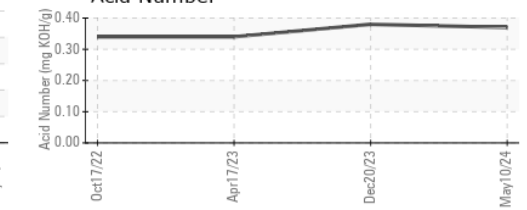

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KFS0005161

Lab Number : 06178686

Unique Number : 11030012

Test Package : IND 2 (Additional Tests: PrtCount)

Received : 14 May 2024

Tested : 16 May 2024

Diagnosed : 16 May 2024 - Don Baldrige

CONSTELLIUM

4805 SECOND STREET

MUSCLE SHOALS, AL

US 35661

Contact: Joel Even

joel.even@constellium.com

T: (256)740-7490

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)