

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id

2139283 (S/N 1008)

Component Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC129885	KC108102	
Sample Date		Client Info		03 May 2024	03 May 2023	
Machine Age	hrs	Client Info		133030	124296	
Oil Age	hrs	Client Info		8734	9000	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	6	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	1	
Copper	ppm	ASTM D5185m	>50	7	10	
Tin	ppm	ASTM D5185m	>10	′ <1	<1	
Vanadium	ppm	ASTM D5185m	210	0	0	
Cadmium		ASTM D5185m		0	0	
	ppm			-		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	2	0	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		22	76	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	7	
Sodium	ppm	ASTM D5185m		<1	1	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304	>0.05	0.009	0.036	
ppm Water	ppm	ASTM D6304	>500	91	363.8	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4882		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<mark> </mark> 105		
Particles >21µm		ASTM D7647	>20	<mark> </mark> 22		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	9/18/14		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.45	0.46	
	ing non/g	7.0 TWI 20043	J.T	0.75	0.70	



OIL ANALYSIS REPORT

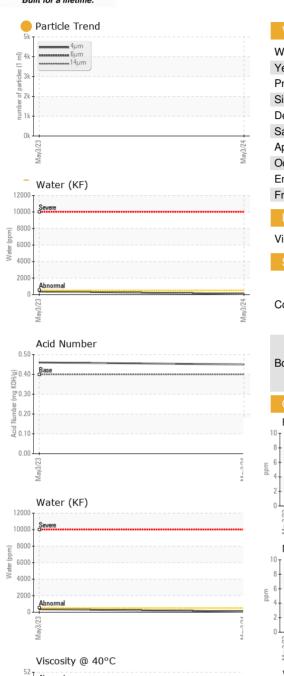



50


48

(D=04) 44

42

4(

3

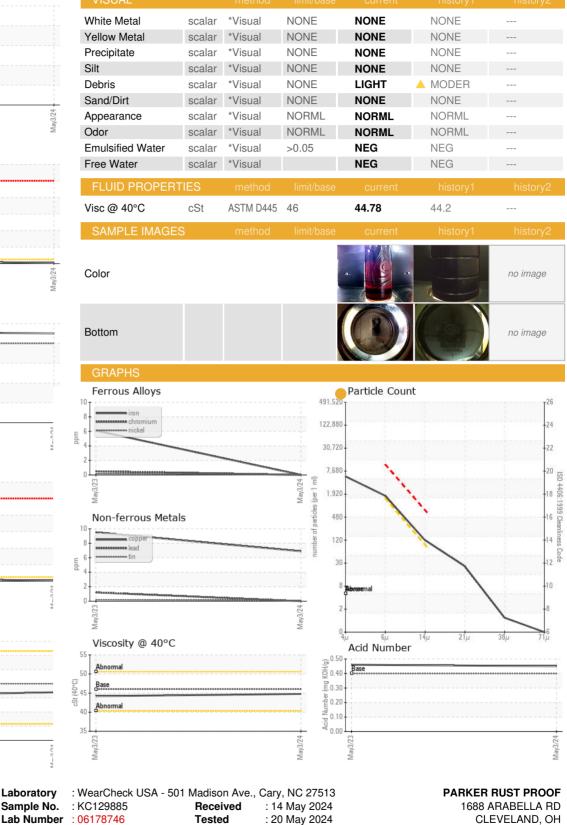

: 20 May 2024 - Jonathan Hester

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

Unique Number : 11030072

Laboratory

Sample No.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

Contact/Location: Service Manager - PARCLE Page 2 of 2

US 44112

T:

F:

Contact: Service Manager