

## **OIL ANALYSIS REPORT**

KAESER BS 51 1318723 (S/N 1014)

Component Compressor Fluid KAESER SIGMA (OEM) S-460 (--- QTS)

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

## 🔺 Wear


The tin level is abnormal. All other component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

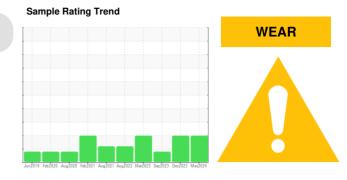



SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128976	KC122020	KC05950199
Sample Date		Client Info		08 May 2024	11 Dec 2023	01 Sep 2023
Machine Age	hrs	Client Info		74608	72143	70523
Oil Age	hrs	Client Info		3000	0	0
Oil Changed		Client Info		Not Changd	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	10	6	14
Tin	ppm	ASTM D5185m	>10	<b>A</b> 32	<b>4</b> 34	9
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	<1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	14	35	4
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	6
Zinc	ppm	ASTM D5185m		6	14	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		5	21	2
Potassium	ppm	ASTM D5185m	>20	<1	0	1
Water	%	ASTM D6304	>0.05	0.010	0.011	0.013
ppm Water	ppm	ASTM D6304	>500	103	111	134.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		256059	4709	125272
Particles >6µm		ASTM D7647	>1300	<u> </u>	865	<b>3</b> 5707
Particles >14µm		ASTM D7647	>80	<b>e</b> 108	114	28
Particles >21µm		ASTM D7647	>20	6	29	6
Particles >38µm		ASTM D7647	>4	1	0	0
Particles >71µm		ASTM D7647	>3	1	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>4</b> 25/24/14	9/17/14	▲ 24/22/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.38	0.33	0.33





# **OIL ANALYSIS REPORT**













		un a the a d	line it /le e e e		la la tanun d	histow.0
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.4	45.4	44.6
SAMPLE IMAGES		method	limit/base	current	history1	history2

Color



Bottom

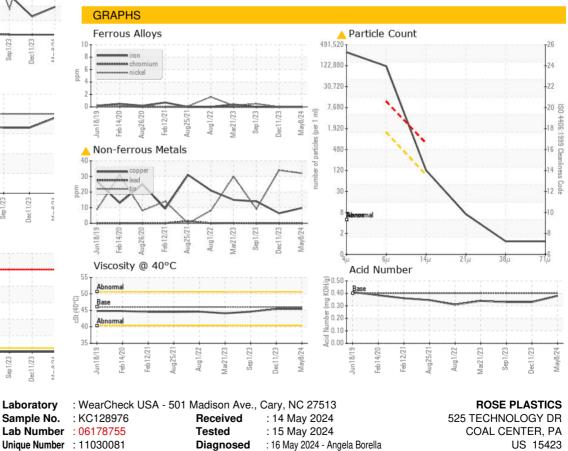

Unique Number : 11030081 Test Package : IND 2

Laboratory

- To discuss this sample report, contact Customer Service at 1-800-237-1369.
- \* Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Certificate 12367

Contact/Location: SERVICE MANAGER ? - ROSCOA

Contact: SERVICE MANAGER