




# OIL ANALYSIS REPORT

## Sample Rating Trend

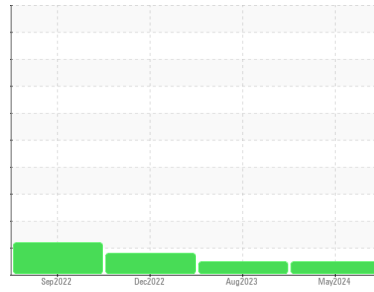

Machine Id  
**KAESER 7894008**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC129340</b>	KC124305	KC91680
Sample Date	Client Info	<b>08 May 2024</b>	21 Aug 2023	20 Dec 2022
Machine Age	hrs	<b>12240</b>	9771	7602
Oil Age	hrs	<b>2469</b>	0	1200
Oil Changed	Client Info	<b>Not Changed</b>	Changed	Not Changed
Sample Status		<b>NORMAL</b>	NORMAL	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	3	1
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>45</b>	12	37
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 90	<b>82</b>	55	78
Calcium	ppm	ASTM D5185m 2	<b>2</b>	0	1
Phosphorus	ppm	ASTM D5185m	<b>0</b>	<1	<1
Zinc	ppm	ASTM D5185m	<b>0</b>	8	6

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>17</b>	14	18
Potassium	ppm	ASTM D5185m >20	<b>6</b>	8	5
Water	%	ASTM D6304 >0.05	<b>0.023</b>	0.031	0.020
ppm Water	ppm	ASTM D6304 >500	<b>237</b>	310.4	202.9






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>2064</b>	2550	4494
Particles >6µm	ASTM D7647 >1300	<b>688</b>	717	1334
Particles >14µm	ASTM D7647 >80	<b>42</b>	35	79
Particles >21µm	ASTM D7647 >20	<b>6</b>	8	17
Particles >38µm	ASTM D7647 >4	<b>0</b>	0	1
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >17/13	<b>17/13</b>	17/12	18/13

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.37</b>	0.33	0.36


# OIL ANALYSIS REPORT

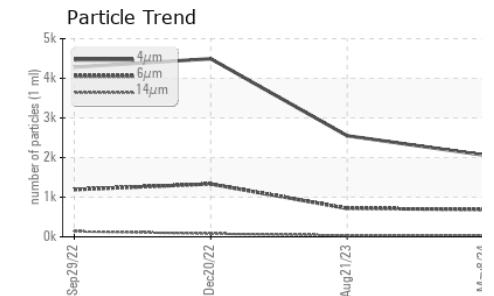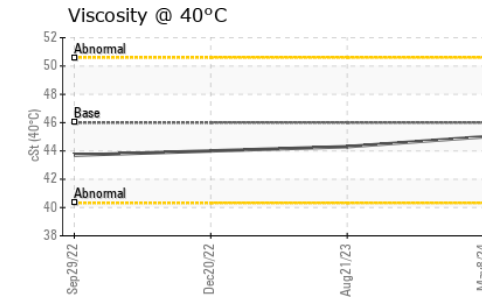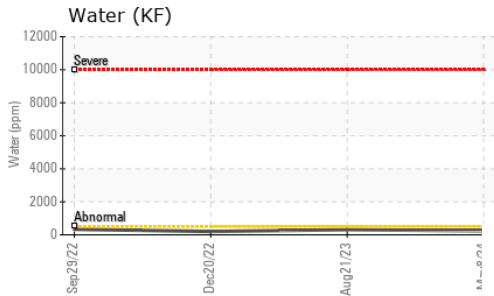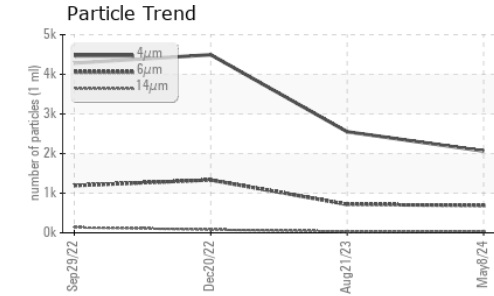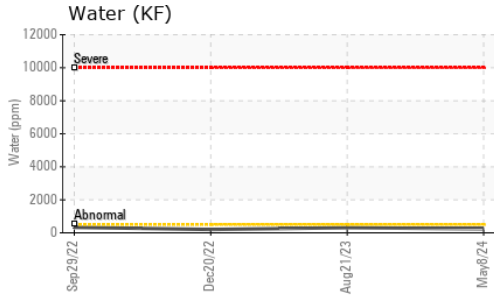






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	45.0	44.3	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

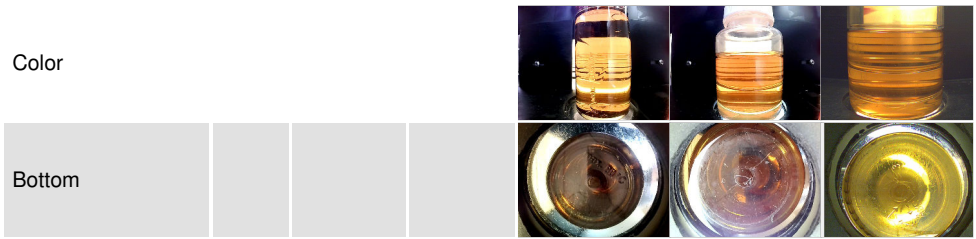

## GRAPHS

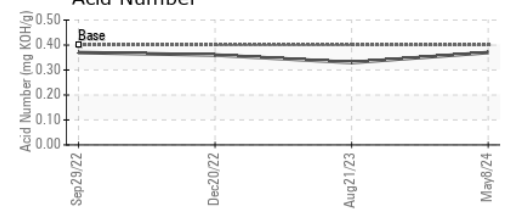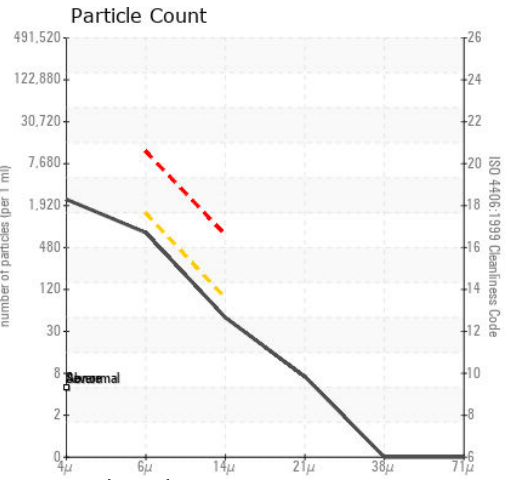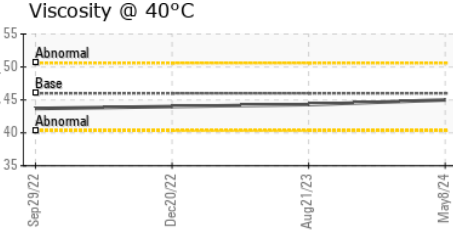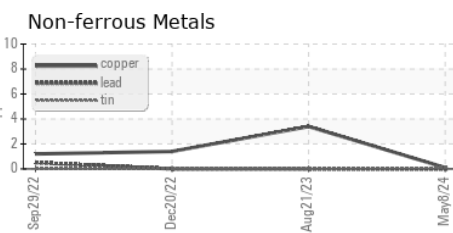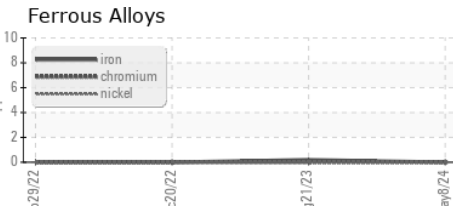

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC129340  
**Lab Number** : 06178761  
**Unique Number** : 11030087  
**Test Package** : IND 2  
**Received** : 14 May 2024  
**Tested** : 15 May 2024  
**Diagnosed** : 16 May 2024 - Angela Borella

**ROCKWOOD MFG**  
 300 MAIN ST  
 ROCKWOOD, PA  
 US 15557  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)