


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

Machine Id

KAESER CSD 100ST 6062252 (S/N 1106)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGN	10 - 10
DIAGIN	

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		ec2018 Jun201	9 Dec2019 Jun2020 Dec20	020 Sep2021 Mar2022 Sep2022 Ju	2023 May202	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC129323	KC122012	KC108937
Sample Date		Client Info		13 May 2024	05 Dec 2023	24 Jul 2023
Machine Age	hrs	Client Info		45870	43510	40827
Oil Age	hrs	Client Info		3000	0	3000
Oil Changed		Client Info		Not Changd	N/A	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	4	7	19
Tin	ppm		>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	3	0	<1
Calcium	ppm	ASTM D5185m	2	0	<1	0
Phosphorus	ppm	ASTM D5185m		0	<1	0
Zinc	ppm	ASTM D5185m		0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	1	0	<1
Water	%	ASTM D6304	>0.05	0.008	0.009	0.005
ppm Water	ppm	ASTM D6304	>500	81	92	58.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3390	387	
Particles >6µm		ASTM D7647	>1300	748	66	
Particles >14μm		ASTM D7647	>80	34	8	
Particles >21µm		ASTM D7647	>20	5	3	
Particles >38µm		ASTM D7647	>4	0	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/12	16/13/10	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A : 1 N		AOTAA DOO 45	0.4	0.40	0.40	0.45

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.40


0.43

0.45



OIL ANALYSIS REPORT



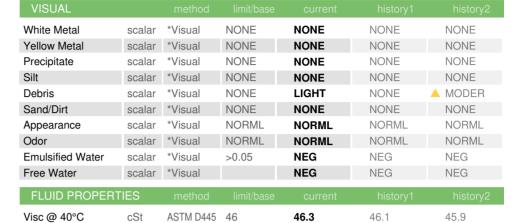



Water (KF) 1200


Color


SAMPLE IMAGES












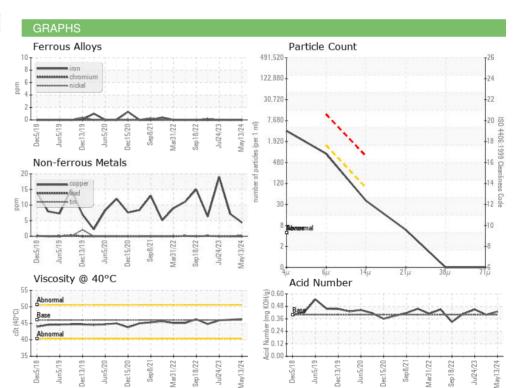





Certificate 12367

Laboratory

Sample No. : KC129323 Lab Number : 06178764 Unique Number : 11030090 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 14 May 2024 **Tested** : 15 May 2024 : 16 May 2024 - Angela Borella

Diagnosed

124 HIDDEN VALLEY RD MCMURRAY, PA US 15317

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

FPD

T:

F: