

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

Machine Id

KAESER ASD 30T 6425484 (S/N 1001)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		0ct2022	! May2023	Oct2023 Mi	ny2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC129861	KC121503	KC107934
Sample Date		Client Info		09 May 2024	24 Oct 2023	02 May 2023
Machine Age	hrs	Client Info		16923	15130	13739
Oil Age	hrs	Client Info		3184	0	2829
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	<1	<1
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	3	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	2	2
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	7	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	20	51	49
Calcium	ppm	ASTM D5185m	2	0	1	0
Phosphorus	ppm	ASTM D5185m		0	10	0
Zinc	ppm	ASTM D5185m		12	9	29
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	4	8
Sodium	ppm	ASTM D5185m		9	24	19
Potassium	ppm	ASTM D5185m	>20	2	6	7
Water	%	ASTM D6304	>0.05	0.014	0.022	0.008
ppm Water	ppm	ASTM D6304	>500	146	224.4	89.0
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1237	492	879
Particles >6µm		ASTM D7647	>1300	306	144	266
Particles >14μm		ASTM D7647	>80	13	9	23
Particles >21µm		ASTM D7647	>20	3	1	5
Particles >38μm		ASTM D7647	>4	0	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	16/14/10	17/15/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A : 1 N	I/OII/	4 OT1 4 D 00 4 F	0 4		0.10	0.44

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.40

0.44

0.41



OIL ANALYSIS REPORT

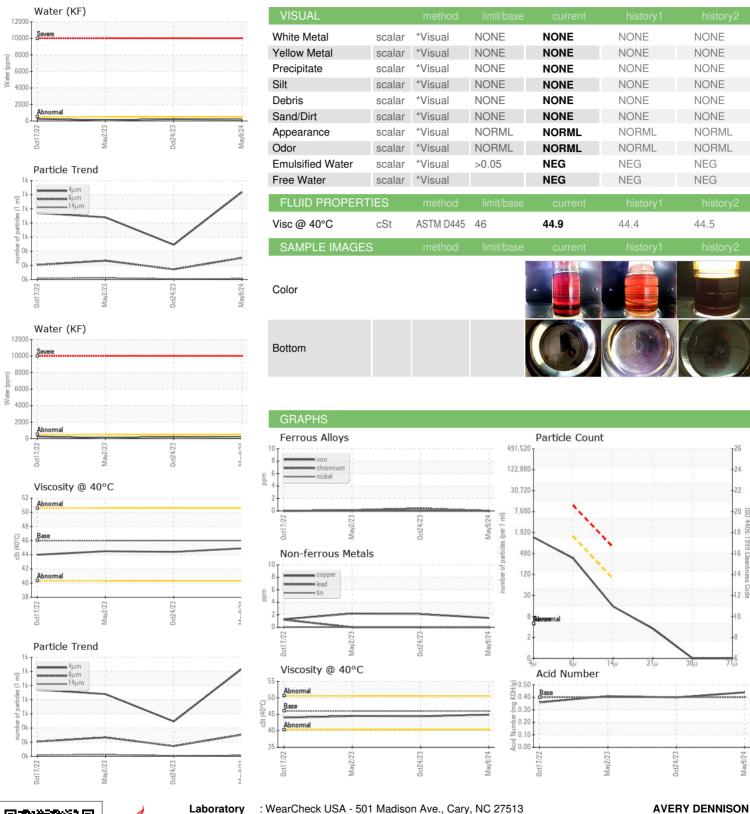





Certificate 12367

Sample No. Lab Number

Laboratory : KC129861 : 06178769 Unique Number : 11030095 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 14 May 2024 **Tested**

: 15 May 2024 Diagnosed

: 16 May 2024 - Don Baldridge

7070 SPINACH DRIVE MENTOR, OH US 44060

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AVEMEN [WUSCAR] 06178769 (Generated: 05/16/2024 12:28:51) Rev: 1

Contact/Location: SERVICE MANAGER ? - AVEMEN

T:

F: