




OIL ANALYSIS REPORT

Sample Rating Trend

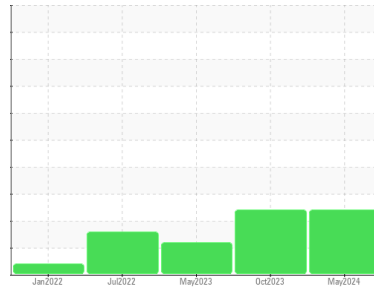

WEAR



Machine Id
6600676 (S/N 1009)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

The copper level is abnormal. All other component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC125862	KC123162	KC110576
Sample Date	Client Info			02 May 2024	13 Oct 2023	25 May 2023
Machine Age	hrs	Client Info		20271	16404	13512
Oil Age	hrs	Client Info		0	0	2800
Oil Changed	Client Info			N/A	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	9
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	▲ 20	2	10
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	0	<1	<1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	4
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		1	<1	<1
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m	500	141	28	200
Zinc	ppm	ASTM D5185m		155	9	69


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	0
Sodium	ppm	ASTM D5185m		2	2	<1
Potassium	ppm	ASTM D5185m	>20	2	2	0
Water	%	ASTM D6304	>0.05	0.005	0.006	0.002
ppm Water	ppm	ASTM D6304	>500	50	61.8	19.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7261	56724	3597
Particles >6µm		ASTM D7647	>1300	▲ 1967	▲ 24592	1135
Particles >14µm		ASTM D7647	>80	▲ 267	▲ 3382	● 129
Particles >21µm		ASTM D7647	>20	▲ 87	▲ 1111	● 39
Particles >38µm		ASTM D7647	>4	2	▲ 77	1
Particles >71µm		ASTM D7647	>3	0	▲ 7	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/15	▲ 23/22/19	● 19/17/14


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.62	0.57	1.11

OIL ANALYSIS REPORT


▲ Particle Trend

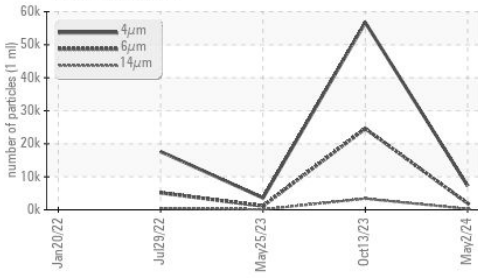


▲ Aluminum (ppm)

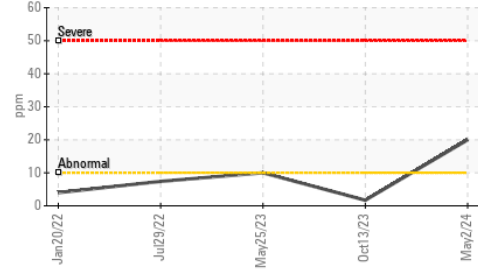


Water (KF)

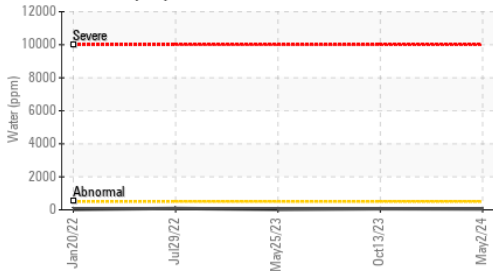

Acid Number

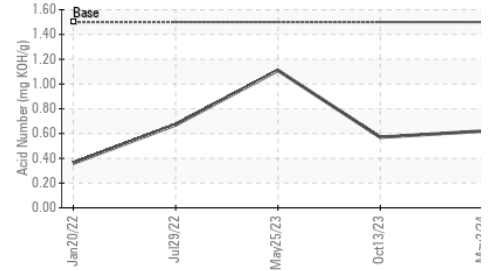


Water (KF)

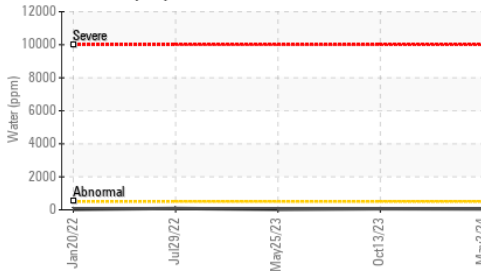

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	48.9	46.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

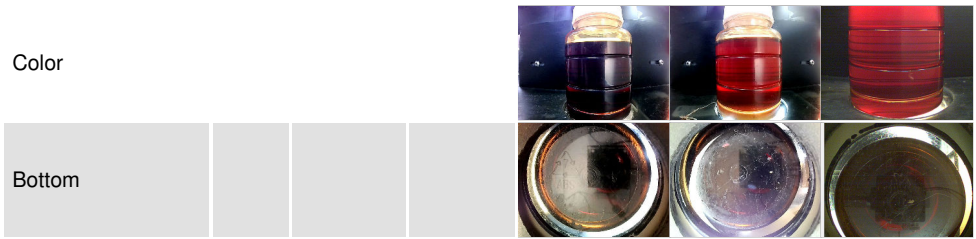


GRAPHS


Ferrous Alloys

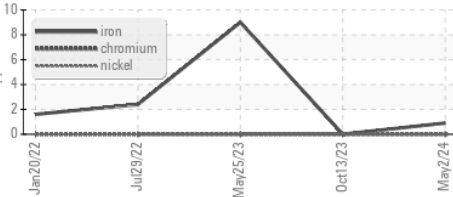


Non-ferrous Metals

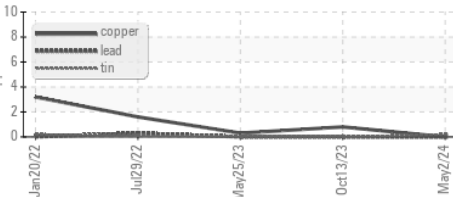


Viscosity @ 40°C

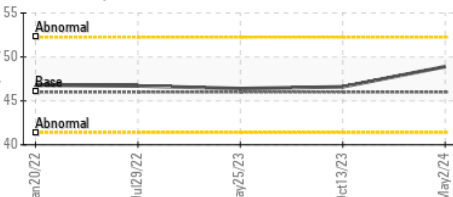

▲ Particle Count

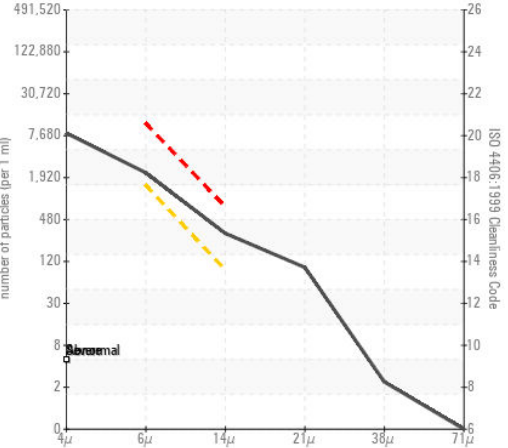

Acid Number

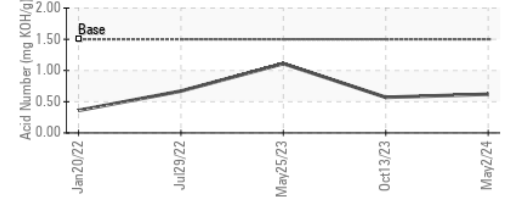

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC125862
Lab Number : 06178775
Unique Number : 11030101
Test Package : IND 2
Received : 14 May 2024
Tested : 17 May 2024
Diagnosed : 17 May 2024 - Don Baldrige

NEXT GEN - FILMS 4
 145 FRECKA DR
 LEXINGTON, OH
 US 44904
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)