




OIL ANALYSIS REPORT

Sample Rating Trend

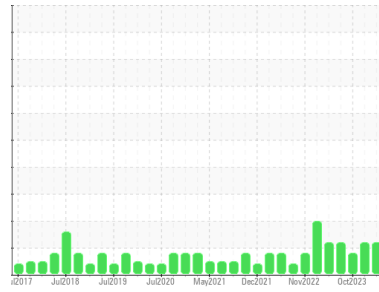

ISO



Machine Id
B37875 - VILTER SCREW COMPRESSOR (S/N 834)
 Component
Refrigeration Compressor
 Fluid
CHEVRON CAPELLA OIL WF 68 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0885508	WC0885504	WC0814203
Sample Date	Client Info		29 Apr 2024	16 Feb 2024	31 Oct 2023
Machine Age	hrs	Client Info	3000	38384	37105
Oil Age	hrs	Client Info	3000	0	7105
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			ATTENTION	ABNORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<1	0	0
Chromium	ppm	ASTM D5185m >2	<1	<1	<1
Nickel	ppm	ASTM D5185m	0	0	<1
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >3	1	0	2
Lead	ppm	ASTM D5185m >2	0	0	<1
Copper	ppm	ASTM D5185m >8	<1	0	<1
Tin	ppm	ASTM D5185m >4	<1	0	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 0	<1	0	<1
Calcium	ppm	ASTM D5185m	3	1	0
Phosphorus	ppm	ASTM D5185m	0	0	3
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m	250	240	162

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<1	0	0
Sodium	ppm	ASTM D5185m	0	0	0
Potassium	ppm	ASTM D5185m >20	1	0	1
Water	%	ASTM D6304 >0.01	0.002	0.001	0.004
ppm Water	ppm	ASTM D6304 >100	18	12	40.1

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	● 14399	▲ 18621	● 10327
Particles >6µm	ASTM D7647	>2500	● 3055	▲ 5326	● 2239
Particles >14µm	ASTM D7647	>320	122	239	58
Particles >21µm	ASTM D7647	>80	18	35	7
Particles >38µm	ASTM D7647	>20	0	1	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	● 21/19/14	▲ 21/20/15	● 21/18/13


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.014	0.014	0.014




OIL ANALYSIS REPORT


Particle Trend

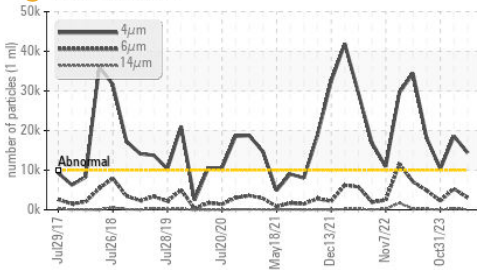


Water (KF)

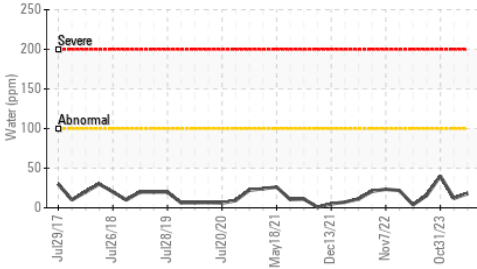


Acid Number

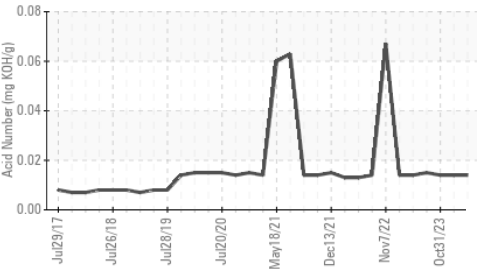

Water (KF)

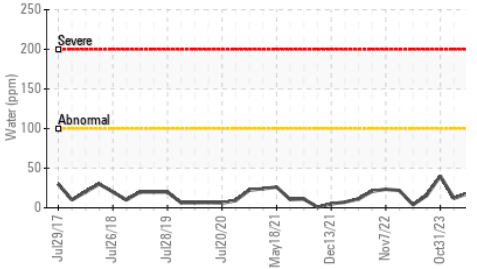

Viscosity @ 40°C

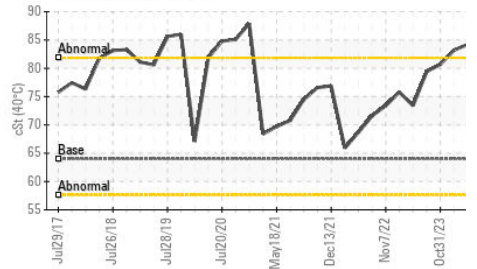


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.0	84.2	83.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

Bottom

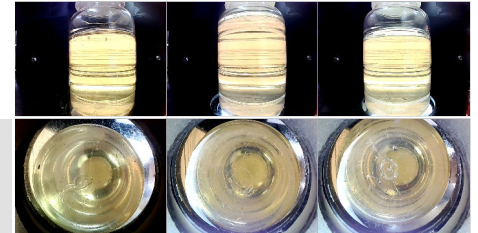


GRAPHS


Ferrous Alloys

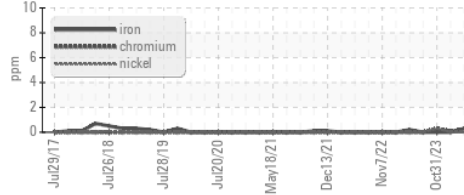


Non-ferrous Metals

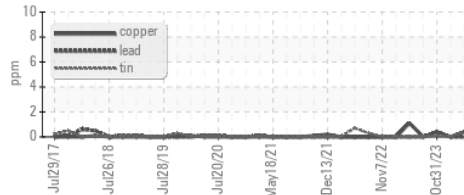


Viscosity @ 40°C

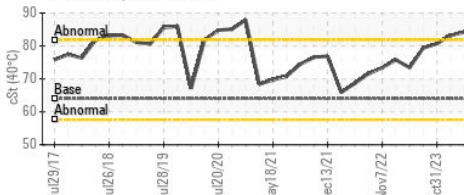

Particle Count

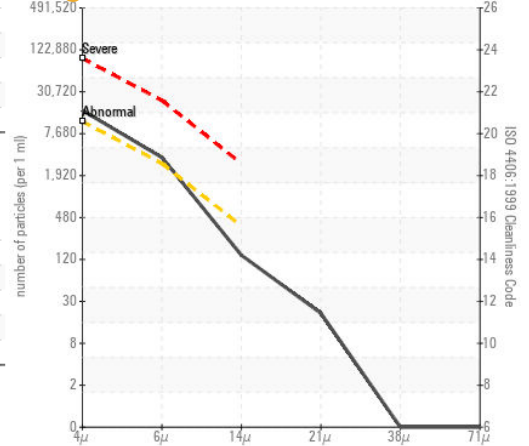

Acid Number

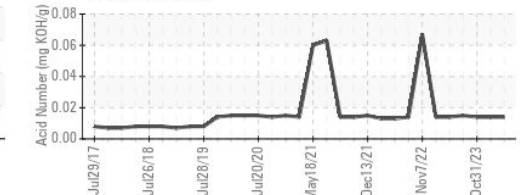

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0885508

Lab Number : 06178831

Unique Number : 11030157

Test Package : IND 2 (Additional Tests: PrtCount)

Received : 14 May 2024

Tested : 16 May 2024

Diagnosed : 16 May 2024 - Angela Borella

HORMEL FOODS-BELOIT

3000 KENNEDY DRIVE

BELOIT, WI

US 53511

Contact: Craig Bennett

cabennett@hormel.com

T:

F: (608)365-8322

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)