




# OIL ANALYSIS REPORT

Sample Rating Trend

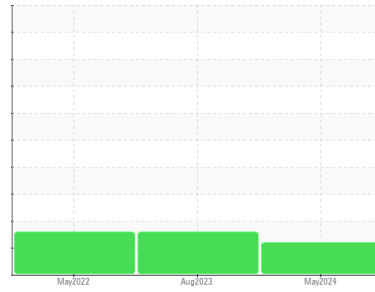

ISO



Machine Id

**77AY02**

Component

**Hydraulic System**

Fluid

**KLUBER KLUBEROIL 4 UH1-68 N (5 GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible.

### Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0888948</b>	WC0840221	WC0688438
Sample Date	Client Info		<b>09 May 2024</b>	11 Aug 2023	25 May 2022
Machine Age	yrs	Client Info	<b>0</b>	0	0
Oil Age	yrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	Not Changd	N/A
Sample Status			<b>ABNORMAL</b>	MARGINAL	MARGINAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>0</b>	1	<1
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	1	0
Copper	ppm	ASTM D5185m >20	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>3</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>1</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>669</b>	912	631
Zinc	ppm	ASTM D5185m	<b>0</b>	5	0
Sulfur	ppm	ASTM D5185m	<b>1122</b>	1128	540

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>6</b>	▲ 15	▲ 16
Sodium	ppm	ASTM D5185m	<b>1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	0
Water	%	ASTM D6304 >0.05	<b>0.002</b>	0.002	0.00
ppm Water	ppm	ASTM D6304 >500	<b>23</b>	22.3	0.00

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ <b>10894</b>	2779	318
Particles >6µm	ASTM D7647	>1300	● <b>2181</b>	438	67
Particles >14µm	ASTM D7647	>160	<b>128</b>	25	9
Particles >21µm	ASTM D7647	>40	<b>41</b>	7	2
Particles >38µm	ASTM D7647	>10	<b>2</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ <b>21/18/14</b>	19/16/12	15/13/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.95</b>	1.14	0.83




# OIL ANALYSIS REPORT

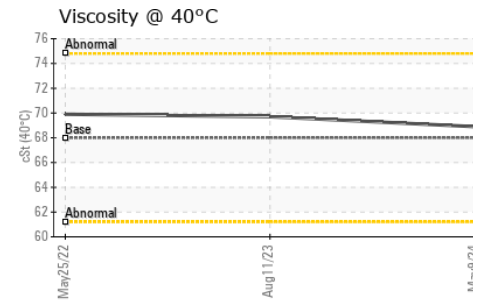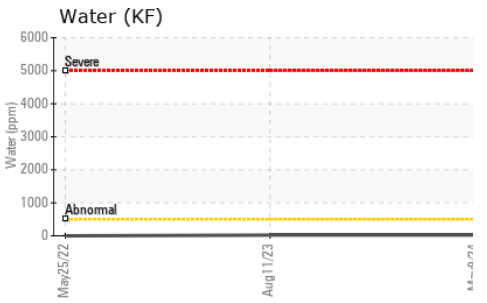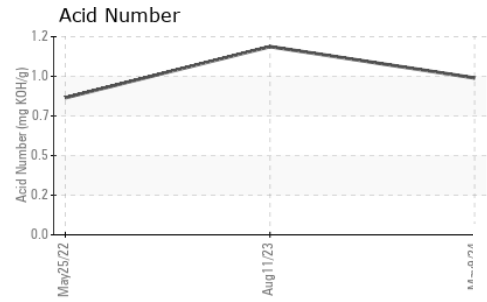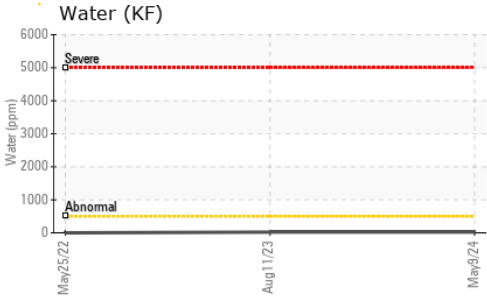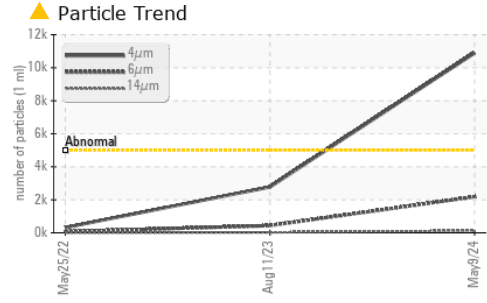




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	<b>68.9</b>	69.7	69.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

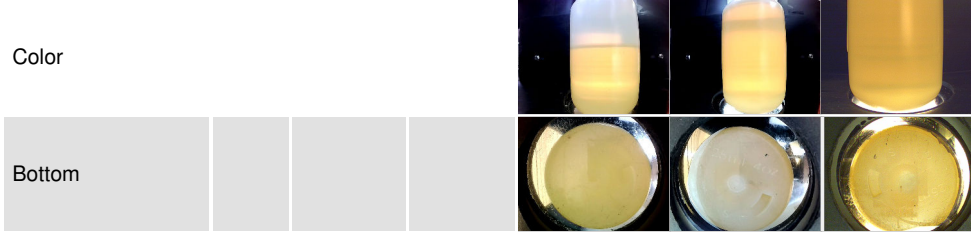

## GRAPHS

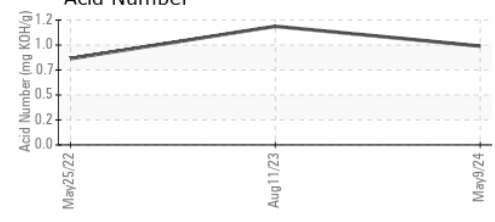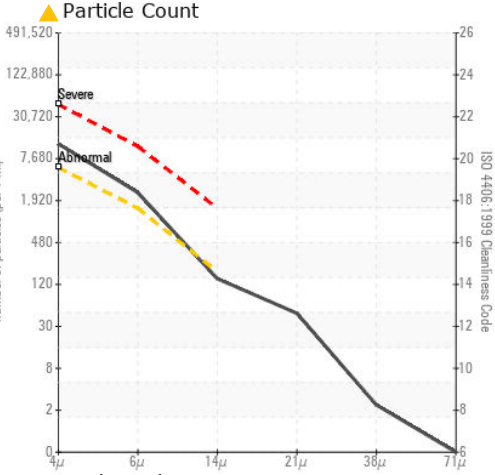

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0888948      **Received** : 14 May 2024  
**Lab Number** : **06179425**      **Tested** : 16 May 2024  
**Unique Number** : 11030751      **Diagnosed** : 16 May 2024 - Wes Davis  
**Test Package** : IND 2 ( Additional Tests: KF )

**GRIFOLS TALECRIS PHARMACEUTICAL**  
 8368 US 70 WEST  
 CLAYTON, NC  
 US 27520  
 Contact: KEN TERRY  
 kenneth.terry@grifols.com  
 T: (919)359-4362  
 F: (919)359-4767

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)