


# **OIL ANALYSIS REPORT**

Sample Rating Trend

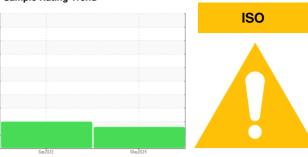

Machine Id

# **KAESER 7878189**

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Sep 2022	May2024		
CAMPLE INCOR	AATIONI	and the second	15		for the second of	la la tarre O
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016779	KCP47272	
Sample Date		Client Info		06 May 2024	26 Sep 2022	
Machine Age	hrs	Client Info		5316	2160	
Oil Age	hrs	Client Info		2169	646	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	4	2	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	63	71	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	100	79	94	
Calcium	ppm	ASTM D5185m	0	4	3	
Phosphorus	ppm	ASTM D5185m	0	3	32	
Zinc	ppm	ASTM D5185m	0	2	4	
Sulfur	ppm	ASTM D5185m	23500	25255	24890	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	10	
Sodium	ppm	ASTM D5185m		28	11	
Potassium	ppm	ASTM D5185m	>20	9	4	
Water	%	ASTM D6304	>0.05	0.028	0.017	
ppm Water	ppm	ASTM D6304	>500	282	176.5	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		58897	39667	
Particles >6µm		ASTM D7647	>1300	<b>19759</b>	<u> </u>	
Particles >14µm		ASTM D7647	>80	<b>1408</b>	<b>△</b> 1094	
Particles >21µm		ASTM D7647	>20	<b>^</b> 268	<u>^</u> 213	
Particles >38µm		ASTM D7647	>4	4	<u>^</u> 12	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>23/21/18</b>	<u>22/21/17</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
. LO.D DEGITION	1/011/			0.27	0.00	. Hotory L

Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.38

0.37



## **OIL ANALYSIS REPORT**







Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA016779 : 06179450 Unique Number : 11030776

Received : 14 May 2024 **Tested** Diagnosed

: 17 May 2024 : 17 May 2024 - Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**AMAZON OKC2** 8991 S PORTLAND AVE

OKLAHOMA CITY, OK US 73159

Contact: JOSH UOLS joshuols@amazon.com

T: F: