

Sample Rating Trend

ISO



KAESER ASD 40 7854293 (S/N 1334)

Component Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
|--|-------------------|----------------------|---------------|-------------|----------|----------|
| Sample Number | | Client Info | | KCPA017307 | | |
| Sample Date | | Client Info | | 07 May 2024 | | |
| Machine Age | hrs | Client Info | | 7793 | | |
| Oil Age | hrs | Client Info | | 1033 | | |
| Oil Changed | | Client Info | | Not Changd | | |
| Sample Status | | | | ABNORMAL | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | | |
| Chromium | ppm | | >10 | 0 | | |
| Nickel | ppm | ASTM D5185m | >3 | <1 | | |
| Titanium | ppm | | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | | |
| Lead | | ASTM D5185m | >10 | 0 | | |
| | ppm | ASTM D5185m | | 4 | | |
| Copper Tin | ppm | | >50 | - | | |
| | ppm | ASTM D5185m | >10 | <1 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | | |
| Barium | ppm | ASTM D5185m | 90 | 16 | | |
| Molybdenum | ppm | ASTM D5185m | | 0 | | |
| Manganese | ppm | ASTM D5185m | | <1 | | |
| Magnesium | ppm | ASTM D5185m | 90 | 64 | | |
| Calcium | ppm | ASTM D5185m | 2 | 2 | | |
| Phosphorus | ppm | ASTM D5185m | | 3 | | |
| Zinc | ppm | ASTM D5185m | | 20 | | |
| Sulfur | ppm | ASTM D5185m | | 22258 | | |
| CONTAMINANTS | 5 | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 0 | | |
| Sodium | ppm | ASTM D5185m | | 17 | | |
| Potassium | ppm | ASTM D5185m | >20 | 7 | | |
| Water | % | ASTM D6304 | | 0.025 | | |
| ppm Water | ppm | ASTM D6304 | | 257 | | |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 27626 | | |
| Particles >6μm | | ASTM D7647 | >1300 | <u> </u> | | |
| Particles >14µm | | ASTM D7647 | >80 | 9 43 | | |
| Particles >21µm | | ASTM D7647 | | <u> </u> | | |
| Particles >38µm | | ASTM D7647 | >4 | 3 | | |
| Particles >71µm | | ASTM D7647 | | 0 | | |
| | | ISO 4406 (c) | >/17/13 | 0 22/21/17 | | |
| Oil Cleanliness | | | - / - / / - 0 | | | |
| | TION | () | | | | |
| Oil Cleanliness FLUID DEGRADA Acid Number (AN) | ATION mg KOH/g | method ASTM D8045 | limit/base | current | history1 | history2 |



30


25


20 ä

15i

Built for a lifetime Particle Trend

______14µm



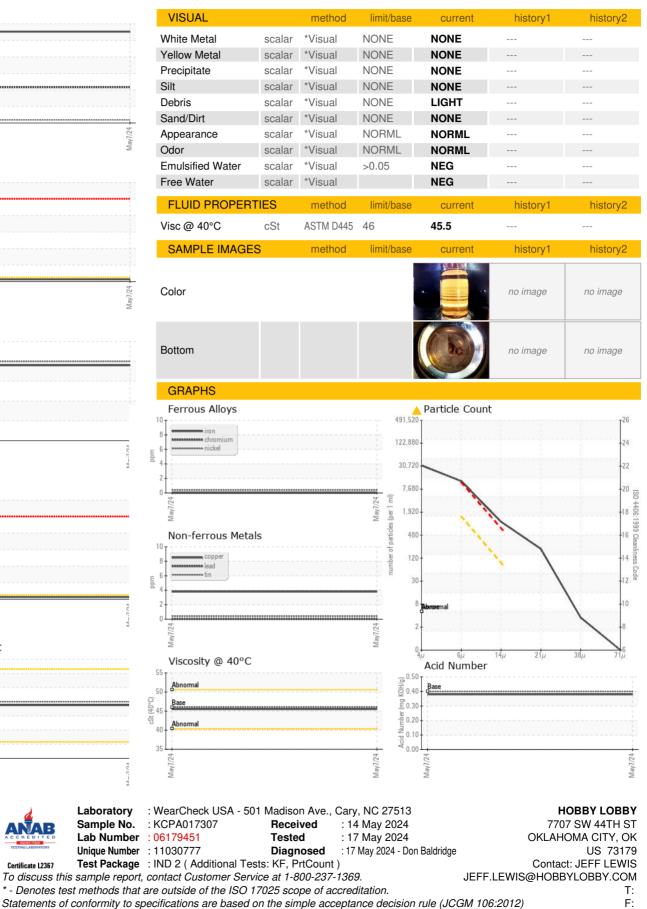

0 Water (KF) 12000 1000 800 (maa) 600 Water 400 200 Acid Number 0.50 (B/HO) Ê0.3 Pio 0.1 0.00 Water (KF) 1000 600 Water (4000 200 Abnormal Unav Viscosity @ 40°C 52 5 48 ()-41 ()-41 ()-44)()-44 ()-44) 47 Abno 40 3

Report Id: HOBOKL [WUSCAR] 06179451 (Generated: 05/17/2024 11:37:02) Rev: 1

Contact/Location: JEFF LEWIS - HOBOKL