


OIL ANALYSIS REPORT

Sample Rating Trend

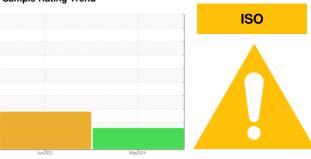

Machine Id

KAESER AS 30 6440707

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jun 2023	May2024		
CAMPLE INFORM	AATIONI	and the second	11		foto to mod	la la tarre O
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017813	KCPA003163	
Sample Date		Client Info		10 May 2024	05 Jun 2023	
Machine Age	hrs	Client Info		6923	5848	
Oil Age	hrs	Client Info		2000	0	
Oil Changed		Client Info		Not Changd	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	3	5	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		<1	<1	
	ррпп					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	12	4	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	63	39	
Calcium	ppm	ASTM D5185m	2	3	3	
Phosphorus	ppm	ASTM D5185m		49	129	
Zinc	ppm	ASTM D5185m		7	2	
Sulfur	ppm	ASTM D5185m		20078	17449	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	11	
Sodium	ppm	ASTM D5185m		21	19	
Potassium	ppm	ASTM D5185m	>20	6	7	
Water	%	ASTM D6304	>0.05	0.025	<u>^</u> 0.472	
ppm Water	ppm	ASTM D6304	>500	250	▲ 4720	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10149		
Particles >6µm		ASTM D7647	>1300	△ 3689		
Particles >14µm		ASTM D7647	>80	480		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	3		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	△ 21/19/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34	0.28	



OIL ANALYSIS REPORT

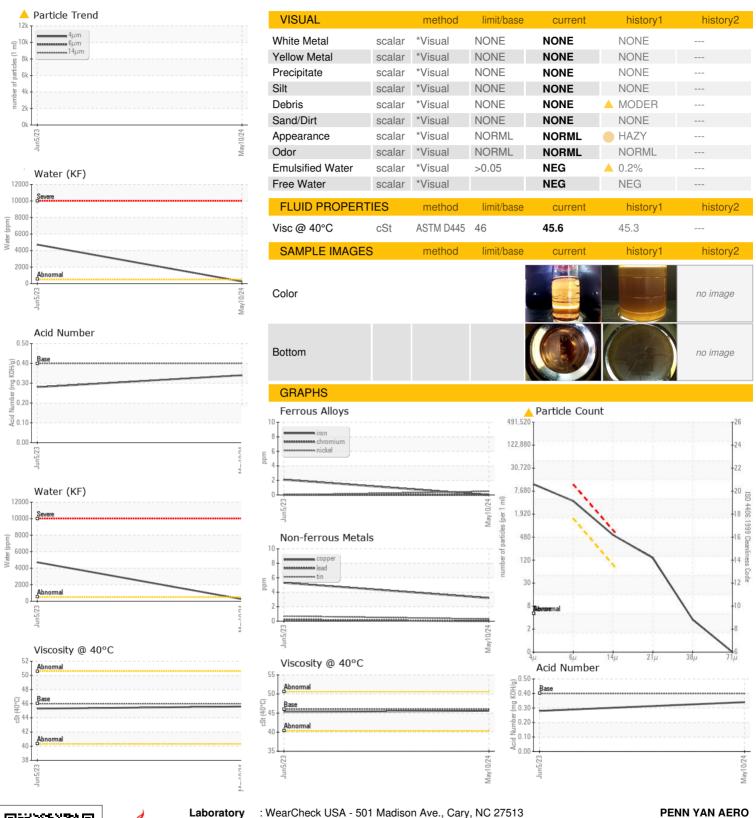



Certificate 12367

Laboratory Sample No.

: KCPA017813 Lab Number : 06179460 Unique Number : 11030786

Received **Tested** Diagnosed

: 17 May 2024

: 17 May 2024 - Don Baldridge

2499 BATH RD PENN YAN, NY US 14527 Contact: SERVICE MANAGER

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 14 May 2024

Contact/Location: SERVICE MANAGER - PENPENNY

T:

F: