

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER 8723459 (S/N 2150)

Component Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

## DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	<b>MATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KC129468	KC107558	
Sample Date		Client Info		07 May 2024	13 Apr 2023	
Machine Age	hrs	Client Info		3216	751	
Oil Age	hrs	Client Info		2465	751	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	nnm	ASTM D5185m	>50	0	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	۰ <1	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
	ppm				0	
Aluminum	ppm	ASTM D5185m		<1		
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m		5	<1	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	<1	45	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		<1	<1	
Magnesium	ppm	ASTM D5185m	90	47	81	
Calcium	ppm	ASTM D5185m	2	1	4	
Phosphorus	ppm	ASTM D5185m		3	4	
Zinc	ppm	ASTM D5185m		4	4	
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	3	
Sodium	ppm	ASTM D5185m		14	12	
Potassium	ppm	ASTM D5185m	>20	5	5	
Water	%	ASTM D6304	>0.05	0.027	0.019	
ppm Water	ppm	ASTM D6304	>500	275	198.5	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		15135	7006	
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u> </u>	
Particles >14µm		ASTM D7647	>80	<b>A</b> 371	<b>A</b> 86	
Particles >21µm		ASTM D7647	>20	<u> </u>	9	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>A</b> 21/19/16	▲ 20/19/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.29	
			5	0.02	0.20	





#### Built for a lifetime







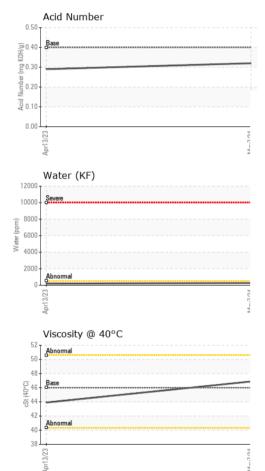

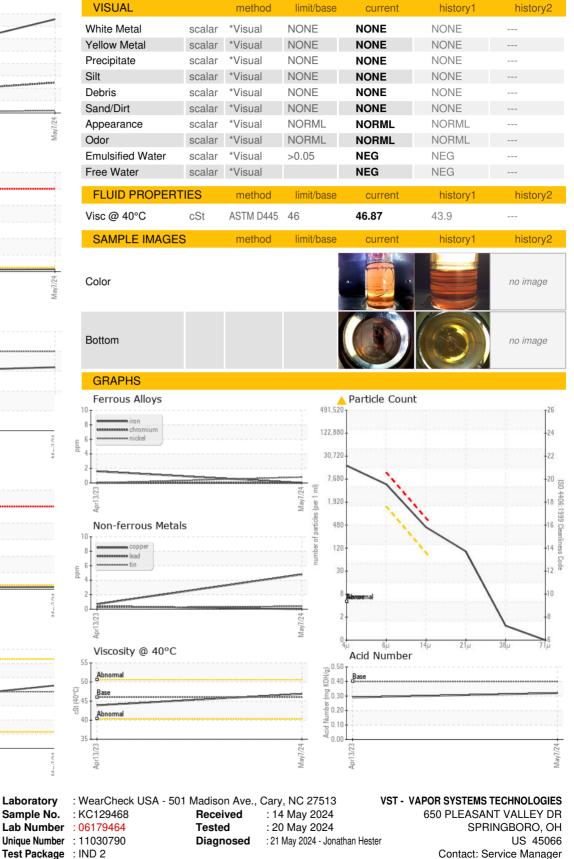

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

Laboratory

Sample No.

Lab Number

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: VSTSPR [WUSCAR] 06179464 (Generated: 05/21/2024 08:46:55) Rev: 1

Contact/Location: Service Manager - VSTSPR

T:

F: