

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 8413764

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC129410		
Sample Date		Client Info		07 May 2024		
Machine Age	hrs	Client Info		3626		
Oil Age	hrs	Client Info		3626		
Oil Changed	1113	Client Info		Changed		
Sample Status		Oliciti IIIIo		NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	nnm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>10	<1		
	ppm					
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm		>50	2		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	56		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	84		
Calcium	ppm	ASTM D5185m	0	4		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	2		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		23		
Potassium	ppm	ASTM D5185m	>20	14		
Water	%	ASTM D6304	>0.05	0.030		
ppm Water	ppm	ASTM D6304	>500	301		
FLUID CLEANLINI	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2005		
Particles >6µm		ASTM D7647	>1300	579		
Particles >14μm		ASTM D7647	>80	57		
Particles >21µm		ASTM D7647	>20	9		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.37



OIL ANALYSIS REPORT

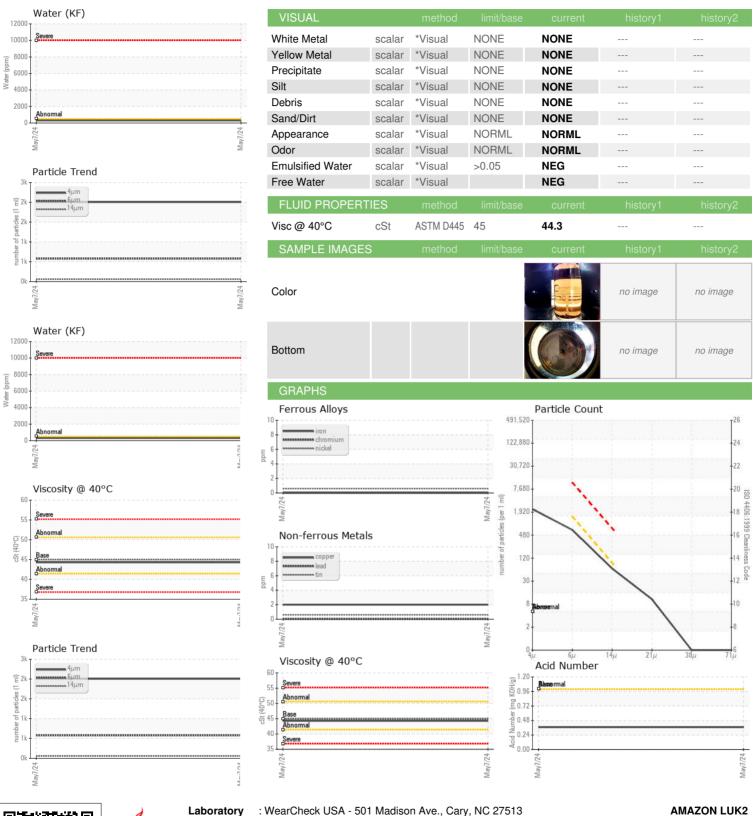



Certificate 12367

Laboratory Sample No. : KC129410 Lab Number : 06179465 Unique Number : 11030791 Test Package : IND 2

Received

: 14 May 2024 **Tested** : 17 May 2024 Diagnosed : 17 May 2024 - Don Baldridge 1835 UNION AIRPARK BLVD UNION, OH US 45377

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: