




# OIL ANALYSIS REPORT

## Sample Rating Trend

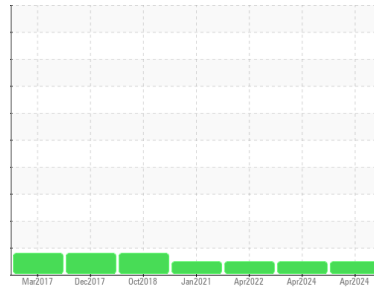

**NORMAL**



Machine Id  
**WARWICK NECK (S/N 241307)**

Component  
**Natural Gas Engine**  
 Fluid  
**{not provided} (--- GAL)**

### DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 Metal levels are typical for a new component breaking in.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0039515</b>	RP0039458	RP0025677
Sample Date	Client Info		<b>19 Apr 2024</b>	10 Apr 2024	08 Apr 2022
Machine Age	hrs	Client Info	<b>832</b>	832	827
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	---	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>15</b>	16	20
Chromium	ppm	ASTM D5185m >4	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >9	<b>5</b>	4	6
Lead	ppm	ASTM D5185m >30	<b>3</b>	3	2
Copper	ppm	ASTM D5185m >35	<b>41</b>	45	19
Tin	ppm	ASTM D5185m >4	<b>1</b>	1	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>7</b>	2	197
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>147</b>	149	99
Manganese	ppm	ASTM D5185m	<b>1</b>	<1	4
Magnesium	ppm	ASTM D5185m	<b>941</b>	882	237
Calcium	ppm	ASTM D5185m	<b>2849</b>	2829	2461
Phosphorus	ppm	ASTM D5185m	<b>286</b>	303	680
Zinc	ppm	ASTM D5185m	<b>355</b>	325	808

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	<b>12</b>	14	85
Sodium	ppm	ASTM D5185m	<b>14</b>	6	4
Potassium	ppm	ASTM D5185m >20	<b>6</b>	5	10
Water	%	ASTM D6304 >0.1	<b>NEG</b>	NEG	NEG

### INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>7.1</b>	7.2	5.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>37.6</b>	▲ 37.8	21.6

### FLUID DEGRADATION


	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>53.6</b>	▲ 54.2	19.9
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>---</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	<b>12.83</b>	13.00	9.15

# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

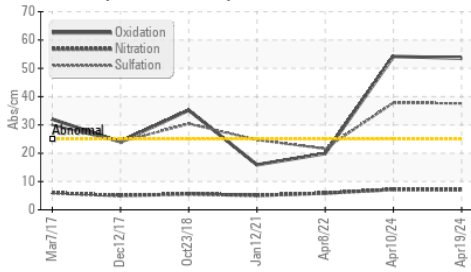


Base Number

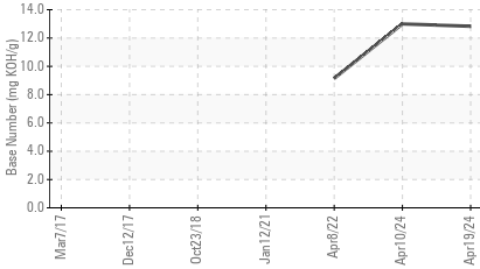


Viscosity @ 100°C

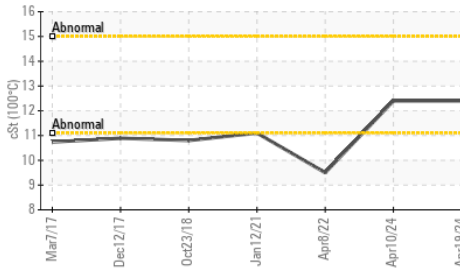

Viscosity @ 40°C

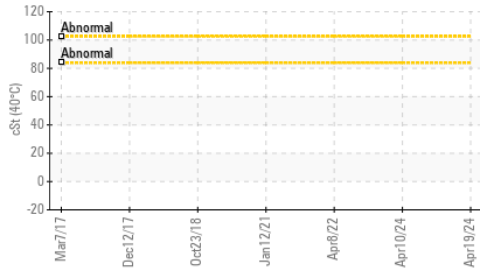

Acid Number

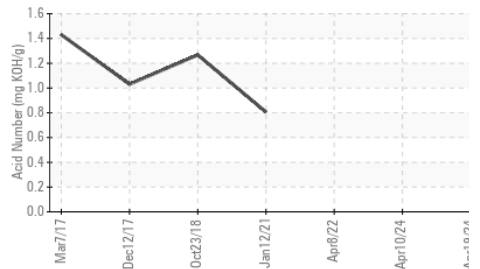


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.4	12.4	9.5

GRAPHS


Ferrous Alloys

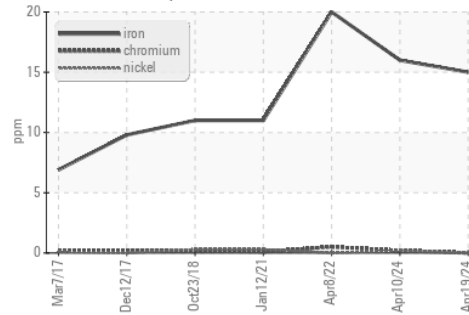


Non-ferrous Metals

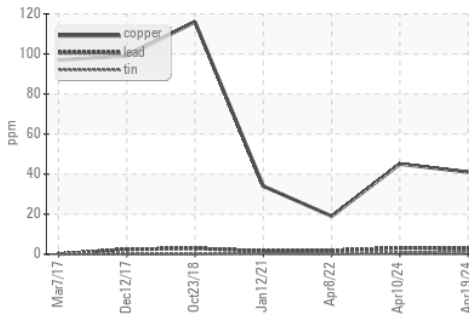

Viscosity @ 100°C

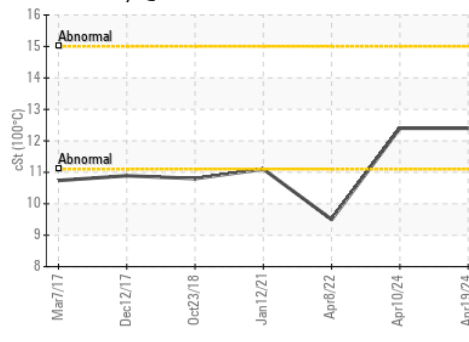

Acid Number

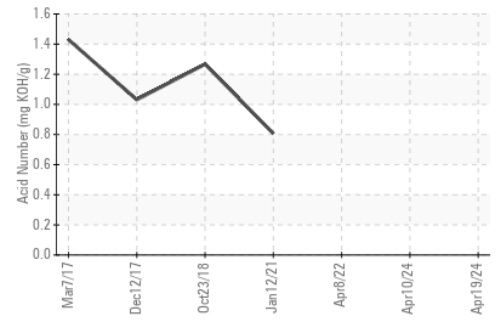

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0039515 **Received** : 14 May 2024  
**Lab Number** : 06179502 **Tested** : 17 May 2024  
**Unique Number** : 11030828 **Diagnosed** : 17 May 2024 - Sean Felton  
**Test Package** : IND 2 ( Additional Tests: FT-IR, KV100, TBN )

**WARWICK SEWER AUTHORITY**  
 125 ARTHUR DEVINE BLVD  
 WARWICK, RI  
 US 02888  
 Contact: JOHN BROSNAHAN  
 john.s.brosnahan@warwickri.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)