




# OIL ANALYSIS REPORT

Sample Rating Trend

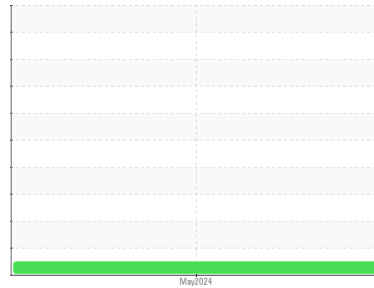

**NORMAL**



Area  
**[185211-N2STV4W]**  
 Machine Id  
**EXT 8**  
 Component  
**Gearbox**  
 Fluid  
**MOBIL SHC 634 (3 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PH06180133</b>	---	---
Sample Date	Client Info			<b>08 May 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	<b>NEG</b>	---	---


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>2</b>	---	---
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m	>200	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>456</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>0</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>24</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	---	---





FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	<b>17275</b>	---	---
Particles >6µm		ASTM D7647	>5000	<b>2435</b>	---	---
Particles >14µm		ASTM D7647	>640	<b>61</b>	---	---
Particles >21µm		ASTM D7647	>160	<b>6</b>	---	---
Particles >38µm		ASTM D7647	>40	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	<b>21/18/13</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.67</b>	---	---

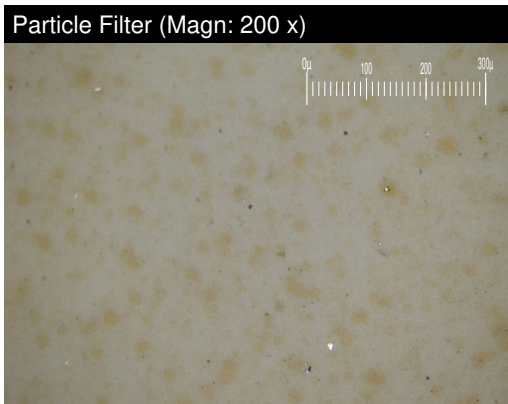



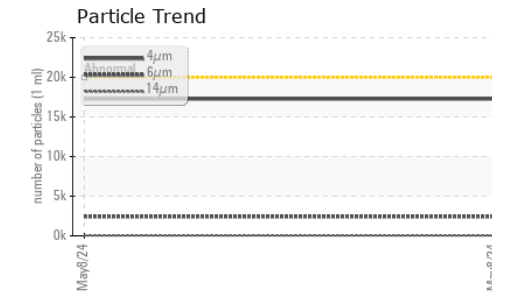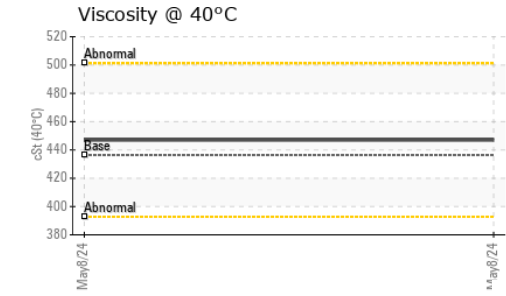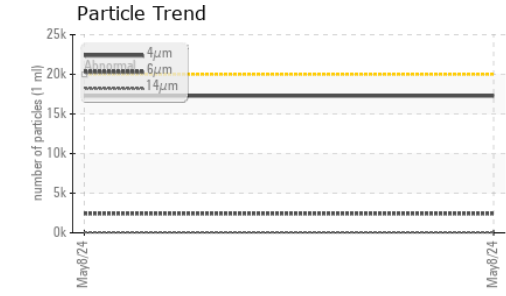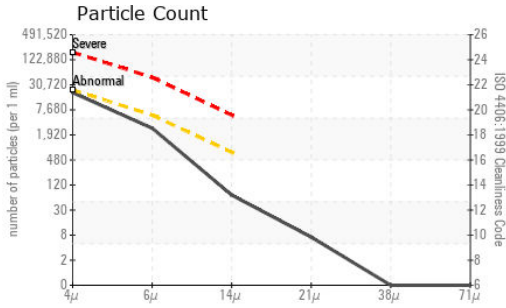

# OIL ANALYSIS REPORT









VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	436.4	<b>447</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image
PrtFilter				no image	no image

## GRAPHS

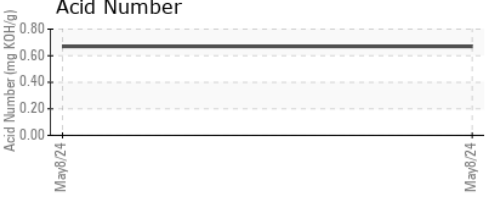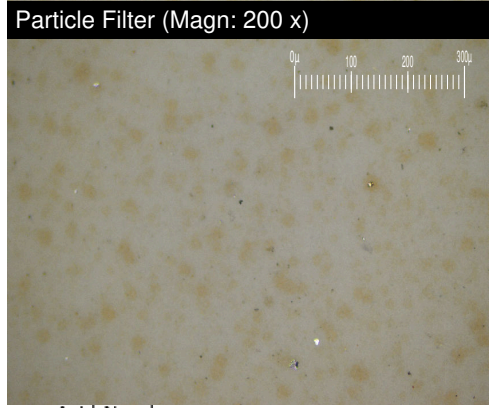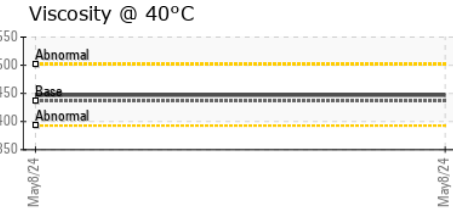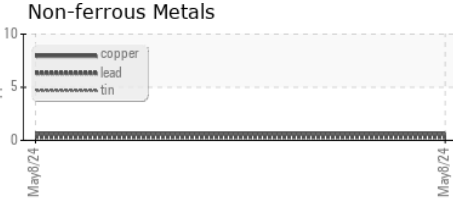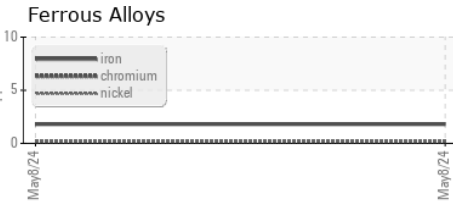

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PH06180133      **Received** : 15 May 2024  
**Lab Number** : **06180133**      **Tested** : 18 May 2024  
**Unique Number** : 11031459      **Diagnosed** : 18 May 2024 - Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: PrtFilter )

**TRELLEBORG HEALTHCARE AND MEDICAL**  
 3077 ROLLIE GATE DR  
 PASO POBLES, CA  
 US 93446  
 Contact: DARRYL DRUM  
 DARRYL.DRUM@TRELLEBORG.COM  
 T: (805)239-4284  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)