




OIL ANALYSIS REPORT

Sample Rating Trend

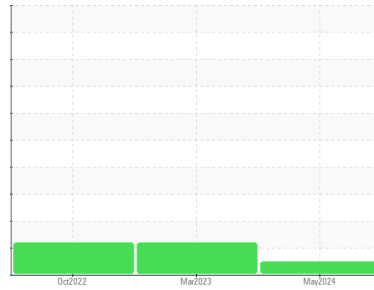

NORMAL



Area

[9675]

Machine Id

KAESER ASD 40T 8362479 (S/N 1306)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC131547	KC111874	KC63925
Sample Date	Client Info	09 May 2024	31 Mar 2023	24 Oct 2022
Machine Age	hrs Client Info	6758	3631	2124
Oil Age	hrs Client Info	3126	1506	2124
Oil Changed	Client Info	Changed	Changed	Changed
Sample Status		NORMAL	ATTENTION	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<1	<1	0
Chromium ppm ASTM D5185m	>10	<1	<1	0
Nickel ppm ASTM D5185m	>3	<1	<1	0
Titanium ppm ASTM D5185m	>3	<1	0	0
Silver ppm ASTM D5185m	>2	<1	0	0
Aluminum ppm ASTM D5185m	>10	2	0	<1
Lead ppm ASTM D5185m	>10	<1	0	0
Copper ppm ASTM D5185m	>50	6	3	3
Tin ppm ASTM D5185m	>10	<1	0	0
Vanadium ppm ASTM D5185m		<1	0	0
Cadmium ppm ASTM D5185m		<1	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	0	0
Barium ppm ASTM D5185m	90	0	4	3
Molybdenum ppm ASTM D5185m		<1	<1	0
Manganese ppm ASTM D5185m		0	<1	<1
Magnesium ppm ASTM D5185m	90	9	51	30
Calcium ppm ASTM D5185m	2	<1	0	0
Phosphorus ppm ASTM D5185m		7	10	2
Zinc ppm ASTM D5185m		3	1	4

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	<1	1	2
Sodium ppm ASTM D5185m		0	0	1
Potassium ppm ASTM D5185m	>20	1	<1	0
Water % ASTM D6304	>0.05	0.008	0.008	0.007
ppm Water ppm ASTM D6304	>500	80	84.4	70.7






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		2109	8696	8952
Particles >6µm ASTM D7647	>1300	674	● 2477	▲ 3894
Particles >14µm ASTM D7647	>80	33	● 94	▲ 178
Particles >21µm ASTM D7647	>20	6	20	14
Particles >38µm ASTM D7647	>4	0	0	1
Particles >71µm ASTM D7647	>3	0	0	0
Oil Cleanliness ISO 4406 (c)	>--/17/13	18/17/12	● 20/18/14	▲ 20/19/15

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.4	0.35	0.38	0.34


OIL ANALYSIS REPORT

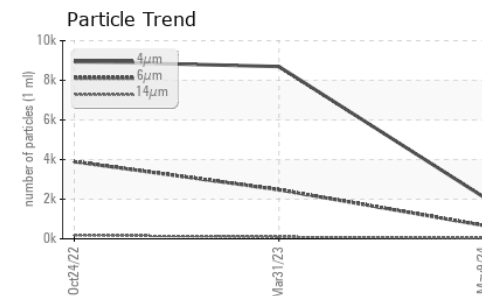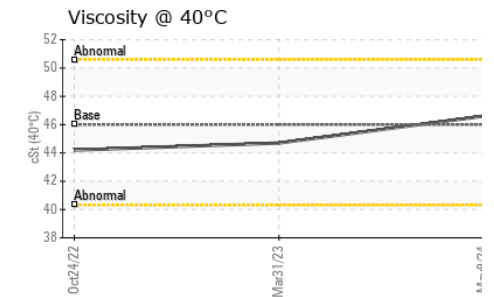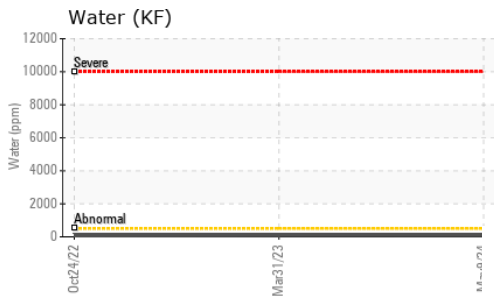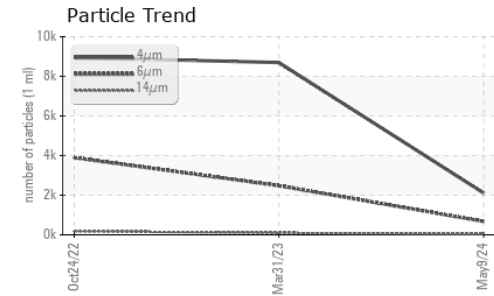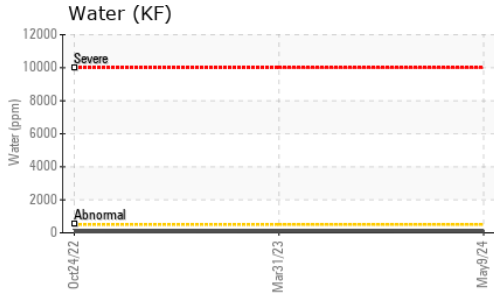



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.6	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

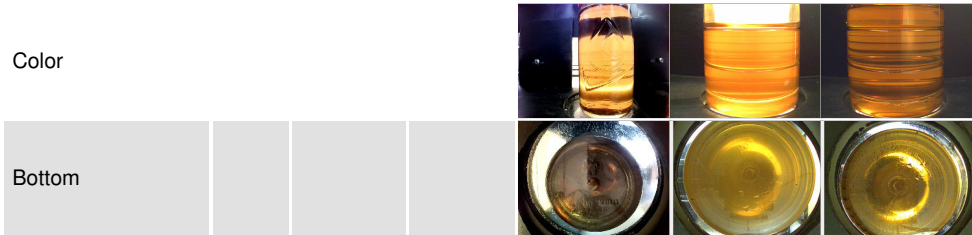

GRAPHS

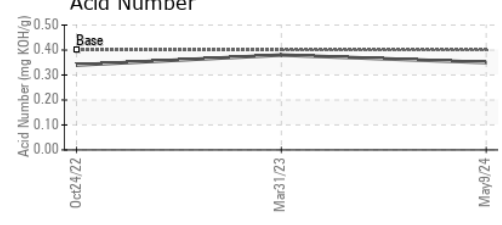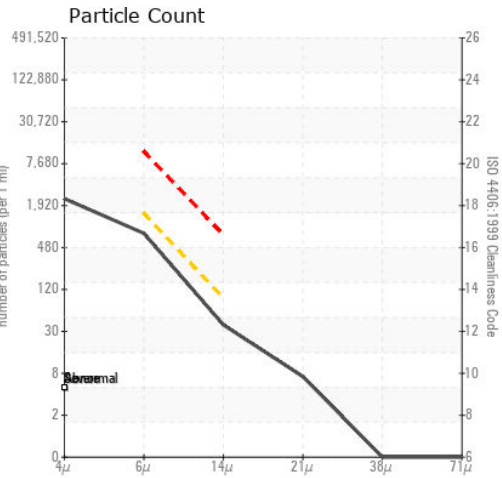

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC131547
Lab Number : 06180164
Unique Number : 11031490
Test Package : IND 2
Received : 15 May 2024
Tested : 16 May 2024
Diagnosed : 17 May 2024 - Don Baldrige

MASTER TOOL & MFG INC
 829 N COMPTON DR
 HIAWATHA, IA
 US 52233
 Contact: CLINT BITTERMAN
 clint.bitterman@mastertoolmfg.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)