




OIL ANALYSIS REPORT

Sample Rating Trend

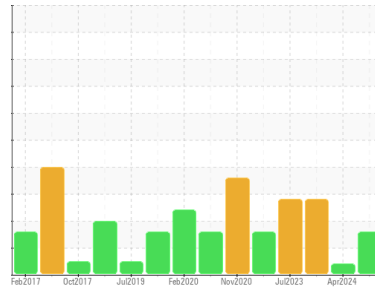

WATER



Machine Id

SULLAIR 6 (S/N 201402220045)

Component

Compressor

Fluid

USPI 1542-32 (--- GAL)

DIAGNOSIS

▲ Recommendation

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USPM36156	USPM36812	USPM31301
Sample Date	Client Info		14 May 2024	23 Apr 2024	18 Nov 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	1	4	▲ 39
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	<1	0	0
Aluminum	ppm	ASTM D5185m >25	2	0	0
Lead	ppm	ASTM D5185m >25	<1	0	0
Copper	ppm	ASTM D5185m >50	3	0	0
Tin	ppm	ASTM D5185m >15	<1	0	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	520	0	0
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	1	<1	<1
Calcium	ppm	ASTM D5185m	11	<1	1
Phosphorus	ppm	ASTM D5185m	24	990	● 1531
Zinc	ppm	ASTM D5185m	16	0	0
Sulfur	ppm	ASTM D5185m	399	29	5

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	2	2
Sodium	ppm	ASTM D5185m	45	0	2
Potassium	ppm	ASTM D5185m >20	5	0	<1
Water	%	ASTM D6304 >0.1	▲ 0.296	0.048	0.085
ppm Water	ppm	ASTM D6304 >1000	▲ 2965	484	854.7






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	2437	1903	● 14920
Particles >6µm	ASTM D7647	>2500	532	428	● 3603
Particles >14µm	ASTM D7647	>320	42	26	304
Particles >21µm	ASTM D7647	>80	12	7	79
Particles >38µm	ASTM D7647	>20	1	0	6
Particles >71µm	ASTM D7647	>4	0	0	2
Oil Cleanliness	ISO 4406 (c)	>20/18/15	18/16/13	18/16/12	● 21/19/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.738	0.30	0.24


OIL ANALYSIS REPORT

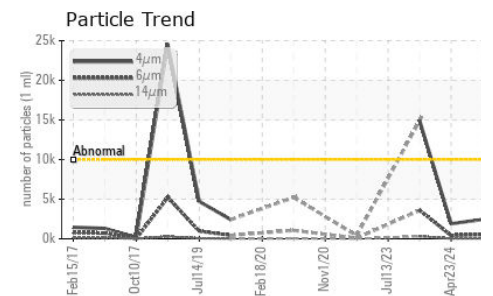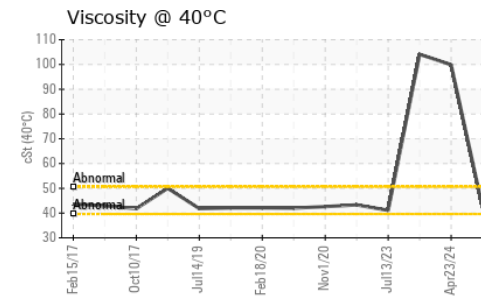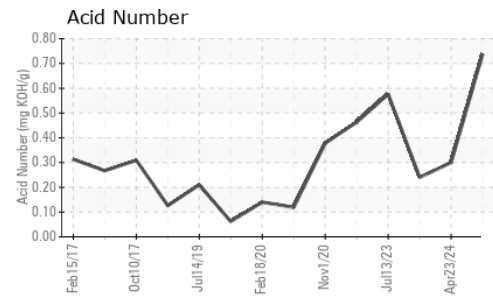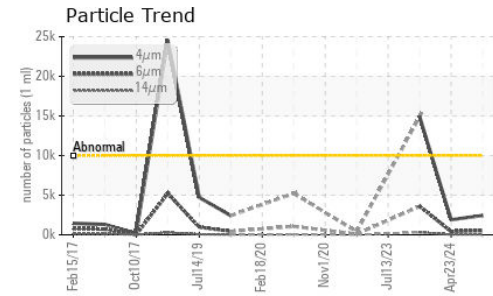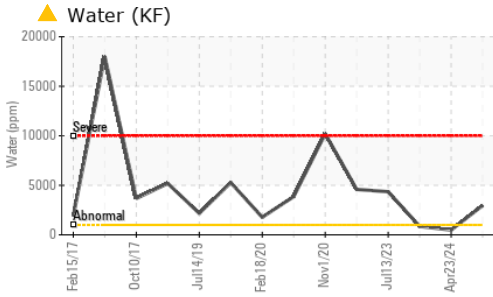






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	42.2	99.9	104.1

SAMPLE IMAGES

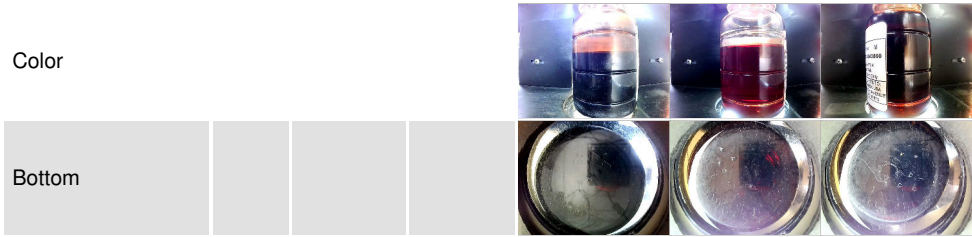

GRAPHS

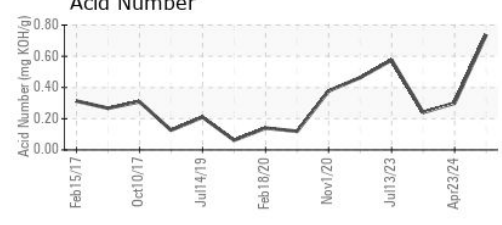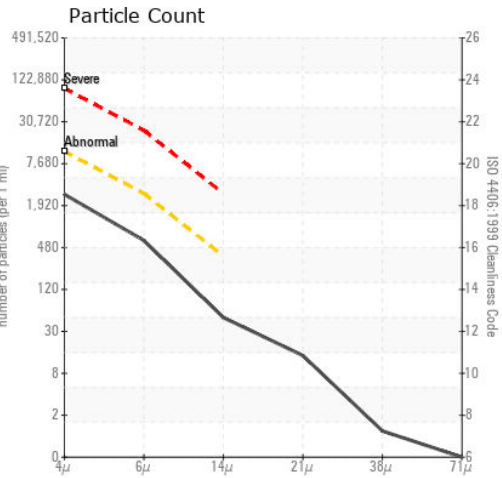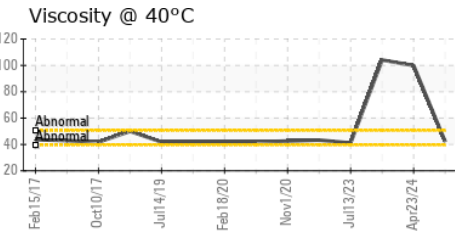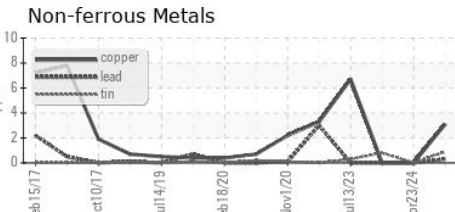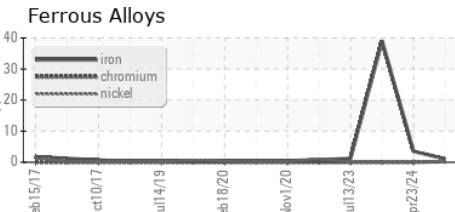

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM36156 **Received** : 15 May 2024
Lab Number : 06180173 **Tested** : 16 May 2024
Unique Number : 11031499 **Diagnosed** : 17 May 2024 - Doug Bogart
Test Package : IND 2

JBS - BEARDSTOWN
 8295 ARENZVILLE RD
 BEARDSTOWN, IL
 US 62618
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)