




OIL ANALYSIS REPORT

Sample Rating Trend

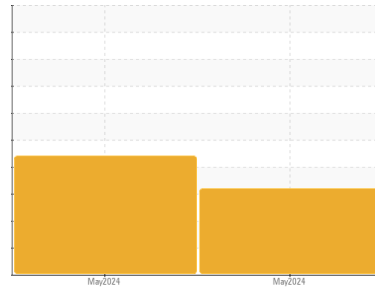

WATER



Area
SSK [AFTER FILTER]
 Machine Id
TK1 HOMO 1 WEST (S/N J3-20.122)
 Component
Refrigeration Compressor
 Fluid
LUBRIPLATE SFGO ULTRA 100 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

Wear

The iron level is abnormal.

Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. There is a trace of moisture present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USP0011865	USP0011867	---
Sample Date	Client Info	09 May 2024	08 May 2024	---
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	---
Sample Status		ABNORMAL	ABNORMAL	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >8	▲ 49	▲ 60	---
Chromium ppm	ASTM D5185m >2	<1	<1	---
Nickel ppm	ASTM D5185m	<1	<1	---
Titanium ppm	ASTM D5185m	<1	<1	---
Silver ppm	ASTM D5185m >2	<1	<1	---
Aluminum ppm	ASTM D5185m >3	2	2	---
Lead ppm	ASTM D5185m >2	1	2	---
Copper ppm	ASTM D5185m >8	2	2	---
Tin ppm	ASTM D5185m >4	2	2	---
Vanadium ppm	ASTM D5185m	<1	<1	---
Cadmium ppm	ASTM D5185m	<1	<1	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m	0	0	---
Barium ppm	ASTM D5185m	0	0	---
Molybdenum ppm	ASTM D5185m	<1	<1	---
Manganese ppm	ASTM D5185m	0	0	---
Magnesium ppm	ASTM D5185m	<1	<1	---
Calcium ppm	ASTM D5185m	<1	<1	---
Phosphorus ppm	ASTM D5185m	711	707	---
Zinc ppm	ASTM D5185m	0	0	---
Sulfur ppm	ASTM D5185m	1949	1968	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >15	2	2	---
Sodium ppm	ASTM D5185m	0	3	---
Potassium ppm	ASTM D5185m >20	1	2	---
Water %	ASTM D6304 >0.01	▲ 0.011	▲ 0.027	---
ppm Water	ASTM D6304 >100	▲ 112	▲ 272	---

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	● 12153	▲ 157387	---
Particles >6µm	ASTM D7647 >2500	1957	▲ 89577	---
Particles >14µm	ASTM D7647 >640	32	▲ 2467	---
Particles >21µm	ASTM D7647 >160	5	▲ 181	---
Particles >38µm	ASTM D7647 >40	0	1	---
Particles >71µm	ASTM D7647 >10	0	0	---
Oil Cleanliness	ISO 4406 (c) >20/18/16	● 21/18/12	▲ 24/24/18	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D974	0.19	0.20	---




OIL ANALYSIS REPORT

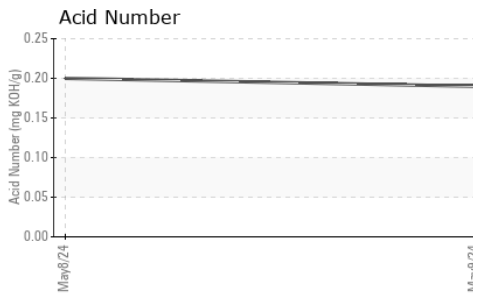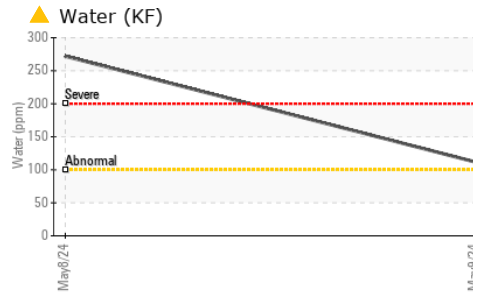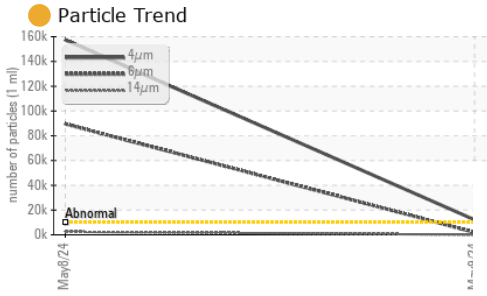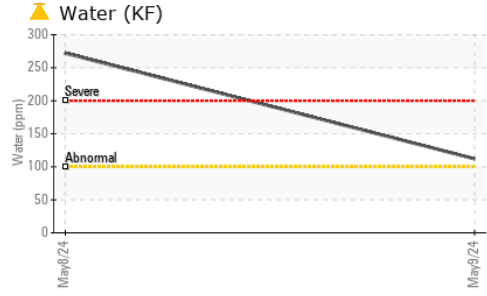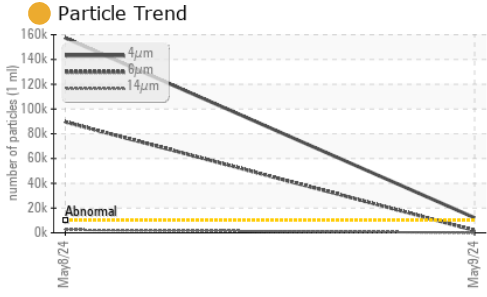





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 98	93.9	93.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

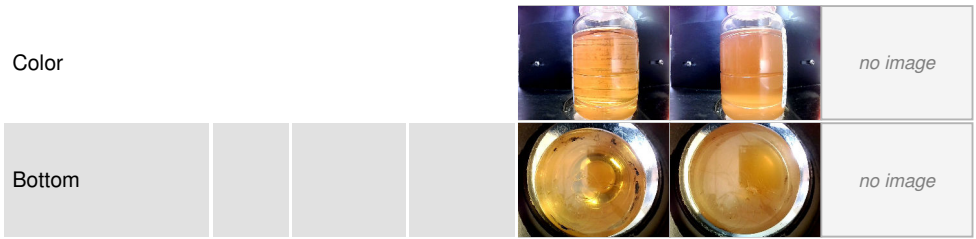

GRAPHS

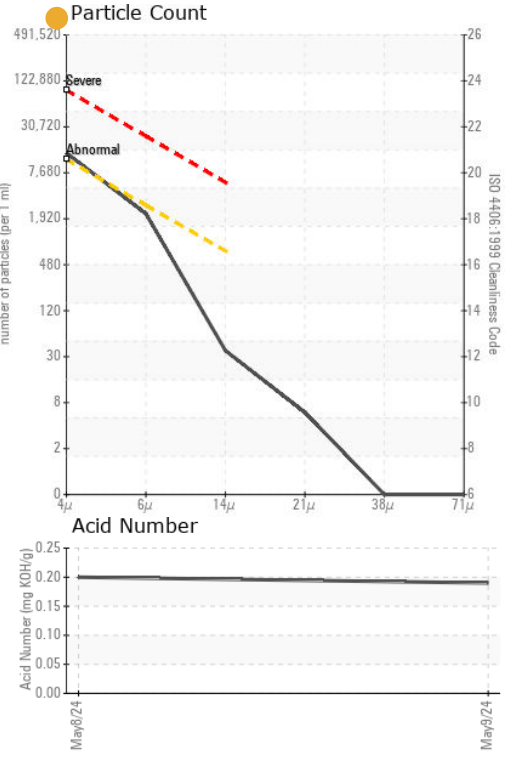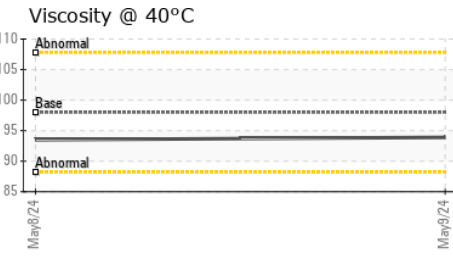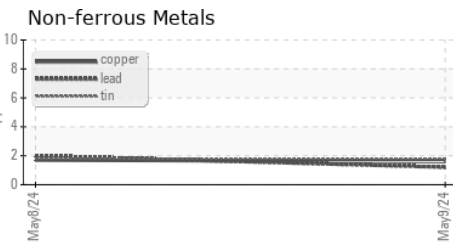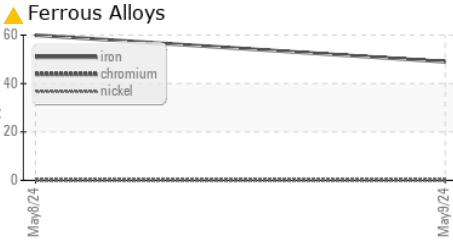

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0011865 **Received** : 15 May 2024
Lab Number : 06180176 **Tested** : 16 May 2024
Unique Number : 11031502 **Diagnosed** : 18 May 2024 - Jonathan Hester
Test Package : IND 2

KraftHeinz - Champaign - Plant 8318
 702 N MATTHIS AVE, DOOR 22 EAST STOREROOM
 CHAMPAIGN, IL
 US 61821
 Contact: Nathan Shankles
 Nathan.Shankles@kraftheinz.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)