


OIL ANALYSIS REPORT

SCHULZ/SYNTHETIC 46 12313 / 33254 - ALFRED MATTHEWS

Component Compressor



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06180244	UCH05982493	
Sample Date		Client Info		10 Apr 2024	20 Sep 2023	
Machine Age	hrs	Client Info		6271	0	
Oil Age	hrs	Client Info		1685	6902	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m		<1	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m		<1	0	
Aluminum	ppm	ASTM D5185m	>25	2	0	
Lead	ppm	ASTM D5185m	>25	<1	0	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>15	<1	0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		0	0	
Calcium	ppm	ASTM D5185m		1	0	
Phosphorus	ppm	ASTM D5185m		451	380	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		1590	1935	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	6	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	2	0	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.11	0.045	





OIL ANALYSIS REPORT

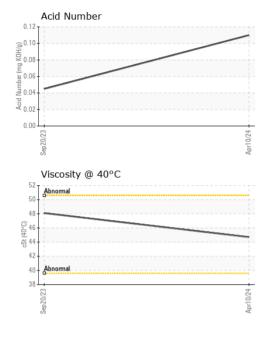













Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06180244

Unique Number : 11031570 Test Package : IND 2

: UCH06180244

Received : 15 May 2024 **Tested** : 16 May 2024 Diagnosed

: 17 May 2024 - Wes Davis

PRECISION FOR COLLISION INC

8845 WASHINGTON BLVD, SUITE 170 ROSEVILLE, CA US 95648

Contact: MAGGI ZINN mzinn@pfcequipment.com T: (916)677-2885

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)