




OIL ANALYSIS REPORT

Sample Rating Trend

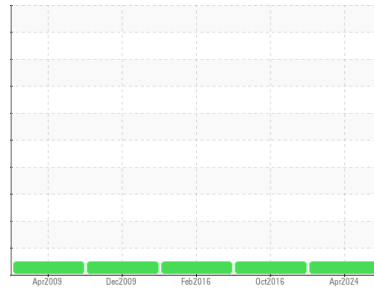

NORMAL



Area

5-40 [80412]

Machine Id

GARDNER DENVER S033328 - CENTURY TYWOOD CORP

Component

Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH06180277	UCH04111048	UCH03922023
Sample Date	Client Info		12 Apr 2024	26 Oct 2016	02 Feb 2016
Machine Age	hrs	Client Info	33756	29115	27459
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Not Changed	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	<1	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	0	<1	<1
Lead	ppm	ASTM D5185m >25	0	0	0
Copper	ppm	ASTM D5185m >50	<1	<1	<1
Tin	ppm	ASTM D5185m >15	0	0	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	<1	0
Barium	ppm	ASTM D5185m 1.2	4	1	4
Molybdenum	ppm	ASTM D5185m 0.1	0	1	0
Manganese	ppm	ASTM D5185m 1.3	<1	<1	<1
Magnesium	ppm	ASTM D5185m 0	1	0	<1
Calcium	ppm	ASTM D5185m 8.2	9	<1	2
Phosphorus	ppm	ASTM D5185m 447	887	1055	1051
Zinc	ppm	ASTM D5185m 0	27	15	12
Sulfur	ppm	ASTM D5185m 436	1350	659	548

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	3	2	3
Sodium	ppm	ASTM D5185m	7	3	4
Potassium	ppm	ASTM D5185m >20	<1	8	<1

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.431	0.20	0.153	0.080




OIL ANALYSIS REPORT

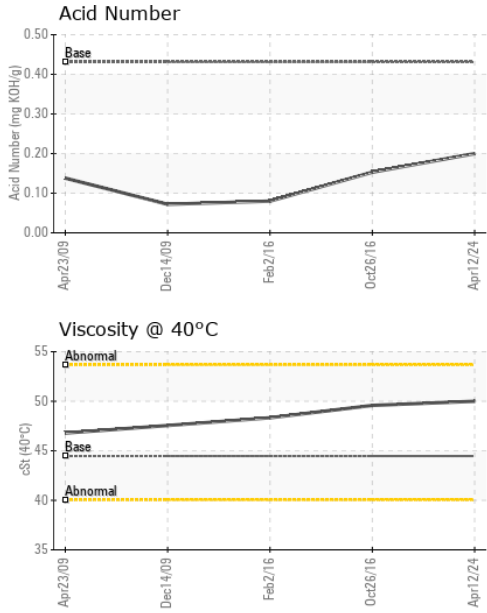





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	LIGHT	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.47	50.0	49.58	48.33

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

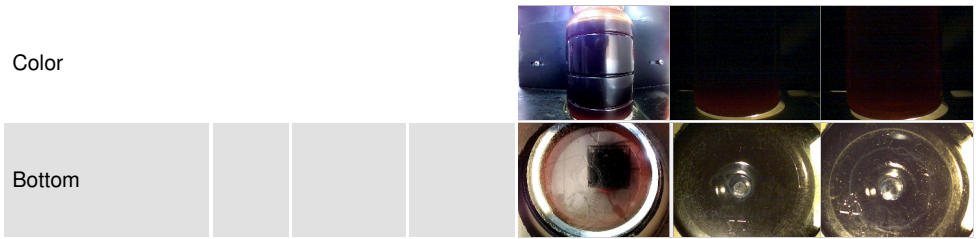

GRAPHS

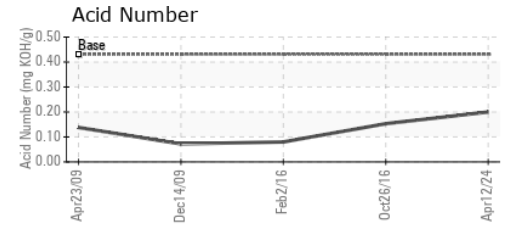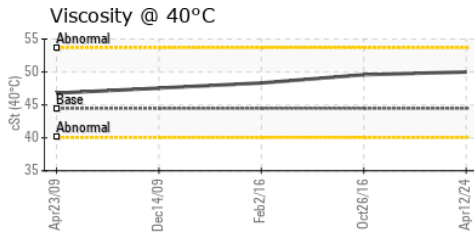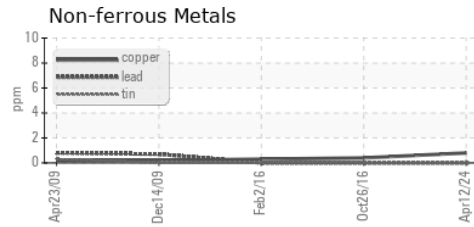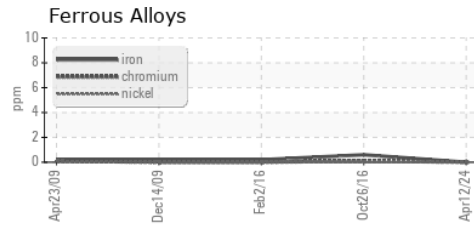

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06180277 **Received** : 15 May 2024
Lab Number : **06180277** **Tested** : 16 May 2024
Unique Number : 11031603 **Diagnosed** : 17 May 2024 - Wes Davis
Test Package : IND 2

CAL SUPPLY COMPANY
 259 MACKLIN ST
 CRANSTON, RI
 US 02920
 Contact: SUE PARRILLO
 sparrillo@calsupplycompany.com
 T: (401)946-1300
 F: (401)946-0055

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)