




OIL ANALYSIS REPORT

Sample Rating Trend

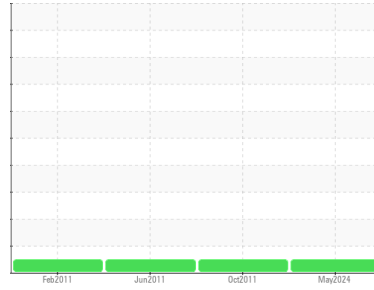

NORMAL



Machine Id
INGERSOLL RAND #3 AIR COMPRESSOR (S/N FF1195U97020)
 Component
Compressor
 Fluid
INGERSOLL-RAND SSR ULTRA COOLANT (15 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0941866	WCI2097874	WCI2098437
Sample Date	Client Info		11 May 2024	03 Oct 2011	18 Jun 2011
Machine Age	hrs	Client Info	20940	90969	88473
Oil Age	hrs	Client Info	60974	3000	4000
Oil Changed	Client Info		N/A	Not Changd	Not Changd
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	2	<1
Chromium	ppm	ASTM D5185m >5	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >15	0	0	<1
Lead	ppm	ASTM D5185m >65	0	1	<1
Copper	ppm	ASTM D5185m >65	1	2	3
Tin	ppm	ASTM D5185m >10	<1	0	0
Antimony	ppm	ASTM D5185m	---	4	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	1
Barium	ppm	ASTM D5185m 556	593	556	500
Molybdenum	ppm	ASTM D5185m	0	0	<1
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m	<1	0	1
Calcium	ppm	ASTM D5185m 242	4	5	5
Phosphorus	ppm	ASTM D5185m 0	23	4	4
Zinc	ppm	ASTM D5185m 0	24	8	9
Sulfur	ppm	ASTM D5185m 306	411	231	268

CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	0	2	4
Sodium	ppm	ASTM D5185m	61	33	26
Potassium	ppm	ASTM D5185m >20	7	0	4

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.2	0.98	1.22	0.713



OIL ANALYSIS REPORT

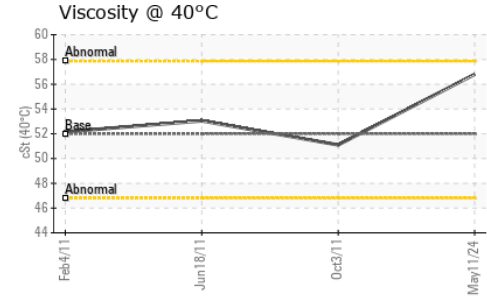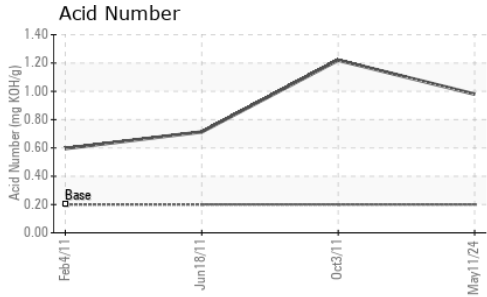





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	LIGHT	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 52	56.8	51.1	53.04

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

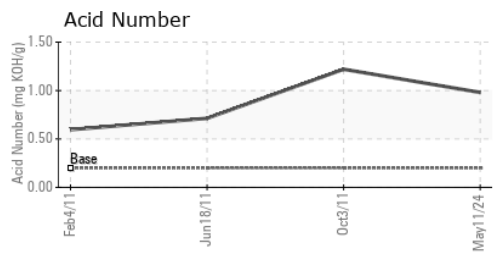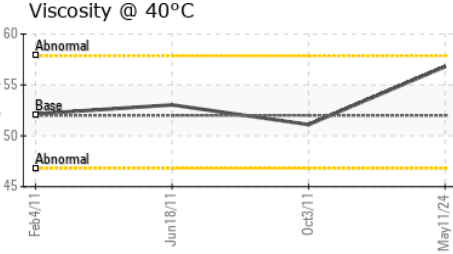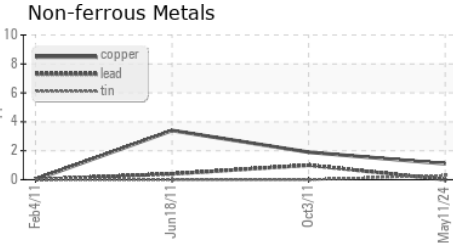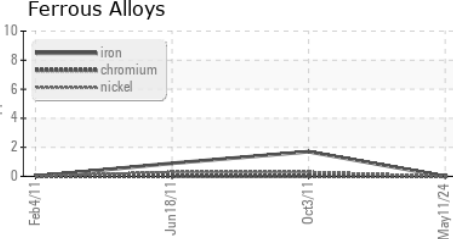

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0941866 **Received** : 15 May 2024
Lab Number : **06180297** **Tested** : 16 May 2024
Unique Number : 11031623 **Diagnosed** : 17 May 2024 - Sean Felton
Test Package : IND 2

ARMSTRONG SERVICE ASI
 100 HERO DR
 AMSTERDAM, NY
 US 12010
 Contact: JEFF TOLEDO
 jtoledo@armstronginternational.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)