



FUEL REPORT

Sample Rating Trend



ISO



Area

[MERCK]

Machine Id

GEN 3 BASE TANK - MERCK

Component

Diesel Fuel

Fluid

DIESEL FUEL No. 2 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you filter this fluid before use. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is a high amount of particulates present in the fuel. The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|-------------|----------|----------|
| Sample Number | Client Info | | | WC0929978 | --- | --- |
| Sample Date | Client Info | | | 10 May 2024 | --- | --- |
| Machine Age | hrs | Client Info | | 0 | --- | --- |
| Sample Status | | | | ABNORMAL | --- | --- |

| PHYSICAL PROPERTIES | | method | limit/base | current | history1 | history2 |
|----------------------------|--------|------------------|------------|---------|----------|----------|
| Fuel Color | text | *Visual Screen | | Red | --- | --- |
| ASTM Color | scalar | *ASTM D1500 | | L4.5 | --- | --- |
| Visc @ 40°C | cSt | ASTM D445 | 4.1 | 2.46 | --- | --- |
| Pensky-Martens Flash Point | °C | *PMCC Calculated | | 59.3 | --- | --- |

| SULFUR CONTENT | | method | limit/base | current | history1 | history2 |
|----------------|-----|-------------|------------|---------|----------|----------|
| Sulfur | ppm | ASTM D5185m | | 0 | --- | --- |
| Sulfur (UVF) | ppm | ASTM D5453 | | 13 | --- | --- |






| DISTILLATION | | method | limit/base | current | history1 | history2 |
|------------------------|----|----------|------------|---------|----------|----------|
| Initial Boiling Point | °C | ASTM D86 | | 170 | --- | --- |
| 5% Distillation Point | °C | ASTM D86 | | 192 | --- | --- |
| 10% Distill Point | °C | ASTM D86 | | 203 | --- | --- |
| 15% Distillation Point | °C | ASTM D86 | | 211 | --- | --- |
| 20% Distill Point | °C | ASTM D86 | | 219 | --- | --- |
| 30% Distill Point | °C | ASTM D86 | | 235 | --- | --- |
| 40% Distill Point | °C | ASTM D86 | | 249 | --- | --- |
| 50% Distill Point | °C | ASTM D86 | | 262 | --- | --- |
| 60% Distill Point | °C | ASTM D86 | | 276 | --- | --- |
| 70% Distill Point | °C | ASTM D86 | | 289 | --- | --- |
| 80% Distill Point | °C | ASTM D86 | | 303 | --- | --- |
| 85% Distillation Point | °C | ASTM D86 | | 313 | --- | --- |
| 90% Distill Point | °C | ASTM D86 | | 323 | --- | --- |
| 95% Distillation Point | °C | ASTM D86 | | 339 | --- | --- |
| Final Boiling Point | °C | ASTM D86 | | 353 | --- | --- |

| IGNITION QUALITY | | method | limit/base | current | history1 | history2 |
|------------------|--|------------|------------|---------|----------|----------|
| API Gravity | | ASTM D7777 | | 37 | --- | --- |
| Cetane Index | | ASTM D4737 | <40.0 | 49 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|---------|----------|----------|
| Silicon | ppm | ASTM D5185m | <1.0 | 0 | --- | --- |
| Sodium | ppm | ASTM D5185m | <0.1 | <1 | --- | --- |
| Potassium | ppm | ASTM D5185m | <0.1 | <1 | --- | --- |
| Water | % | ASTM D6304 | <0.05 | 0.004 | --- | --- |
| ppm Water | ppm | ASTM D6304 | <500 | 42 | --- | --- |
| % Gasoline | % | *In-House | <0.50 | 0.0 | --- | --- |
| % Biodiesel | % | *In-House | <20.0 | 0.0 | --- | --- |



FUEL REPORT

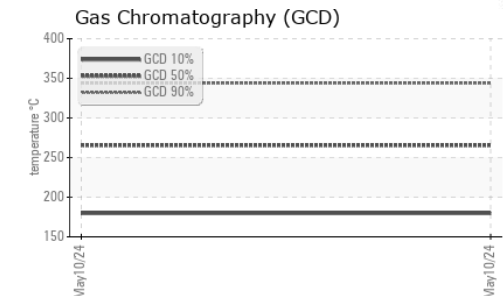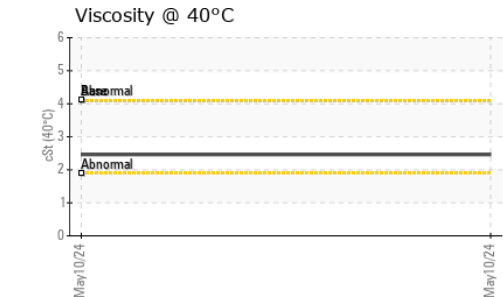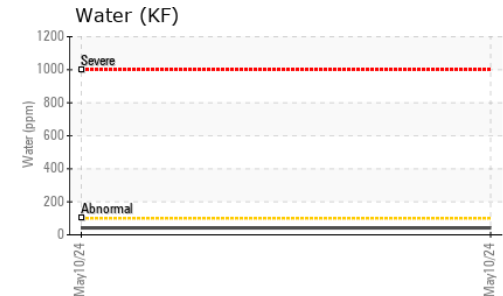
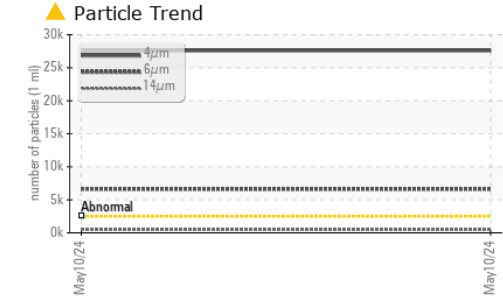
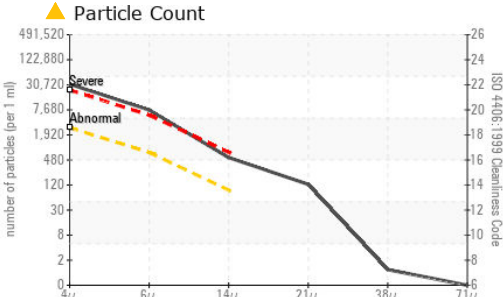


| FLUID CLEANLINESS | method | limit/base | current | history1 | history2 |
|-------------------|--------------|------------|------------|----------|----------|
| Particles >4µm | ASTM D7647 | >2500 | ▲ 27596 | --- | --- |
| Particles >6µm | ASTM D7647 | >640 | ▲ 6625 | --- | --- |
| Particles >14µm | ASTM D7647 | >80 | ▲ 482 | --- | --- |
| Particles >21µm | ASTM D7647 | >20 | ▲ 110 | --- | --- |
| Particles >38µm | ASTM D7647 | >4 | 1 | --- | --- |
| Particles >71µm | ASTM D7647 | >3 | 0 | --- | --- |
| Oil Cleanliness | ISO 4406 (c) | >18/16/13 | ▲ 22/20/16 | --- | --- |

| HEAVY METALS | method | limit/base | current | history1 | history2 |
|--------------|--------|-------------|---------|----------|----------|
| Aluminum | ppm | ASTM D5185m | <0.1 | 0 | --- |
| Nickel | ppm | ASTM D5185m | <0.1 | 0 | --- |
| Lead | ppm | ASTM D5185m | <0.1 | 0 | --- |
| Vanadium | ppm | ASTM D5185m | <0.1 | 0 | --- |
| Iron | ppm | ASTM D5185m | <0.1 | 0 | --- |
| Calcium | ppm | ASTM D5185m | <0.1 | 0 | --- |
| Magnesium | ppm | ASTM D5185m | <0.1 | 0 | --- |
| Phosphorus | ppm | ASTM D5185m | <0.1 | 0 | --- |
| Zinc | ppm | ASTM D5185m | <0.1 | 0 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color | | | | no image | no image |
| Bottom | | | | no image | no image |

GRAPHS

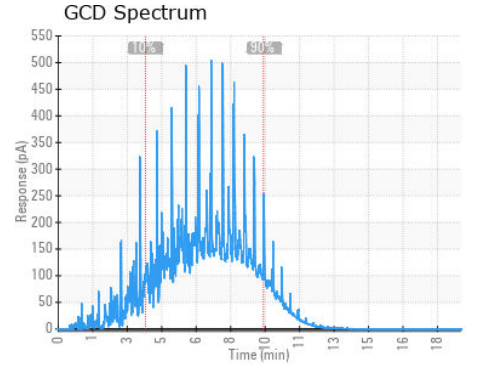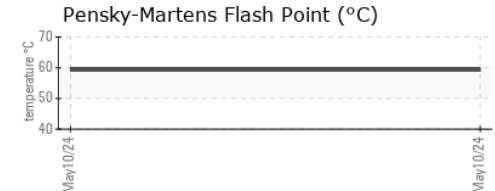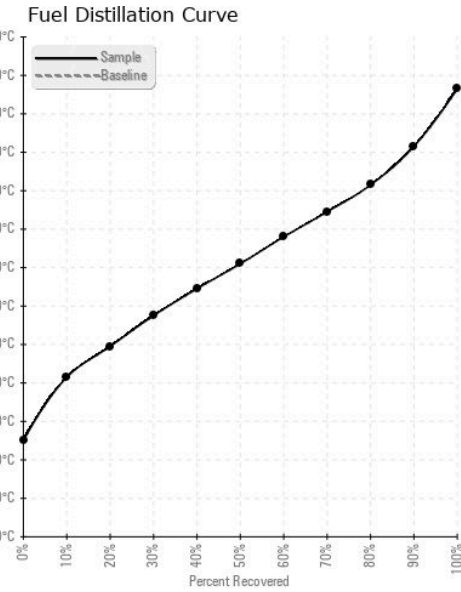

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0929978 **Received** : 15 May 2024
Lab Number : 06180600 **Tested** : 23 May 2024
Unique Number : 11031926 **Diagnosed** : 23 May 2024 - Doug Bogart
Test Package : DF-2 (Additional Tests: Fuel, Screen)

VITAL FUEL SYSTEMS
 1076 CLASSIC RD
 APEX, NC
 US 27539
 Contact: SERVICE
 service@vitalfuelsystems.com
 T: (919)629-8180
 F: (919)303-7399

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)