



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id

CASSIDA FLUID GL 460 A - HEB BAKERY

Component

New (Unused) Oil

Fluid

SHELL CASSIDA GL 460 (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. Please note that this is a corrected copy for laboratory data updates to add particle count data.

Contamination

There is a high amount of particulates present in the oil.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		WC06180609	---	---
Sample Date	Client Info		14 May 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method		NEG	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >5	49	---	---
Chromium	ppm	ASTM D5185m >5	0	---	---
Nickel	ppm	ASTM D5185m >5	<1	---	---
Titanium	ppm	ASTM D5185m	<1	---	---
Silver	ppm	ASTM D5185m >5	0	---	---
Aluminum	ppm	ASTM D5185m >5	<1	---	---
Lead	ppm	ASTM D5185m >5	0	---	---
Copper	ppm	ASTM D5185m >5	0	---	---
Tin	ppm	ASTM D5185m >5	<1	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	<1	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	3	---	---
Calcium	ppm	ASTM D5185m	3	---	---
Phosphorus	ppm	ASTM D5185m	464	---	---
Zinc	ppm	ASTM D5185m	<1	---	---
Sulfur	ppm	ASTM D5185m	673	---	---






CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	25	---	---
Sodium	ppm	ASTM D5185m	<1	---	---
Potassium	ppm	ASTM D5185m >20	1	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 196547	---	---
Particles >6µm	ASTM D7647	>1300	▲ 94910	---	---
Particles >14µm	ASTM D7647	>160	▲ 858	---	---
Particles >21µm	ASTM D7647	>40	39	---	---
Particles >38µm	ASTM D7647	>10	2	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 25/24/17	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	---	---



OIL ANALYSIS REPORT

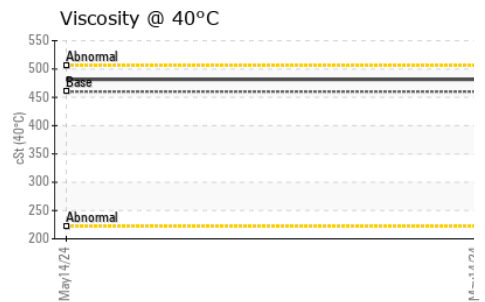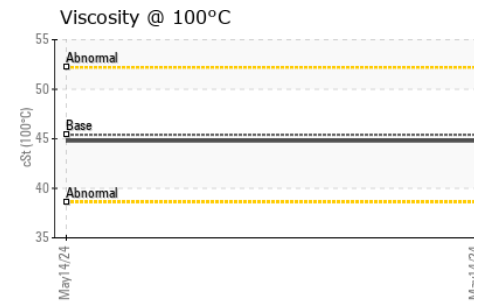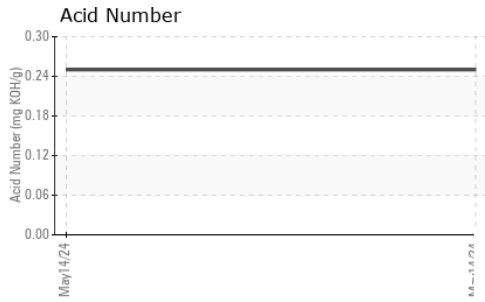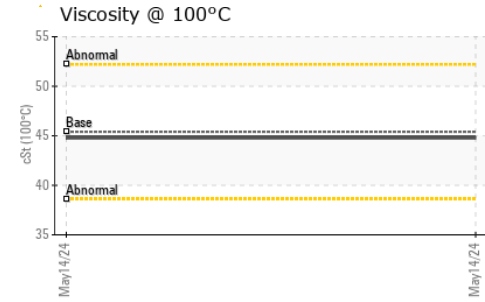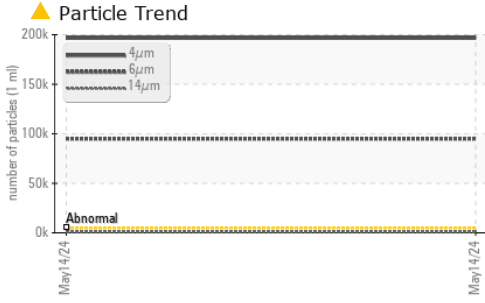





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	460	481.6	---
Visc @ 100°C	cSt	ASTM D445	45.4	44.79	---
Viscosity Index (VI)	Scale	ASTM D2270	154	146	---

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

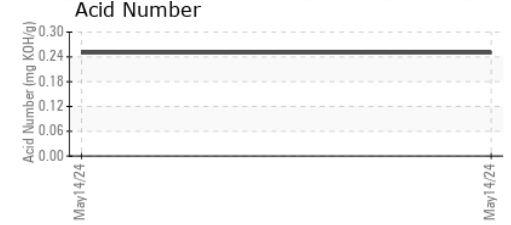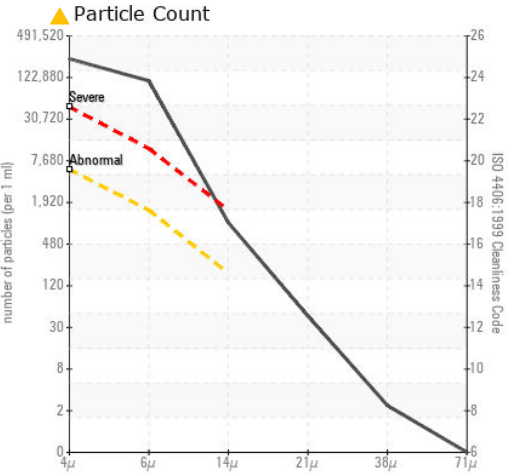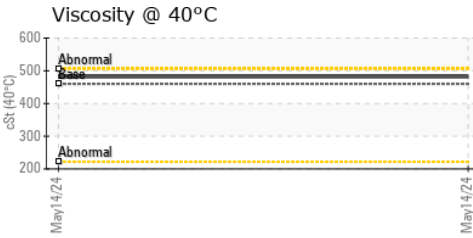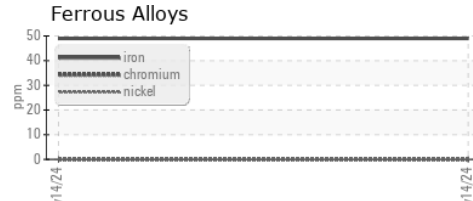

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06180609
Lab Number : 06180609
Unique Number : 11031935
Test Package : IND 2 (Additional Tests: FT-IR, ICP-NewOil, KV100, PrtCount, VI)

MOTION INDUSTRIES - TX59
 4810 N SAM HOUSTON PKWY W
 HOUSTON, TX
 US 77086
 Contact: RAY MOTT
 ray.mott@motion.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (713)683-7029