




# OIL ANALYSIS REPORT

## Sample Rating Trend

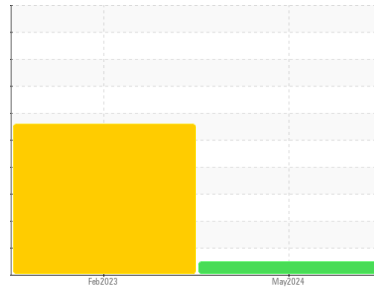

**NORMAL**



Machine Id  
**KAESER 2455569 (S/N 1109)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

### DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC129810</b>	KC105608	---
Sample Date	Client Info			<b>01 May 2024</b>	14 Feb 2023	---
Machine Age	hrs	Client Info		<b>274</b>	170	---
Oil Age	hrs	Client Info		<b>274</b>	38	---
Oil Changed	Client Info			<b>Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	<1	---
Lead	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>1</b>	<1	---
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>43</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	1	---
Magnesium	ppm	ASTM D5185m	90	<b>52</b>	5	---
Calcium	ppm	ASTM D5185m	2	<b>2</b>	0	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	29	---
Zinc	ppm	ASTM D5185m		<b>13</b>	38	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	4	---
Sodium	ppm	ASTM D5185m		<b>8</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>7</b>	<1	---
Water	%	ASTM D6304	>0.05	<b>0.020</b>	▲ 0.223	---
ppm Water	ppm	ASTM D6304	>500	<b>206</b>	▲ 2230	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>4375</b>	2288	---
Particles >6µm		ASTM D7647	>1300	<b>1169</b>	1246	---
Particles >14µm		ASTM D7647	>80	<b>36</b>	▲ 212	---
Particles >21µm		ASTM D7647	>20	<b>15</b>	▲ 71	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	▲ 11	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	1	---
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>17/12</b>	▲ 17/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.27</b>	0.16	---


# OIL ANALYSIS REPORT

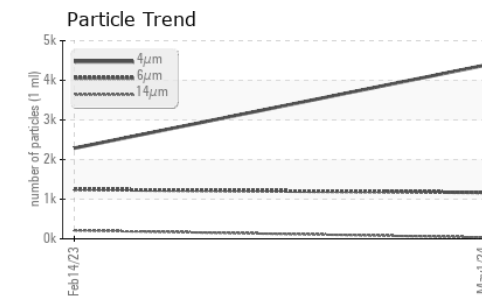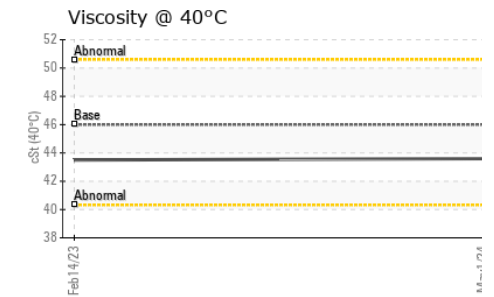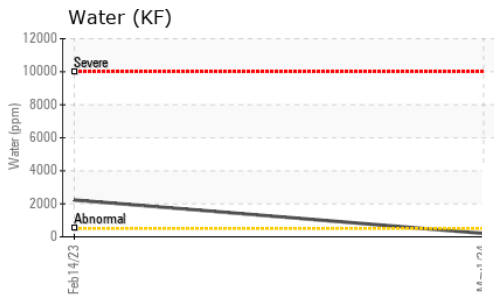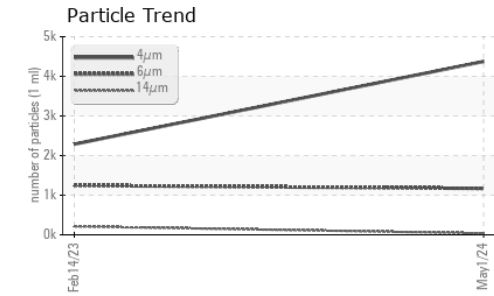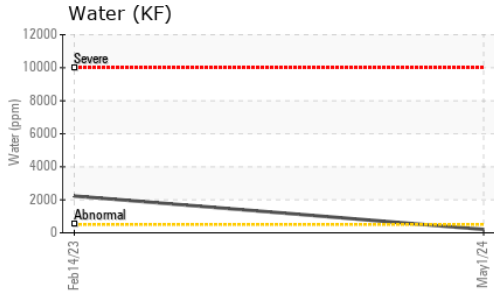






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	HAZY
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.6	43.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

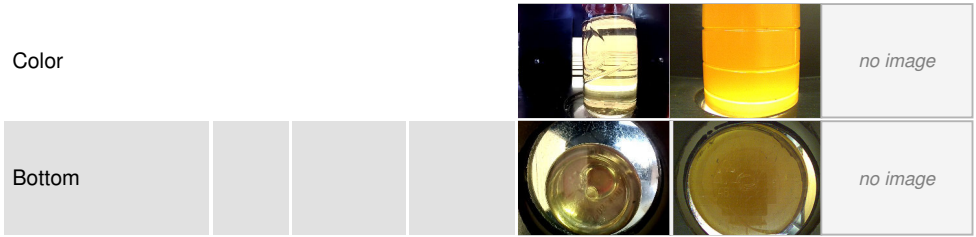

## GRAPHS

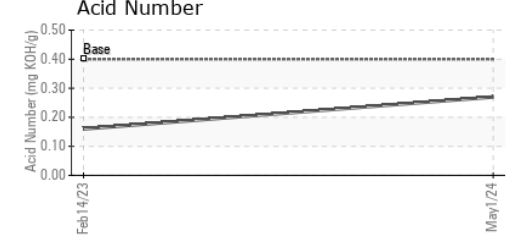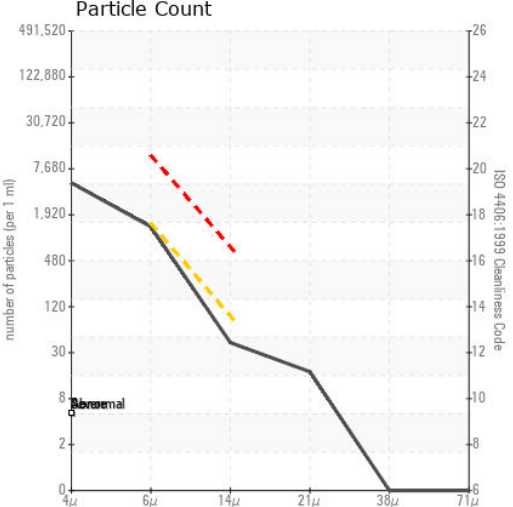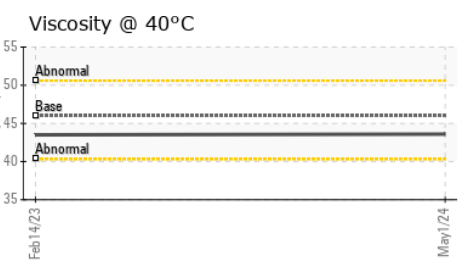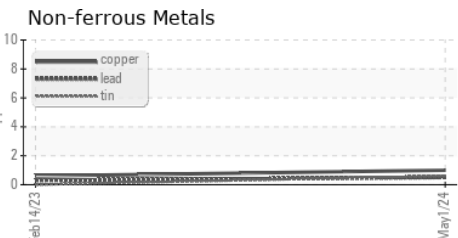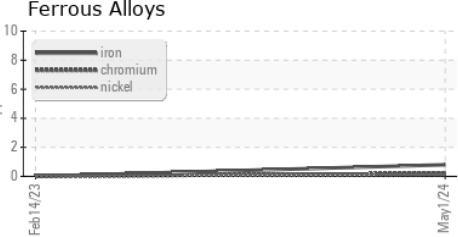

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC129810  
**Lab Number** : 06180696  
**Unique Number** : 11032022  
**Test Package** : IND 2

**Received** : 15 May 2024  
**Tested** : 18 May 2024  
**Diagnosed** : 18 May 2024 - Jonathan Hester

**AEP LUMA**  
 3260 N COLE ST  
 LIMA, OH  
 US 45801  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)