




# OIL ANALYSIS REPORT

Sample Rating Trend

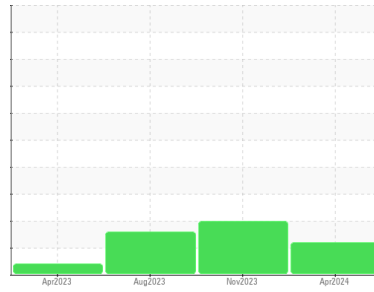

ISO



Machine Id  
**KAESER SX 7.5 8565111 (S/N 12054)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC130170</b>	KC124847	KC06005708
Sample Date	Client Info			<b>02 Apr 2024</b>	07 Nov 2023	23 Aug 2023
Machine Age	hrs	Client Info		<b>9428</b>	6041	5373
Oil Age	hrs	Client Info		<b>4000</b>	3544	0
Oil Changed	Client Info			<b>Changed</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	<1
Nickel	ppm	ASTM D5185m	>3	<1	0	<1
Titanium	ppm	ASTM D5185m	>3	<1	0	<1
Silver	ppm	ASTM D5185m	>2	<1	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	0	2
Lead	ppm	ASTM D5185m	>10	<1	0	<1
Copper	ppm	ASTM D5185m	>50	<b>8</b>	3	7
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	<1






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	21	5
Molybdenum	ppm	ASTM D5185m		<1	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>5</b>	26	16
Calcium	ppm	ASTM D5185m		<1	0	<1
Phosphorus	ppm	ASTM D5185m	500	<b>0</b>	0	4
Zinc	ppm	ASTM D5185m		<b>0</b>	2	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>3</b>	6	3
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	4
Water	%	ASTM D6304	>0.05	<b>0.008</b>	0.009	▲ 0.152
ppm Water	ppm	ASTM D6304	>500	<b>81</b>	96.8	▲ 1520

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5205</b>	45323	2323
Particles >6µm		ASTM D7647	>1300	● <b>1919</b>	▲ 24414	175
Particles >14µm		ASTM D7647	>80	● <b>108</b>	▲ 3546	17
Particles >21µm		ASTM D7647	>20	<b>16</b>	▲ 848	5
Particles >38µm		ASTM D7647	>4	<b>0</b>	▲ 20	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	2	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	● <b>20/18/14</b>	▲ 23/22/19	18/15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	<b>0.29</b>	0.30	0.28

# OIL ANALYSIS REPORT

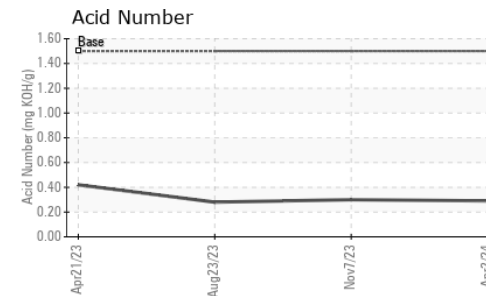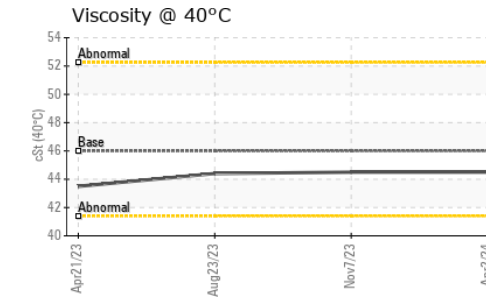
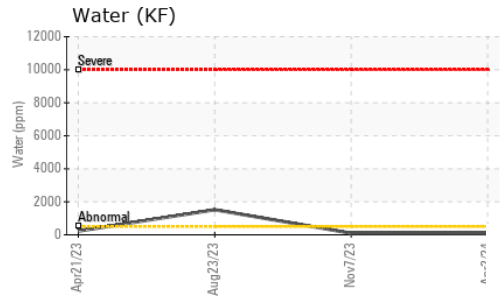
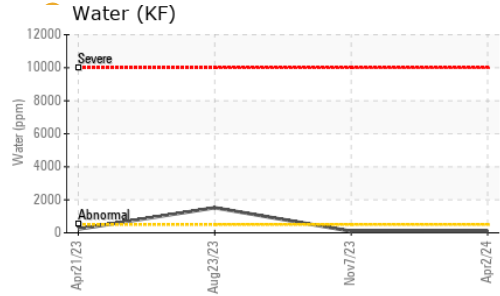
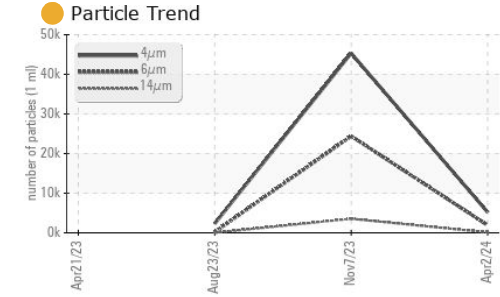


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.5	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

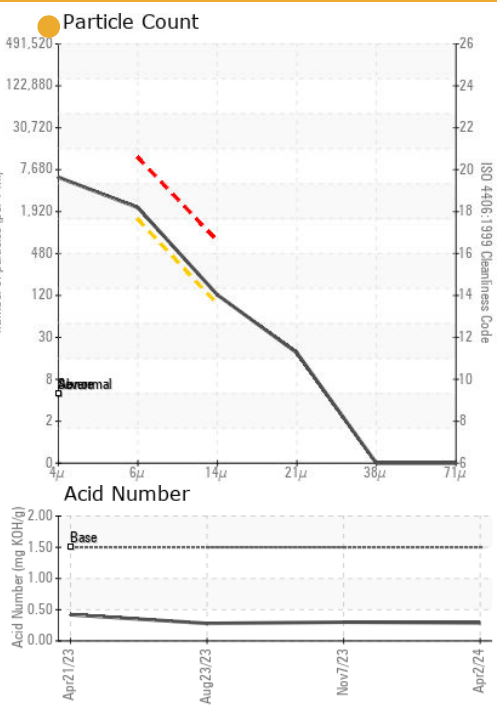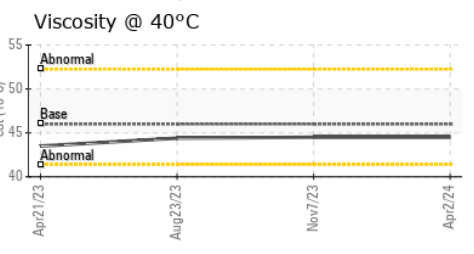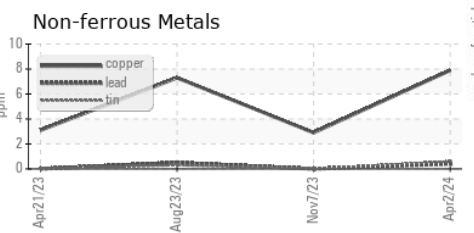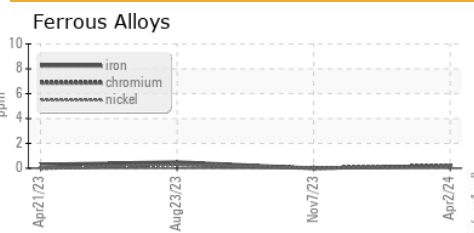

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC130170  
**Lab Number** : 06180698  
**Unique Number** : 11032024  
**Test Package** : IND 2  
**Received** : 15 May 2024  
**Tested** : 18 May 2024  
**Diagnosed** : 18 May 2024 - Jonathan Hester

**EVERGREEN PLASTICS**  
 202 WATER TOWER DR  
 CLYDE, OH  
 US 43410  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)