



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**DOOSAN LCV6WKUB 492006UCADG78**  
 Component  
**Diesel Engine**  
 Fluid  
 **DIESEL ENGINE OIL SAE 40 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |                 | method | limit/base | current            | history1 | history2 |
|--------------------|-----------------|--------|------------|--------------------|----------|----------|
| Sample Number      | Client Info     |        |            | <b>ML0001112</b>   | ---      | ---      |
| Sample Date        | Client Info     |        |            | <b>09 May 2024</b> | ---      | ---      |
| Machine Age        | hrs Client Info |        |            | <b>3398</b>        | ---      | ---      |
| Oil Age            | hrs Client Info |        |            | <b>0</b>           | ---      | ---      |
| Oil Changed        | Client Info     |        |            | <b>Changed</b>     | ---      | ---      |
| Sample Status      |                 |        |            | <b>NORMAL</b>      | ---      | ---      |

| CONTAMINATION |           | method | limit/base | current        | history1 | history2 |
|---------------|-----------|--------|------------|----------------|----------|----------|
| Fuel          | WC Method | >3.0   |            | <b>&lt;1.0</b> | ---      | ---      |
| Water         | WC Method | >0.1   |            | <b>NEG</b>     | ---      | ---      |
| Glycol        | WC Method |        |            | <b>NEG</b>     | ---      | ---      |

| WEAR METALS |                 | method | limit/base | current      | history1 | history2 |
|-------------|-----------------|--------|------------|--------------|----------|----------|
| Iron        | ppm ASTM D5185m | >50    |            | <b>6</b>     | ---      | ---      |
| Chromium    | ppm ASTM D5185m | >20    |            | <b>0</b>     | ---      | ---      |
| Nickel      | ppm ASTM D5185m | >5     |            | <b>0</b>     | ---      | ---      |
| Titanium    | ppm ASTM D5185m |        |            | <b>0</b>     | ---      | ---      |
| Silver      | ppm ASTM D5185m | >3     |            | <b>&lt;1</b> | ---      | ---      |
| Aluminum    | ppm ASTM D5185m | >20    |            | <b>1</b>     | ---      | ---      |
| Lead        | ppm ASTM D5185m | >40    |            | <b>0</b>     | ---      | ---      |
| Copper      | ppm ASTM D5185m | >30    |            | <b>2</b>     | ---      | ---      |
| Tin         | ppm ASTM D5185m | >15    |            | <b>0</b>     | ---      | ---      |
| Vanadium    | ppm ASTM D5185m |        |            | <b>&lt;1</b> | ---      | ---      |
| Cadmium     | ppm ASTM D5185m |        |            | <b>0</b>     | ---      | ---      |




| ADDITIVES  |                 | method | limit/base | current     | history1 | history2 |
|------------|-----------------|--------|------------|-------------|----------|----------|
| Boron      | ppm ASTM D5185m | 250    |            | <b>4</b>    | ---      | ---      |
| Barium     | ppm ASTM D5185m | 10     |            | <b>0</b>    | ---      | ---      |
| Molybdenum | ppm ASTM D5185m | 100    |            | <b>51</b>   | ---      | ---      |
| Manganese  | ppm ASTM D5185m |        |            | <b>0</b>    | ---      | ---      |
| Magnesium  | ppm ASTM D5185m | 450    |            | <b>815</b>  | ---      | ---      |
| Calcium    | ppm ASTM D5185m | 3000   |            | <b>1280</b> | ---      | ---      |
| Phosphorus | ppm ASTM D5185m | 1150   |            | <b>988</b>  | ---      | ---      |
| Zinc       | ppm ASTM D5185m | 1350   |            | <b>1230</b> | ---      | ---      |
| Sulfur     | ppm ASTM D5185m | 4250   |            | <b>3685</b> | ---      | ---      |

| CONTAMINANTS |                 | method | limit/base | current  | history1 | history2 |
|--------------|-----------------|--------|------------|----------|----------|----------|
| Silicon      | ppm ASTM D5185m | >15    |            | <b>5</b> | ---      | ---      |
| Sodium       | ppm ASTM D5185m | >216   |            | <b>2</b> | ---      | ---      |
| Potassium    | ppm ASTM D5185m | >20    |            | <b>1</b> | ---      | ---      |

| INFRA-RED |                      | method | limit/base | current     | history1 | history2 |
|-----------|----------------------|--------|------------|-------------|----------|----------|
| Soot %    | % *ASTM D7844        | >3     |            | <b>0.1</b>  | ---      | ---      |
| Nitration | Abs/cm *ASTM D7624   | >20    |            | <b>5.7</b>  | ---      | ---      |
| Sulfation | Abs/.1mm *ASTM D7415 | >30    |            | <b>17.4</b> | ---      | ---      |

| FLUID DEGRADATION |                      | method | limit/base | current     | history1 | history2 |
|-------------------|----------------------|--------|------------|-------------|----------|----------|
| Oxidation         | Abs/.1mm *ASTM D7414 | >25    |            | <b>13.1</b> | ---      | ---      |
| Base Number (BN)  | mg KOH/g ASTM D2896  | 8.5    |            | <b>9.2</b>  | ---      | ---      |





# OIL ANALYSIS REPORT

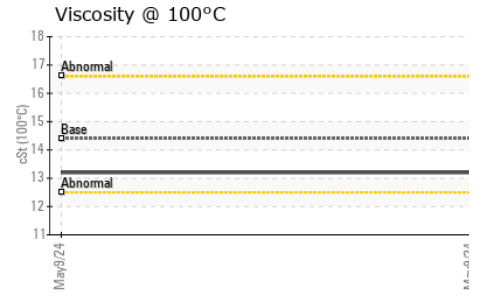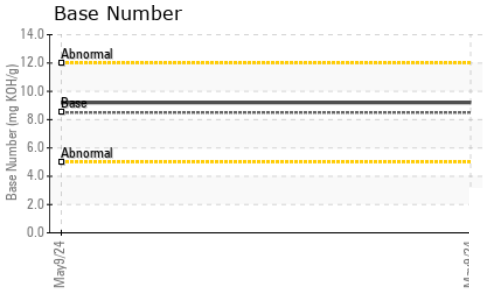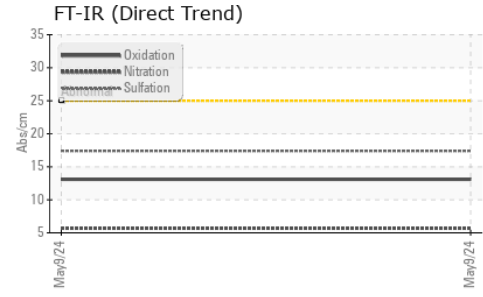

| VISUAL           | method | limit/base | current | history1 | history2 |     |
|------------------|--------|------------|---------|----------|----------|-----|
| White Metal      | scalar | *Visual    | NONE    | NONE     | ---      | --- |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | ---      | --- |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | ---      | --- |
| Silt             | scalar | *Visual    | NONE    | NONE     | ---      | --- |
| Debris           | scalar | *Visual    | NONE    | NONE     | ---      | --- |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | ---      | --- |
| Appearance       | scalar | *Visual    | NORML   | NORML    | ---      | --- |
| Odor             | scalar | *Visual    | NORML   | NORML    | ---      | --- |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | ---      | --- |
| Free Water       | scalar | *Visual    |         | NEG      | ---      | --- |

| FLUID PROPERTIES | method | limit/base | current | history1    | history2 |     |
|------------------|--------|------------|---------|-------------|----------|-----|
| Visc @ 100°C     | cSt    | ASTM D445  | 14.4    | <b>13.2</b> | ---      | --- |

## GRAPHS

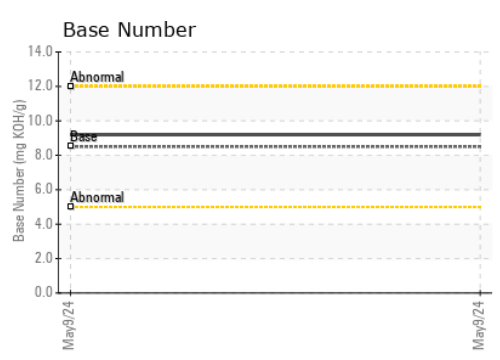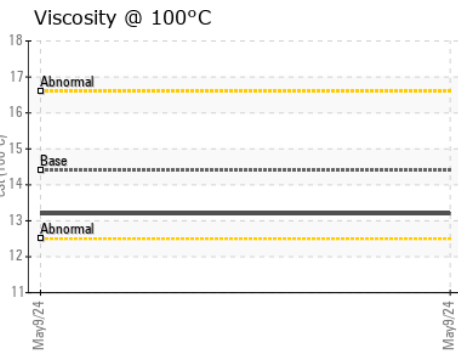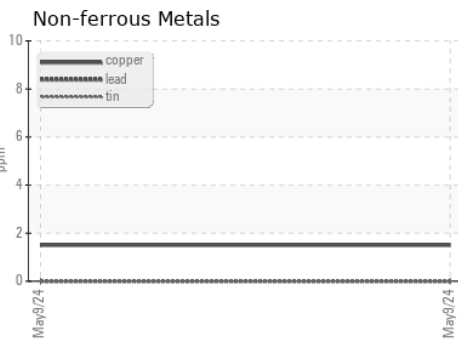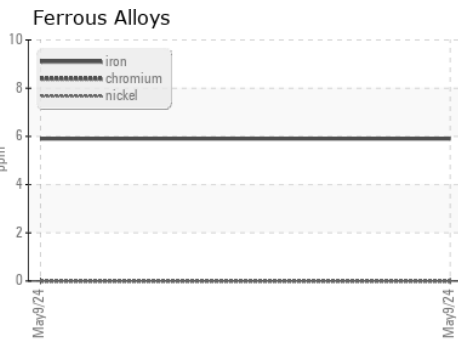

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : ML0001112      **Received** : 16 May 2024  
**Lab Number** : **06180990**      **Tested** : 16 May 2024  
**Unique Number** : 11032316      **Diagnosed** : 20 May 2024 - Jonathan Hester  
**Test Package** : CONST ( Additional Tests: TBN )

**McCLUNG-LOGAN EQUIPMENT CO - BRIDGEVILLE**  
 17941 SUSSEX HIGHWAY  
 BRIDGEVILLE, DE  
 US 19933  
 Contact: MATT CLARK  
 MCLARK@mcclung-logan.com  
 T: (302)337-3400  
 F: (302)337-9083

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)