




# OIL ANALYSIS REPORT

Sample Rating Trend

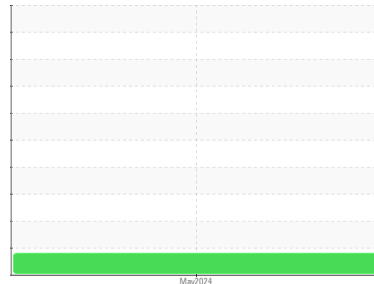

ISO



Machine Id

## NEW IR 2 (S/N MOX100I-A125)

Component

### Air Compressor

Fluid

### COMPRESSOR OIL (PAG) ISO 46 (--- GAL)

#### DIAGNOSIS

##### Recommendation

Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### Contamination

There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USP0011800</b>	---	---
Sample Date	Client Info			<b>15 May 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ATTENTION</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>40	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	525	<b>881</b>	---	---
Molybdenum	ppm	ASTM D5185m	10	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	5	<b>1</b>	---	---
Calcium	ppm	ASTM D5185m	10	<b>3</b>	---	---
Phosphorus	ppm	ASTM D5185m	250	<b>2</b>	---	---
Zinc	ppm	ASTM D5185m	100	<b>8</b>	---	---
Sulfur	ppm	ASTM D5185m	400	<b>527</b>	---	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>19</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	---	---
Water	%	ASTM D6304	>0.8	<b>0.300</b>	---	---
ppm Water	ppm	ASTM D6304	>8000	<b>3009</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>10083</b>	---	---
Particles >6µm		ASTM D7647	>2500	<b>889</b>	---	---
Particles >14µm		ASTM D7647	>320	<b>27</b>	---	---
Particles >21µm		ASTM D7647	>80	<b>7</b>	---	---
Particles >38µm		ASTM D7647	>20	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>21/17/12</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.08</b>	---	---




# OIL ANALYSIS REPORT

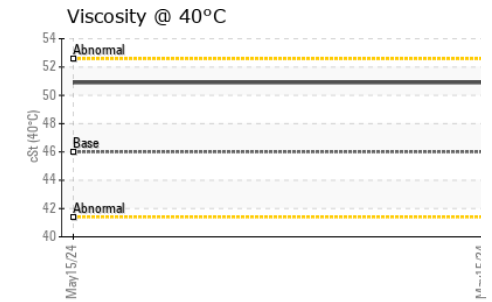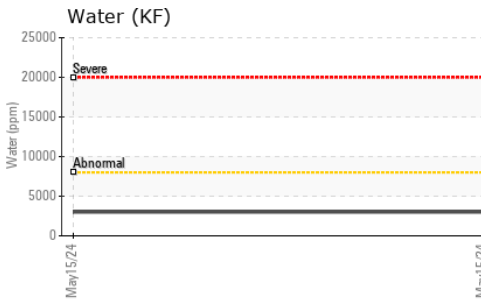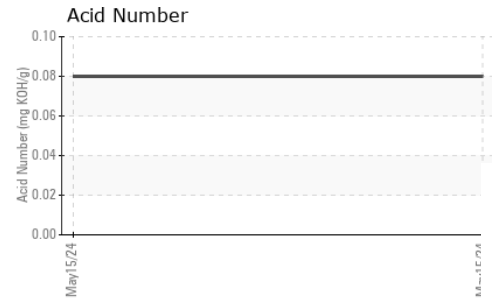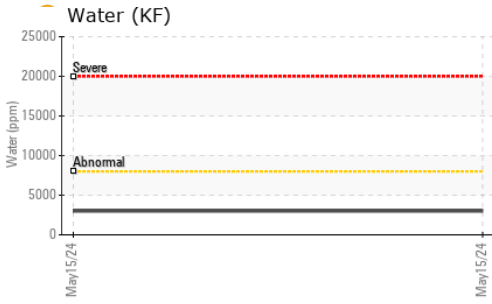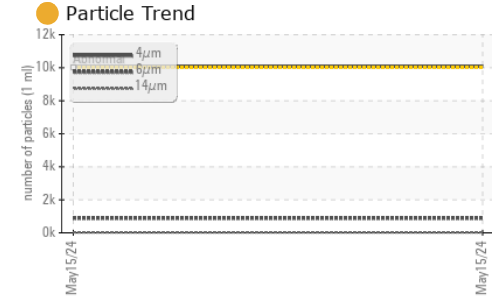



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.8	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	50.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

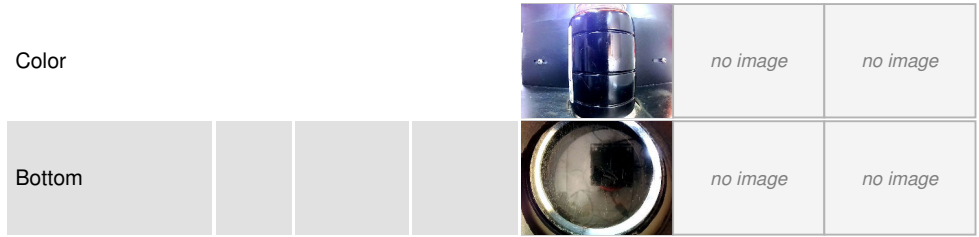

## GRAPHS

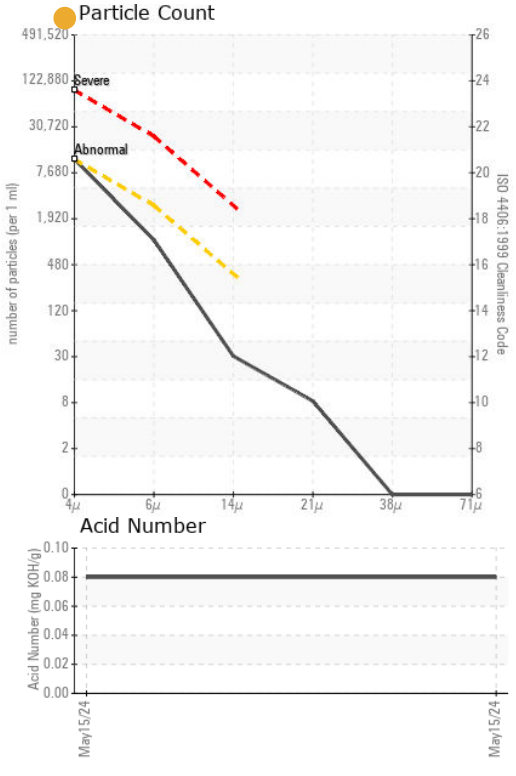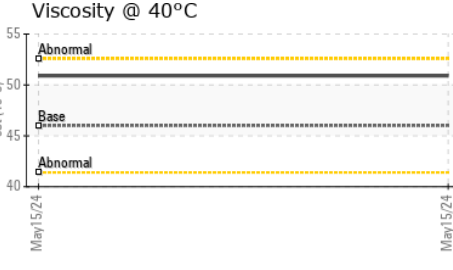

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0011800  
**Lab Number** : 06181349  
**Unique Number** : 11032675  
**Test Package** : IND 2  
**Received** : 16 May 2024  
**Tested** : 17 May 2024  
**Diagnosed** : 20 May 2024 - Jonathan Hester

**PINE RIDGE FARMS - SMITHFIELD - SMIDES**  
 1800 SE MAURY ST  
 DES MOINES, IA  
 US 50317  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: