




# OIL ANALYSIS REPORT

## Sample Rating Trend

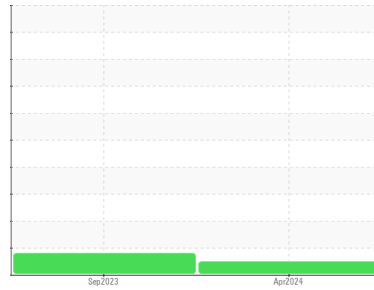

**NORMAL**



Machine Id  
**ASEPIC HOMO**  
 Component  
**Gearbox**  
 Fluid  
**GEAR OIL ISO 150 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>USP0011858</b>	USP244699	---
Sample Date	Client Info			<b>26 Apr 2024</b>	17 Sep 2023	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	ATTENTION	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>2</b>	4	---
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>100	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>200	<b>6</b>	<1	---
Tin	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	<b>3</b>	13	---
Barium	ppm	ASTM D5185m	15	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	15	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	50	<b>0</b>	2	---
Calcium	ppm	ASTM D5185m	50	<b>8</b>	11	---
Phosphorus	ppm	ASTM D5185m	350	<b>251</b>	160	---
Zinc	ppm	ASTM D5185m	100	<b>107</b>	107	---
Sulfur	ppm	ASTM D5185m	12500	<b>5054</b>	6080	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>1</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Water	%	ASTM D6304	>0.2	<b>0.002</b>	0.001	---
ppm Water	ppm	ASTM D6304	>2000	<b>24</b>	5.4	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	<b>1348</b>	● 26389	---
Particles >6µm		ASTM D7647	>5000	<b>62</b>	278	---
Particles >14µm		ASTM D7647	>640	<b>5</b>	6	---
Particles >21µm		ASTM D7647	>160	<b>2</b>	2	---
Particles >38µm		ASTM D7647	>40	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>10	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	<b>18/13/10</b>	● 22/15/10	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	<b>0.37</b>	0.46	---




# OIL ANALYSIS REPORT

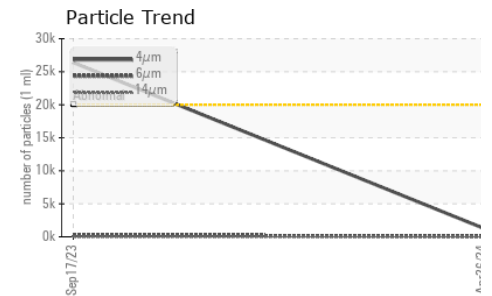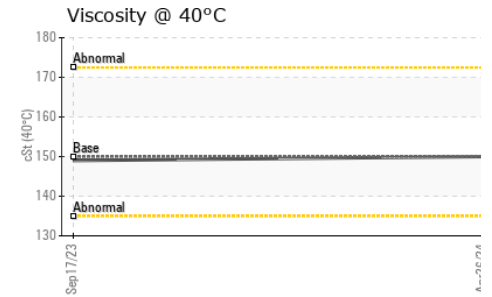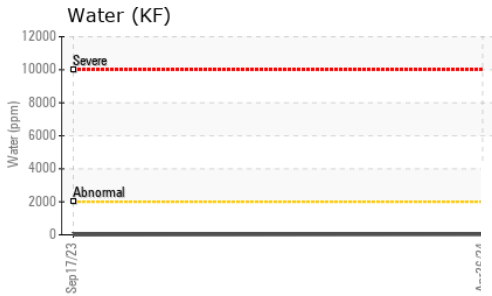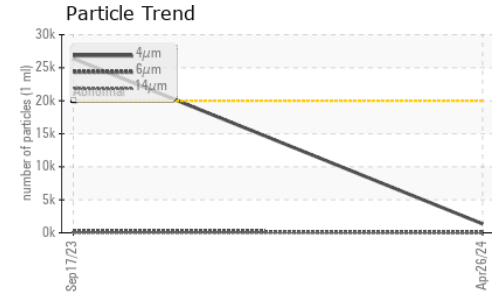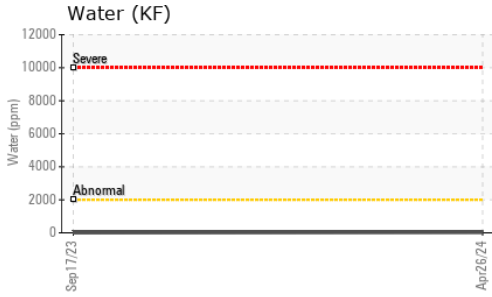







VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	150	149	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

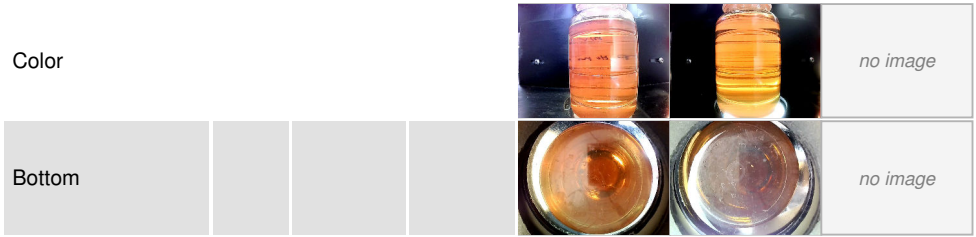

## GRAPHS

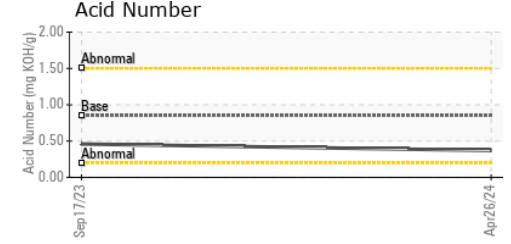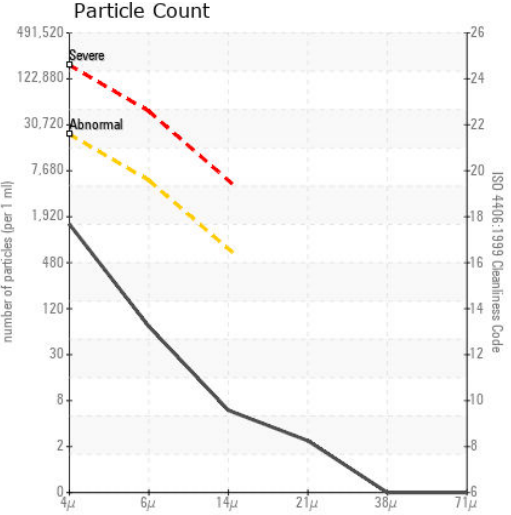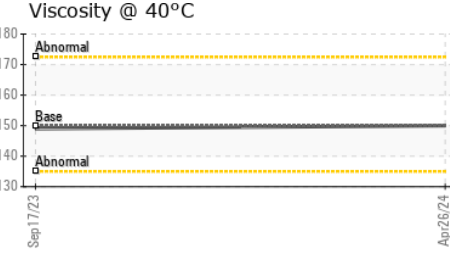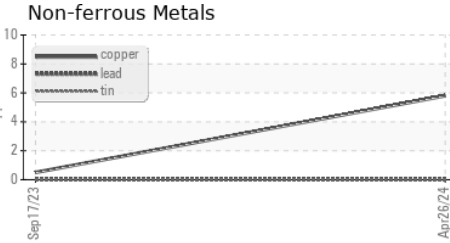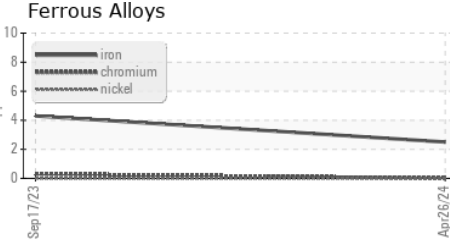

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0011858  
**Lab Number** : 06181359  
**Unique Number** : 11032685  
**Test Package** : IND 2

**Received** : 16 May 2024  
**Tested** : 17 May 2024  
**Diagnosed** : 20 May 2024 - Jonathan Hester

**KROGER/KING SOOPERS MEAT PLANT**  
 65 YUMA ST  
 DENVER, CO  
 US 80223

Contact: DEREK HENKOWSKI  
 derek.henkowski@kingsoopers.com

T: (303)778-3029

F: (303)698-3479

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)