




# OIL ANALYSIS REPORT

Sample Rating Trend

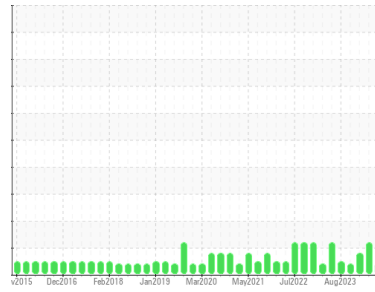

VIS DEBRIS



Area  
**ENGINE ROOM 2**

Machine Id  
**ER2 SC101 (S/N TDSH193L3287D)**

Component  
**Refrigeration Compressor**

Fluid  
**USPI 1009-68 SC (40 GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. NOT RUNNING

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0011814</b>	USP0006161	USP0006867
Sample Date	Client Info		<b>14 May 2024</b>	19 Mar 2024	15 Feb 2024
Machine Age	hrs	Client Info	<b>2110</b>	2110	2108
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	1	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 50	<b>0</b>	0	15

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Water	%	ASTM D6304 >0.01	<b>0.003</b>	0.002	0.003
ppm Water	ppm	ASTM D6304 >100	<b>37</b>	20	33

## FLUID CLEANLINESS




	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	---	▲ 31319	---
Particles >6µm	ASTM D7647	>2500	---	▲ 6436	---
Particles >14µm	ASTM D7647	>320	---	181	---
Particles >21µm	ASTM D7647	>80	---	28	---
Particles >38µm	ASTM D7647	>20	---	0	---
Particles >71µm	ASTM D7647	>4	---	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	---	▲ 22/20/15	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	<b>0.014</b>	0.014	0.014




# OIL ANALYSIS REPORT

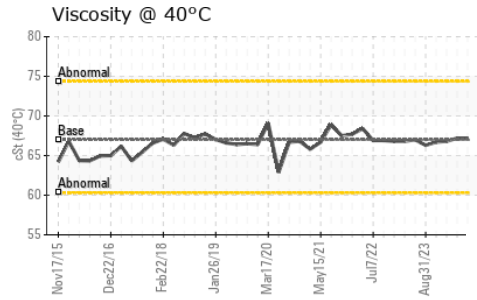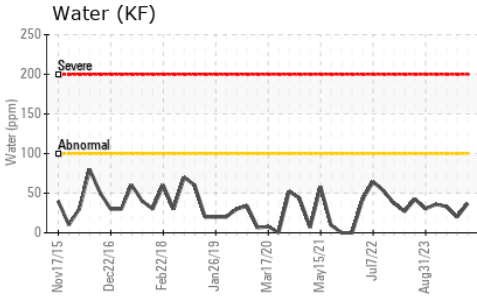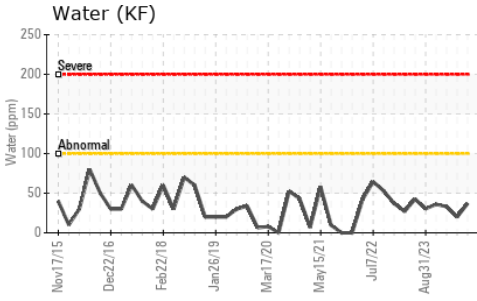





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	67.2	67.2	66.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

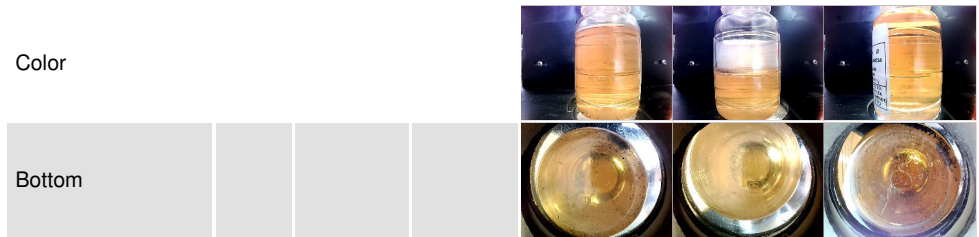

## GRAPHS

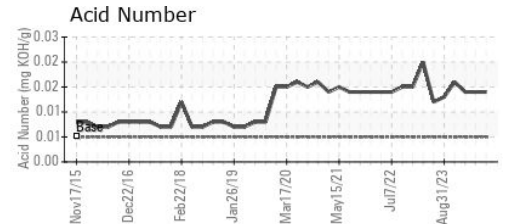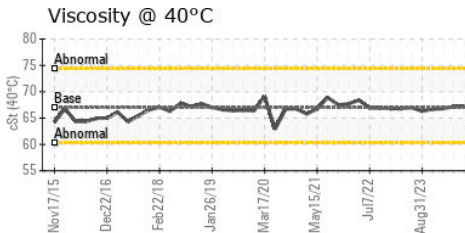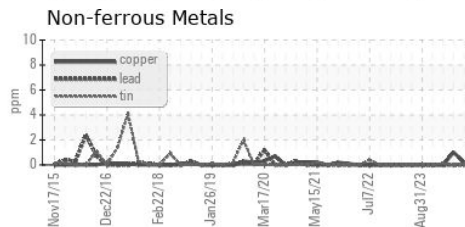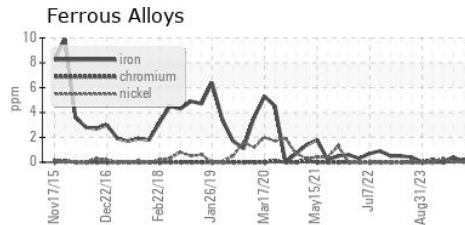

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0011814  
**Lab Number** : 06181400  
**Unique Number** : 11032726  
**Test Package** : IND 2  
**Received** : 16 May 2024  
**Tested** : 20 May 2024  
**Diagnosed** : 20 May 2024 - Jonathan Hester

**CONAGRA FOODS**  
 801 DYE MILL ROAD  
 TROY, OH  
 US 45373

Contact: MIKE WEAVER  
 mike.weaver@conagrafoods.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: