




# OIL ANALYSIS REPORT



Area  
**Engine Room [24-00324471-000]**  
 Machine Id  
**755-REF-COMP-NH3-04 (S/N 10241G31849716)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**FRICK COMPRESSOR OIL #3 (65 GAL)**

## Sample Rating Trend

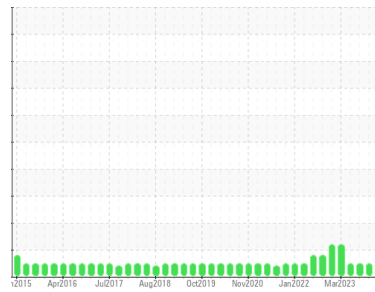

**NORMAL**



### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0011859</b>	USP0007667	USP244687
Sample Date	Client Info		<b>27 Apr 2024</b>	13 Feb 2024	16 Aug 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >8	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m	<b>0</b>	<1	1
Phosphorus	ppm	ASTM D5185m	<b>0</b>	<1	0
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	<b>0</b>	19	43

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Water	%	ASTM D6304 >0.01	<b>0.001</b>	0.002	0.001
ppm Water	ppm	ASTM D6304 >100	<b>11</b>	18	3.6

### FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>3711</b>	9020	6384
Particles >6µm	ASTM D7647 >2500		<b>593</b>	1267	878
Particles >14µm	ASTM D7647 >320		<b>6</b>	4	8
Particles >21µm	ASTM D7647 >80		<b>1</b>	1	2
Particles >38µm	ASTM D7647 >20		<b>0</b>	0	0
Particles >71µm	ASTM D7647 >4		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15		<b>19/16/10</b>	20/17/9	20/17/10

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.014</b>	0.014	0.014




# OIL ANALYSIS REPORT

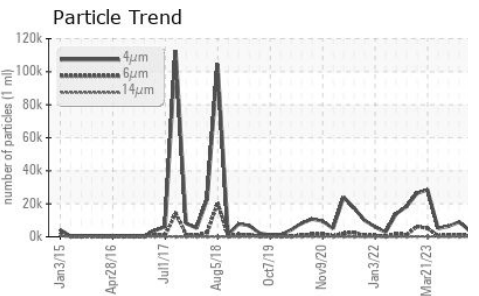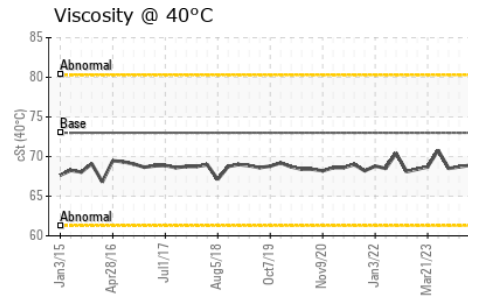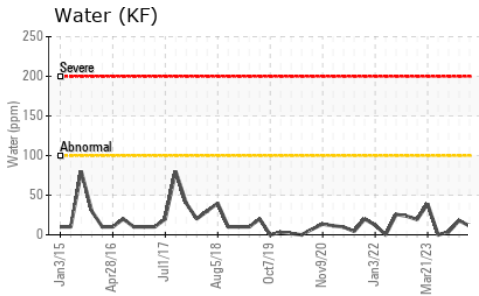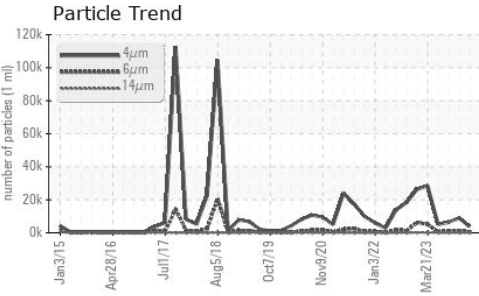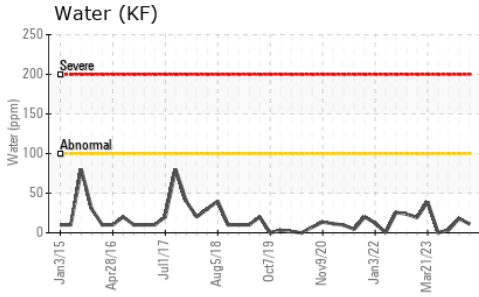





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	68.9	68.7	68.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

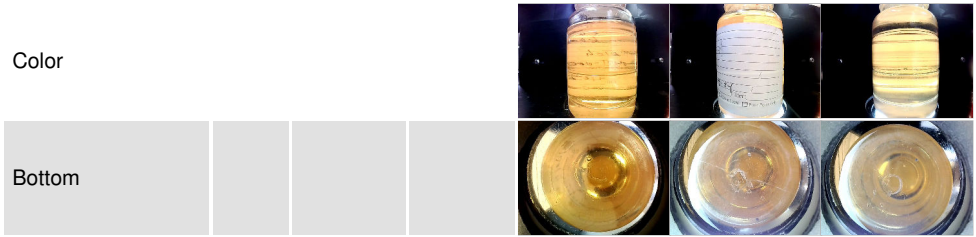

## GRAPHS

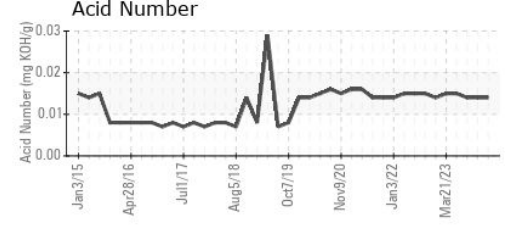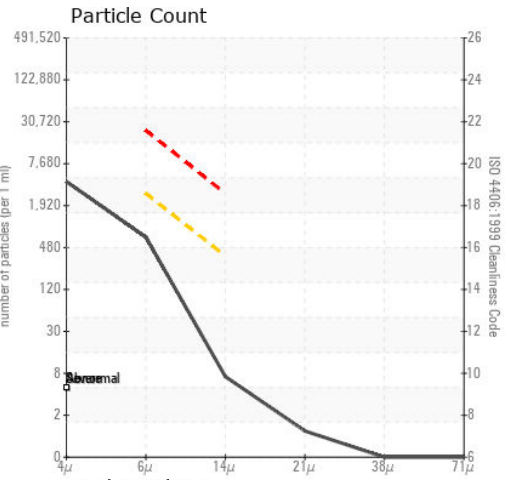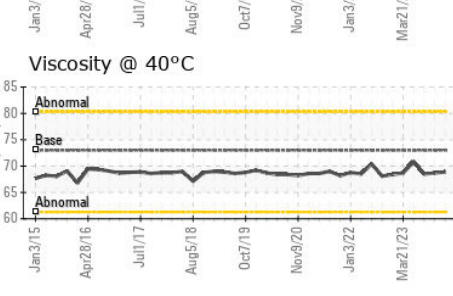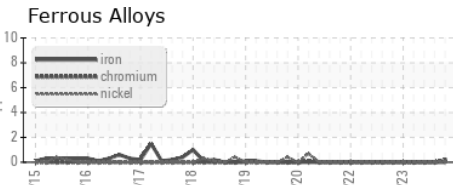

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0011859  
**Lab Number** : 06181421  
**Unique Number** : 11032747  
**Test Package** : IND 2  
**Received** : 16 May 2024  
**Tested** : 17 May 2024  
**Diagnosed** : 20 May 2024 - Jonathan Hester

**KROGER MOUNTAIN VIEW FOODS**  
 10241 EAST 51ST AVE  
 DENVER, CO  
 US 80239  
 Contact: CHARLES AMMERMAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: