


# **OIL ANALYSIS REPORT**



Engine Room [24-00324472-000] 755-REF-COMP-NH3-03 (S/N 10241G31849715)

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (65 GAL)





## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


	,					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0011861	USP0007663	USP244704
Sample Date		Client Info		27 Apr 2024	13 Feb 2024	16 Aug 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	<1	0
Lead	ppm	ASTM D5185m	>2	0	<1	0
Copper	ppm	ASTM D5185m	>8	<1	<1	0
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		0	<1	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		0	22	57
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	<1	0
Sodium	ppm	ASTM D5185m		<1	<1	<1
Potassium	ppm	ASTM D5185m	>20	0	1	0
Water	%	ASTM D6304	>0.01	0.001	0.002	0.001
ppm Water	ppm	ASTM D6304	>100	4	19	3.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7483	2632	9362
Particles >6µm		ASTM D7647	>2500	1382	437	899
Particles >14µm		ASTM D7647	>320	23	10	12
Particles >21µm		ASTM D7647	>80	3	2	1
Particles >38µm		ASTM D7647	>20	0	1	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	20/18/12	19/16/10	20/17/11
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.014	0.014	0.013





# **OIL ANALYSIS REPORT**












VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FILLID DDODED	TIFO					

FLUID PROPER	HES	method	ilmii/base		nistory i	nistory
Visc @ 40°C	cSt	ASTM D445	73	68.1	68.2	68.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
				ANDEN (Chang	



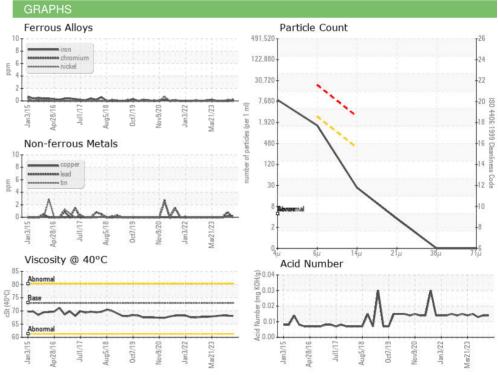





Certificate 12367

Laboratory Sample No.

Test Package : IND 2

: USP0011861 Lab Number : 06181422

Unique Number : 11032748

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 16 May 2024 **Tested** : 17 May 2024

Diagnosed : 20 May 2024 - Jonathan Hester

**KROGER MOUNTAIN VIEW FOODS** 

10241 EAST 51ST AVE DENVER, CO

US 80239 Contact: CHARLES AMMERMAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: