




OIL ANALYSIS REPORT

Sample Rating Trend

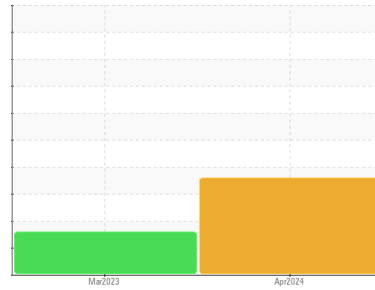

WATER



Area

QUIN SYN PLUS

Machine Id

QUINCY COMP 23 (S/N UTY304322)

Component

Compressor

DIAGNOSIS

Recommendation

We advise that you follow the water drain-off procedure for this component. The filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. Free water present. Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH06181466	UCH05800385	---
Sample Date	Client Info		20 Apr 2024	18 Mar 2023	---
Machine Age	hrs	Client Info	6441	2561	---
Oil Age	hrs	Client Info	6441	2561	---
Oil Changed	Client Info		Not Changed	Not Changed	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	---
Chromium	ppm	ASTM D5185m >10	<1	0	---
Nickel	ppm	ASTM D5185m	<1	<1	---
Titanium	ppm	ASTM D5185m	<1	0	---
Silver	ppm	ASTM D5185m	<1	<1	---
Aluminum	ppm	ASTM D5185m >25	1	<1	---
Lead	ppm	ASTM D5185m >25	<1	0	---
Copper	ppm	ASTM D5185m >50	<1	0	---
Tin	ppm	ASTM D5185m >15	<1	<1	---
Vanadium	ppm	ASTM D5185m	<1	0	---
Cadmium	ppm	ASTM D5185m	<1	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	<1	0	---
Molybdenum	ppm	ASTM D5185m	<1	0	---
Manganese	ppm	ASTM D5185m	<1	0	---
Magnesium	ppm	ASTM D5185m	<1	1	---
Calcium	ppm	ASTM D5185m	4	0	---
Phosphorus	ppm	ASTM D5185m	171	<1	---
Zinc	ppm	ASTM D5185m	1	0	---
Sulfur	ppm	ASTM D5185m	8	2	---

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	5	1	---
Sodium	ppm	ASTM D5185m	0	0	---
Potassium	ppm	ASTM D5185m >20	1	1	---
Water	%	ASTM D6304 >0.1	▲ 0.173	0.091	---
ppm Water	ppm	ASTM D6304 >1000	▲ 1730	910	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.46	0.34	---




OIL ANALYSIS REPORT

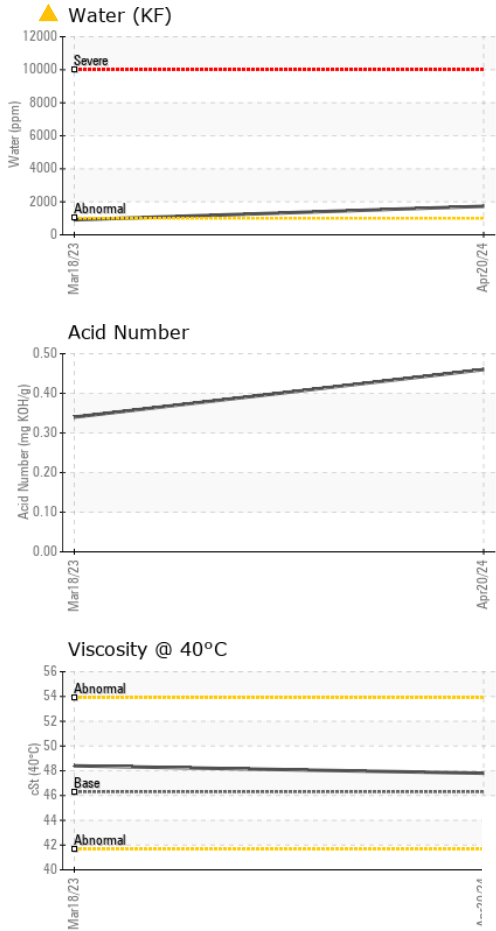





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	0.2%	0.2%
Free Water	scalar	*Visual		▲ 2.0	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.3	47.8	48.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

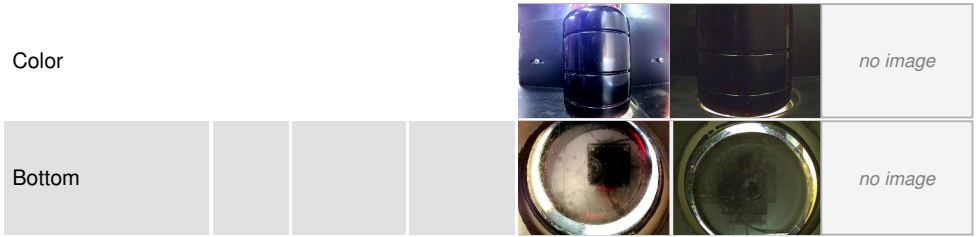

GRAPHS

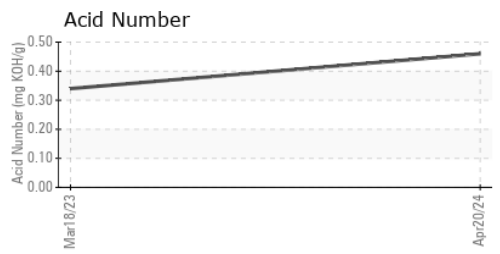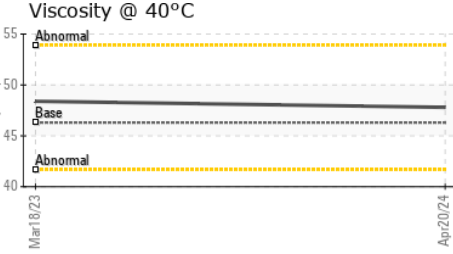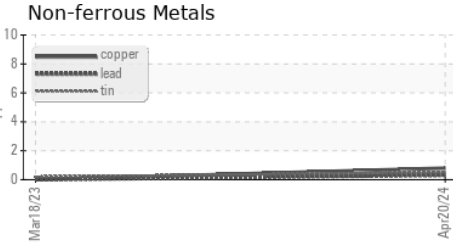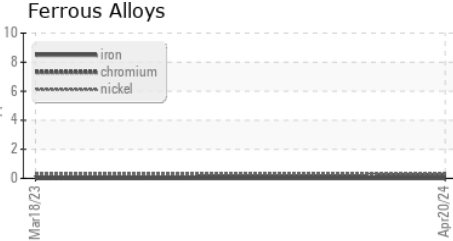

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06181466 **Received** : 16 May 2024
Lab Number : 06181466 **Tested** : 17 May 2024
Unique Number : 11032792 **Diagnosed** : 20 May 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF)

FCC INDIANA INC
 555 INDUSTRIAL PARK RD
 PORTLAND, IN
 US 47371
 Contact: NEIL RINKER
 neil.rinder@e-fcci.com
 T: (260)726-8023
 F: (260)726-7782

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)