




OIL ANALYSIS REPORT

Sample Rating Trend

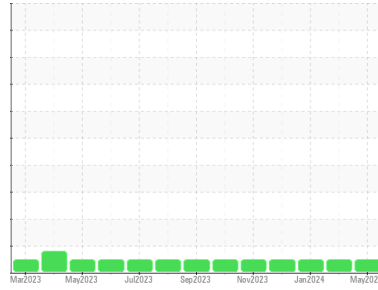

NORMAL



Area
Huntington
 Machine Id
[Huntington] Oil - Port Genset
 Component
Port Genset
 Fluid
DIESEL ENGINE OIL SAE 15W40 (5 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0874555	WC0874747	WC0859835
Sample Date	Client Info		08 May 2024	19 Mar 2024	21 Jan 2024
Machine Age	hrs	Client Info	18784	18341	17915
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Not Changed	Not Changed	Not Changed
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	43	56	35
Chromium	ppm	ASTM D5185m >4	2	2	1
Nickel	ppm	ASTM D5185m >2	1	1	1
Titanium	ppm	ASTM D5185m	<1	<1	<1
Silver	ppm	ASTM D5185m >5	<1	<1	<1
Aluminum	ppm	ASTM D5185m >12	2	3	2
Lead	ppm	ASTM D5185m >17	16	24	19
Copper	ppm	ASTM D5185m >70	5	7	7
Tin	ppm	ASTM D5185m >15	1	1	1
Vanadium	ppm	ASTM D5185m	<1	<1	<1
Cadmium	ppm	ASTM D5185m	<1	<1	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	14	21	18
Barium	ppm	ASTM D5185m 10	<1	0	0
Molybdenum	ppm	ASTM D5185m 100	73	102	73
Manganese	ppm	ASTM D5185m	<1	1	2
Magnesium	ppm	ASTM D5185m 450	1445	2031	1407
Calcium	ppm	ASTM D5185m 3000	1315	1765	1216
Phosphorus	ppm	ASTM D5185m 1150	1015	1376	964
Zinc	ppm	ASTM D5185m 1350	1273	1712	1238
Sulfur	ppm	ASTM D5185m 4250	3232	4614	3033

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	6	8	4
Sodium	ppm	ASTM D5185m >158	6	8	7
Potassium	ppm	ASTM D5185m >20	3	3	4
Water	%	ASTM D6304 >0.1	NEG	NEG	NEG

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.8	0.9	0.8
Nitration	Abs/cm	*ASTM D7624 >20	11.4	11.6	11.4
Sulfation	Abs/.1mm	*ASTM D7415 >30	24.3	24.0	23.5


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	20.5	20.9	20.6
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	9.86	10.52	10.10




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

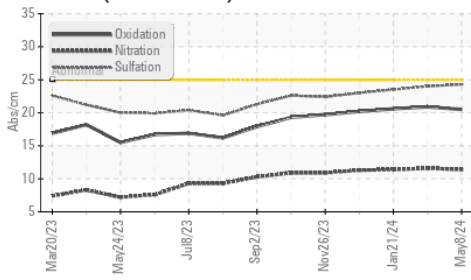

Base Number

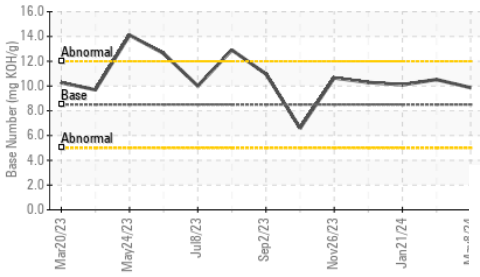

Viscosity @ 100°C

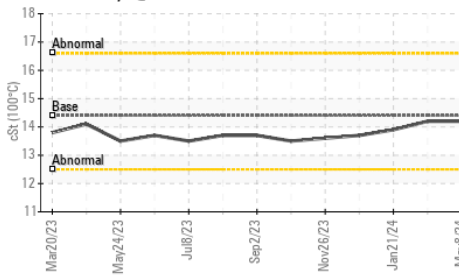


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	14.2	13.9

GRAPHS


Ferrous Alloys

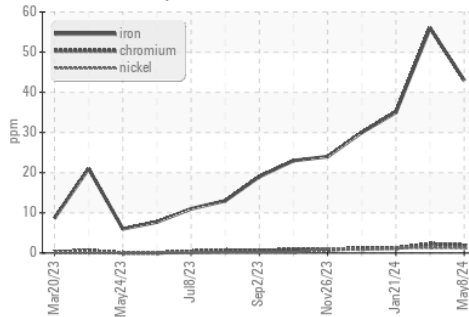


Non-ferrous Metals

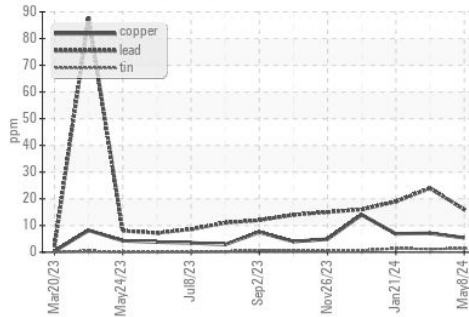

Viscosity @ 100°C

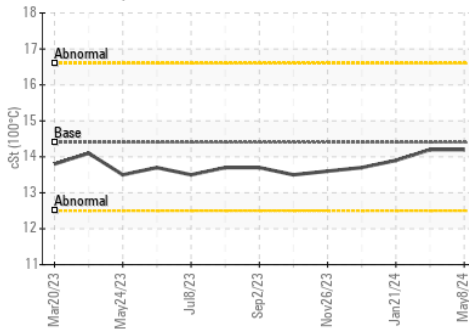

Base Number

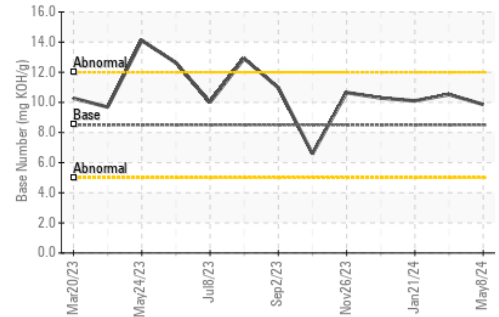

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0874555

Lab Number : 06181541

Unique Number : 11032867

Test Package : IND 2 (Additional Tests: KF)

Received : 16 May 2024

Tested : 20 May 2024

Diagnosed : 20 May 2024 - Sean Felton

MARATHON PETROLEUM CO.

101 12TH ST

CATLETTSBURG, KY

US 41169

Contact: CORY GUMBERT

cagumbert@marathonpetroleum.com

T: (606)585-3950

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)