




# OIL ANALYSIS REPORT

Sample Rating Trend

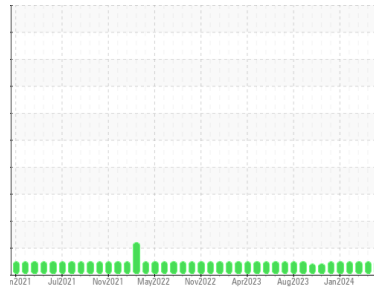

**NORMAL**



Area

**Tampa**

Machine Id

**[Tampa] Oil - Starboard Genset**

Component

**Starboard Genset**

Fluid

**MOBIL 15W40 (7 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0874677</b>	WC0805297	WC0805294
Sample Date	Client Info		<b>09 May 2024</b>	11 Apr 2024	13 Mar 2024
Machine Age	hrs	Client Info	<b>19263</b>	18905	9056
Oil Age	hrs	Client Info	<b>150</b>	250	3589
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	2
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Silver	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	2	2
Lead	ppm	ASTM D5185m	>17	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m	>70	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>80</b>	68	84
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>48</b>	57	53
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>495</b>	548	502
Calcium	ppm	ASTM D5185m		<b>1531</b>	1727	1567
Phosphorus	ppm	ASTM D5185m		<b>706</b>	759	736
Zinc	ppm	ASTM D5185m		<b>839</b>	897	838
Sulfur	ppm	ASTM D5185m		<b>2605</b>	3033	2717

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>8</b>	3	9
Sodium	ppm	ASTM D5185m	>118	<b>3</b>	2	3
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	2
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	NEG

## INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>1</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>7.1</b>	6.9	5.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>17.9</b>	21.7	20.7


## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>12.7</b>	19.8	18.1
Base Number (BN)	mg KOH/g	ASTM D2896		<b>9.92</b>	9.71	10.41



# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

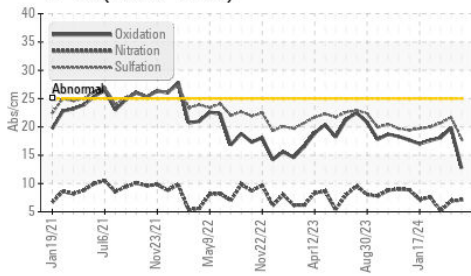


Water (KF)



Base Number

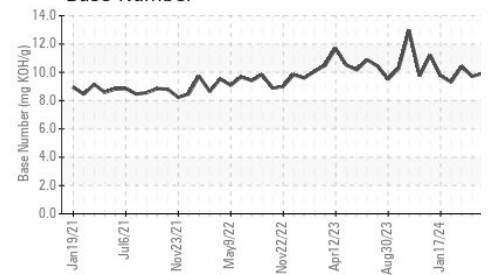

Water (KF)

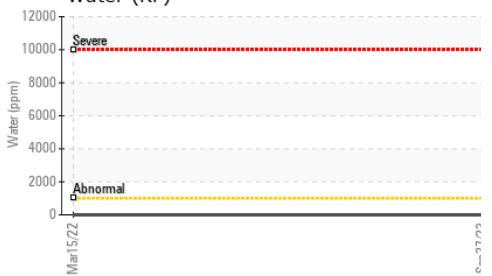


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.0	12.5	14.0

## GRAPHS


Ferrous Alloys

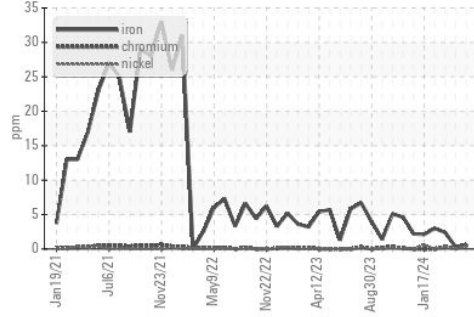


Non-ferrous Metals

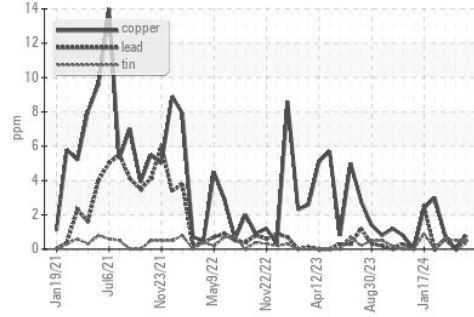

Viscosity @ 100°C

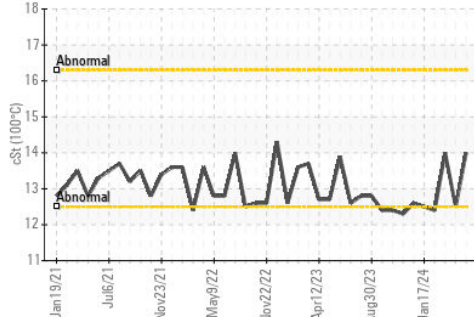

Base Number

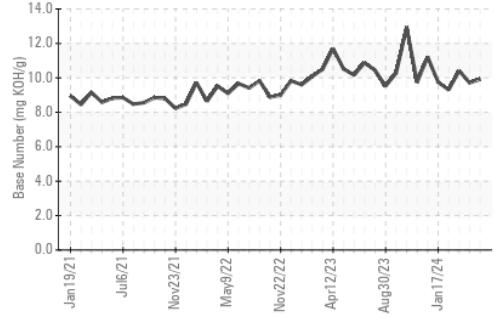

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0874677 **Received** : 16 May 2024  
**Lab Number** : 06181556 **Tested** : 20 May 2024  
**Unique Number** : 11032882 **Diagnosed** : 20 May 2024 - Sean Felton  
**Test Package** : IND 2 ( Additional Tests: KF )

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169  
 Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (606)585-3950

F: x: