

OIL ANALYSIS REPORT

Sample Rating Trend



WEAR



Area
J17
 Machine Id
MAZAK 309801 - TABLE
 Component
Chiller
 Fluid
MOBIL SHC 626 (9 GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The iron level is abnormal.

● Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			FCH0000089	---	---
Sample Date	Client Info			13 May 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				ABNORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.01	NEG	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	▲ 17	---	---
Chromium	ppm	ASTM D5185m	>2	<1	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>2	<1	---	---
Aluminum	ppm	ASTM D5185m	>3	0	---	---
Lead	ppm	ASTM D5185m	>2	0	---	---
Copper	ppm	ASTM D5185m	>8	<1	---	---
Tin	ppm	ASTM D5185m	>4	0	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		0	---	---
Phosphorus	ppm	ASTM D5185m		319	---	---
Zinc	ppm	ASTM D5185m		0	---	---
Sulfur	ppm	ASTM D5185m		860	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	4	---	---
Sodium	ppm	ASTM D5185m		2	---	---
Potassium	ppm	ASTM D5185m	>20	<1	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	● 17888	---	---
Particles >6µm		ASTM D7647	>2500	● 3903	---	---
Particles >14µm		ASTM D7647	>320	106	---	---
Particles >21µm		ASTM D7647	>80	13	---	---
Particles >38µm		ASTM D7647	>20	1	---	---
Particles >71µm		ASTM D7647	>4	1	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	● 21/19/14	---	---


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.34	---	---

OIL ANALYSIS REPORT

Particle Trend




Particle Count

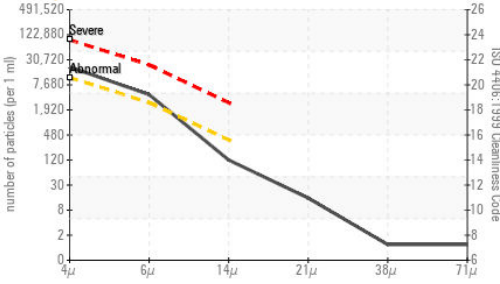


Particle Trend



Acid Number

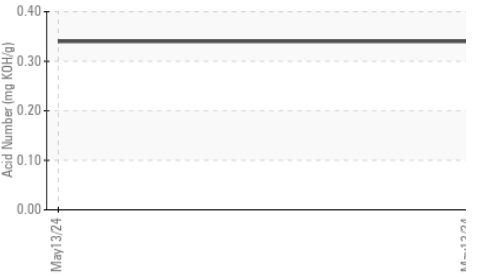

Viscosity @ 40°C

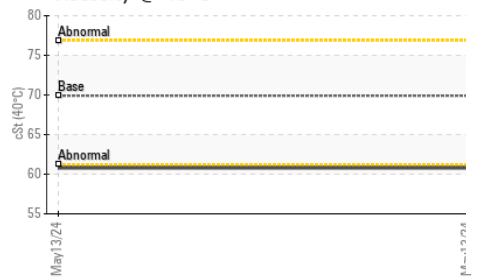

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	69.9	60.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color		no image	no image
Bottom		no image	no image

GRAPHS


Ferrous Alloys

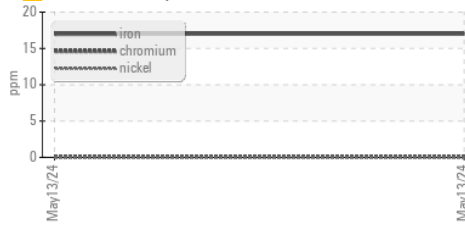


Non-ferrous Metals

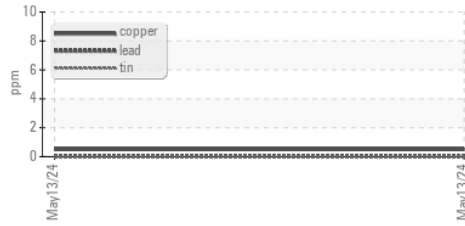

Viscosity @ 40°C

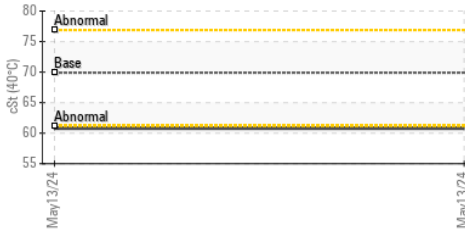

Particle Count

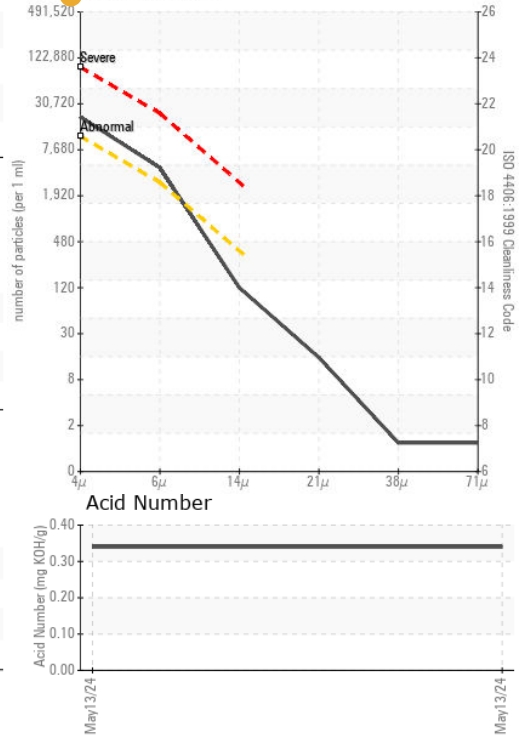

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : FCH0000089
Lab Number : 06181962
Unique Number : 11033288
Test Package : PLANT

Received : 16 May 2024
Tested : 21 May 2024
Diagnosed : 21 May 2024 - Jonathan Hester

DANA - FAIRFIELD CUSTOM GEARS AND DRIVES
 2400 SAGAMORE PKWY S #2400
 LAFAYETTE, IN
 US 47905

Contact: Service Manager
 Jeffrey.Alexander@fuchs.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)