




# OIL ANALYSIS REPORT

## Sample Rating Trend

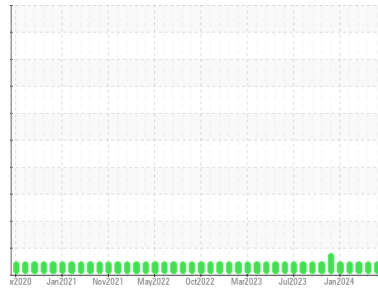

**NORMAL**



Area  
**GAS**  
 Machine Id  
**K-4300A (S/N A AIR COMPRESSOR)**  
 Component  
**Air Compressor**  
 Fluid  
**CHEVRON GST OIL ISO 68 (18 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the fluid. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the fluid is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>HLC0003308</b>	HLC0003212	HLC0003214
Sample Date	Client Info	<b>07 May 2024</b>	01 Apr 2024	08 Mar 2024
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.6	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm ASTM D5185m >4	<b>0</b>	<1	<1
Nickel	ppm ASTM D5185m >4	<b>0</b>	<1	<1
Titanium	ppm ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Aluminum	ppm ASTM D5185m >10	<b>0</b>	1	2
Lead	ppm ASTM D5185m >20	<b>&lt;1</b>	1	<1
Copper	ppm ASTM D5185m >40	<b>&lt;1</b>	<1	<1
Tin	ppm ASTM D5185m >5	<b>0</b>	1	<1
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	<1	<1
Cadmium	ppm ASTM D5185m	<b>0</b>	<1	<1

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>0</b>	<1	<1
Manganese	ppm ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm ASTM D5185m	<b>0</b>	<1	<1
Calcium	ppm ASTM D5185m	<b>28</b>	4	3
Phosphorus	ppm ASTM D5185m	<b>9</b>	50	11
Zinc	ppm ASTM D5185m	<b>0</b>	<1	0
Sulfur	ppm ASTM D5185m	<b>1000</b>	821	860

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>&lt;1</b>	0	<1
Sodium	ppm ASTM D5185m	<b>2</b>	0	0
Potassium	ppm ASTM D5185m >20	<b>&lt;1</b>	1	1





## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>43</b>	390	---
Particles >6µm	ASTM D7647 >2500	<b>17</b>	63	---
Particles >14µm	ASTM D7647 >320	<b>1</b>	4	---
Particles >21µm	ASTM D7647 >80	<b>1</b>	1	---
Particles >38µm	ASTM D7647 >20	<b>0</b>	0	---
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c) >--/18/15	<b>13/11/7</b>	16/13/9	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	<b>0.078</b>	0.073	0.069


# OIL ANALYSIS REPORT

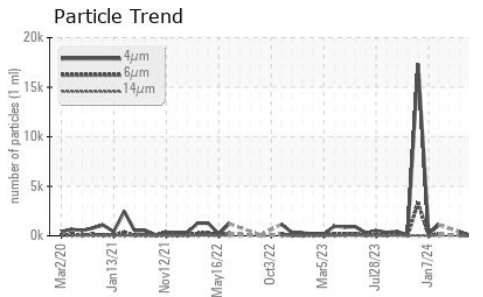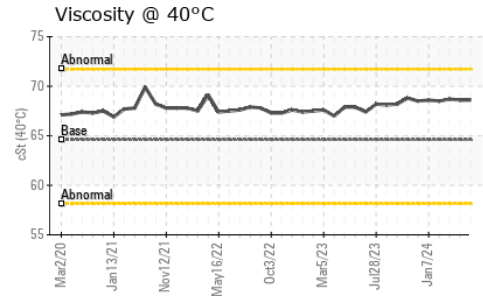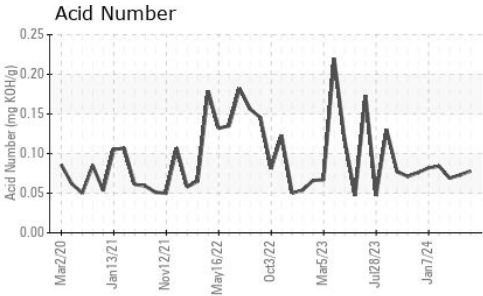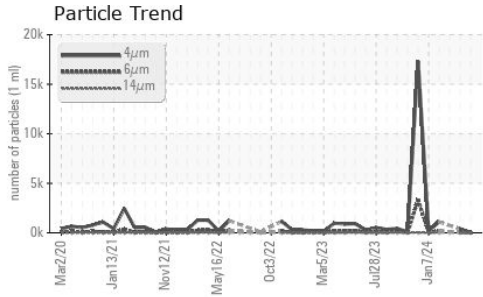






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.6	68.6	68.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

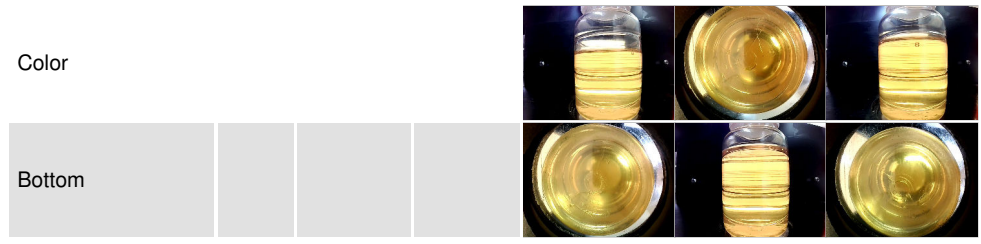

## GRAPHS

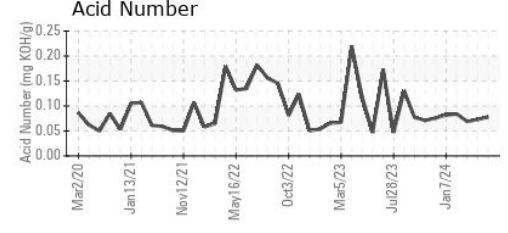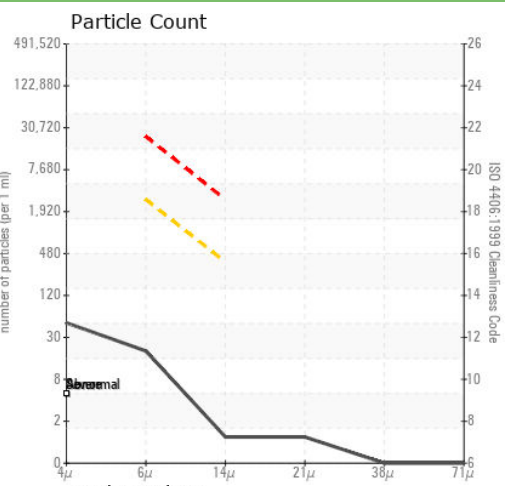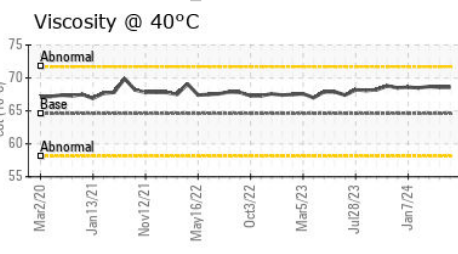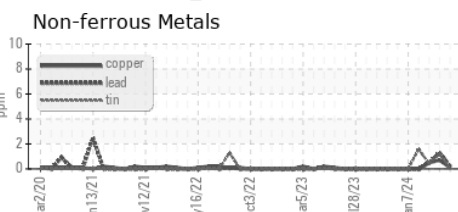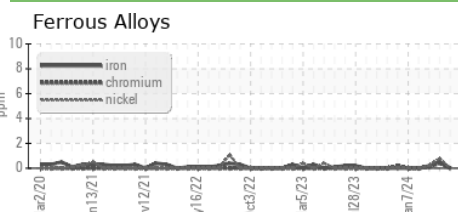

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0003308      **Received** : 16 May 2024  
**Lab Number** : 06181977      **Tested** : 20 May 2024  
**Unique Number** : 11033303      **Diagnosed** : 20 May 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**HILCORP NORTHSTAR FACILITY**  
 PRUDHOE BAY, AK  
 US 99734  
 Contact: PERRY NEEL  
 pneel@hilcorp.com  
 T: (907)670-3514  
 F: (907)659-5377

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)