




# OIL ANALYSIS REPORT

Area  
**GAS**  
 Machine Id  
**GT-2325A (S/N HPA GG)**  
 Component  
**Turbine**  
 Fluid  
**MOBIL JET OIL II (110 GAL)**

Sample Rating Trend

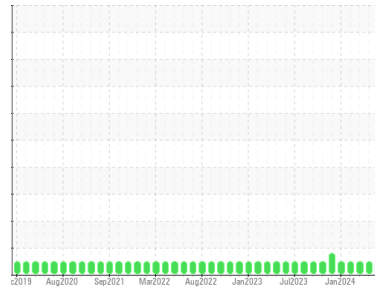

**VIS DEBRIS**



## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>HLC0003327</b>	HLC0003213	HLC0003207
Sample Date	Client Info	<b>29 Apr 2024</b>	31 Mar 2024	08 Mar 2024
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2	
Water	WC Method	>.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	1	2
Lead	ppm	ASTM D5185m		<b>&lt;1</b>	1	<1
Copper	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>5	<b>&lt;1</b>	1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	1	<1

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m		<b>0</b>	3	3
Phosphorus	ppm	ASTM D5185m		<b>2991</b>	2598	2393
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	1


## FLUID CLEANLINESS

method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647		---	264	167
Particles >6µm		ASTM D7647	>1300	---	66	69
Particles >14µm		ASTM D7647	>160	---	9	12
Particles >21µm		ASTM D7647	>40	---	3	5
Particles >38µm		ASTM D7647	>10	---	0	0
Particles >71µm		ASTM D7647	>3	---	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/14	---	15/13/10	15/13/11

## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.03	<b>0.11</b>	0.11	0.13


# OIL ANALYSIS REPORT

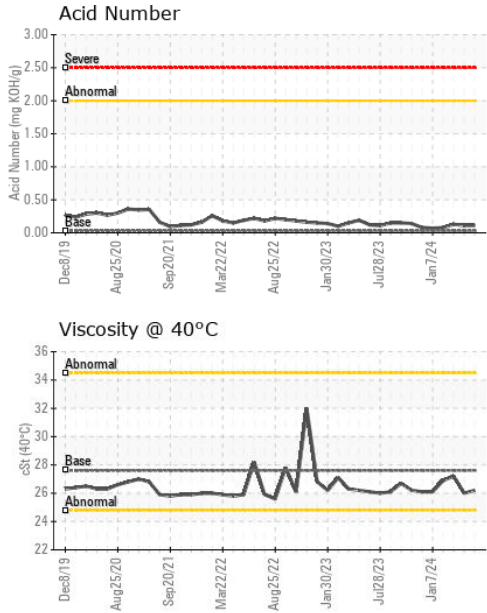





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	27.6	26.0	27.2

### SAMPLE IMAGES

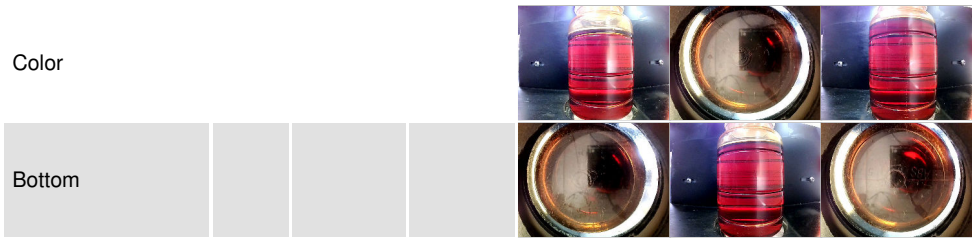

### GRAPHS

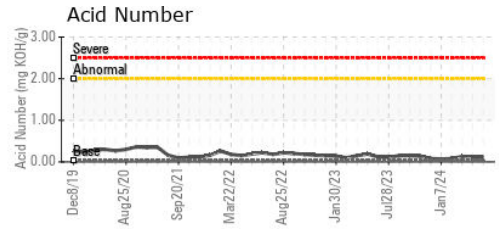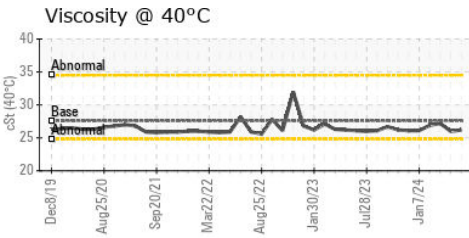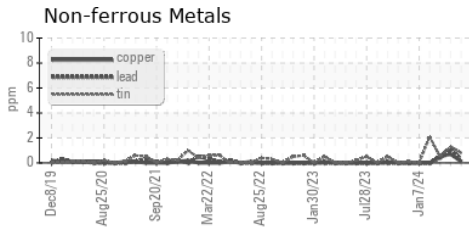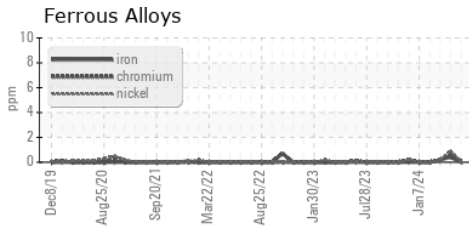

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0003327  
**Lab Number** : 06181982  
**Unique Number** : 11033308  
**Test Package** : IND 2

**Received** : 16 May 2024  
**Tested** : 20 May 2024  
**Diagnosed** : 20 May 2024 - Don Baldrige

**HILCORP NORTHSTAR FACILITY**

PRUDHOE BAY, AK  
 US 99734  
 Contact: PERRY NEEL  
 pneel@hilcorp.com  
 T: (907)670-3514  
 F: (907)659-5377