

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER BSD 60T 7560644 (S/N 1049)

Component Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017386	KCP002087	
Sample Date		Client Info		07 May 2024	21 Jun 2023	
Machine Age	hrs	Client Info		11937	6414	
Oil Age	hrs	Client Info		5523	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	6	3	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	0	58	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	0	0	
Zinc	ppm	ASTM D5185m	0	10	23	
Sulfur	ppm	ASTM D5185m	23500	24180	18871	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	0	
Sodium	ppm	ASTM D5185m		6	13	
Potassium	ppm	ASTM D5185m	>20	2	10	
Water	%	ASTM D6304	>0.05	0.007	0.021	
ppm Water	ppm	ASTM D6304	>500	78	215.0	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1386	3157	
Particles >6µm		ASTM D7647	>1300	307	970	
Particles >14µm		ASTM D7647	>80	13	58	
Particles >21µm		ASTM D7647	>20	2	16	
Particles >38µm		ASTM D7647	>4	1	1	
Particles >71µm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/15/11	19/17/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.43	0.35	



OIL ANALYSIS REPORT

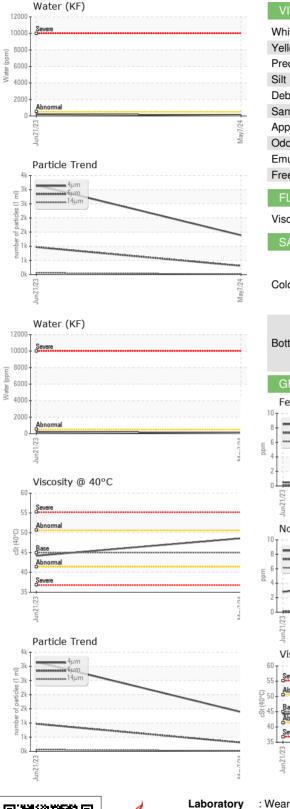

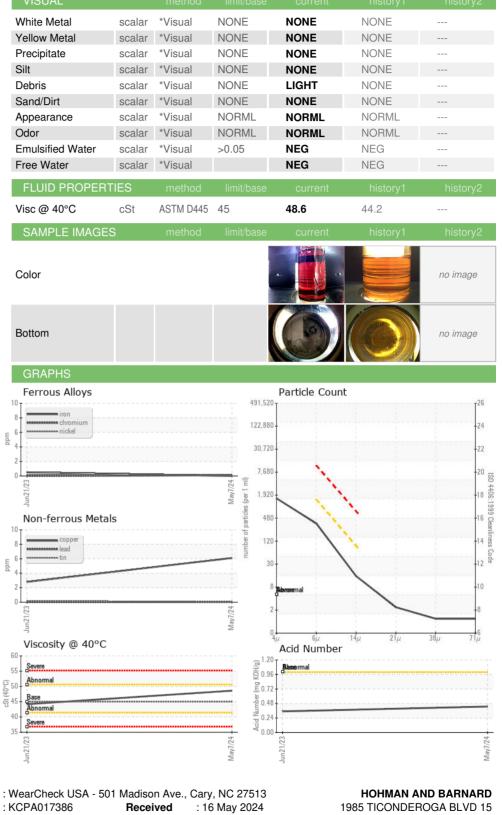



Sample No. Lab Number :06181993 Tested : 20 May 2024 CHESTER SPRINGS, PA Unique Number : 11033319 Diagnosed : 20 May 2024 - Don Baldridge Test Package : IND 2 (Additional Tests: KF, PrtCount) Contact: SERVICE MANAGER Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: HOHCHE [WUSCAR] 06181993 (Generated: 05/20/2024 12:54:00) Rev: 1

Contact/Location: SERVICE MANAGER ? - HOHCHE

US 19425

T:

F: