

OIL ANALYSIS REPORT

KAESER BS 61 0497100016 (S/N 5103146)

Oil Age

Iron

Nickel

Silver

Lead

Tin

Copper

Cadmium

Boron

Barium

Calcium

Zinc

Silicon

Sodium

Water

Particles >21µm

Particles >38µm

Particles >71µm

Oil Cleanliness

Acid Number (AN)

FLUID DEGRADATION

ASTM D7647

ASTM D7647

ISO 4406 (c)

method

ASTM D8045

mg KOH/g

ASTM D7647 >3

>20

>--/17/13

limit/base

>4

1.0

9

4

3

0.34

22/19/13

current

Titanium

Compressor KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Machine Id

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

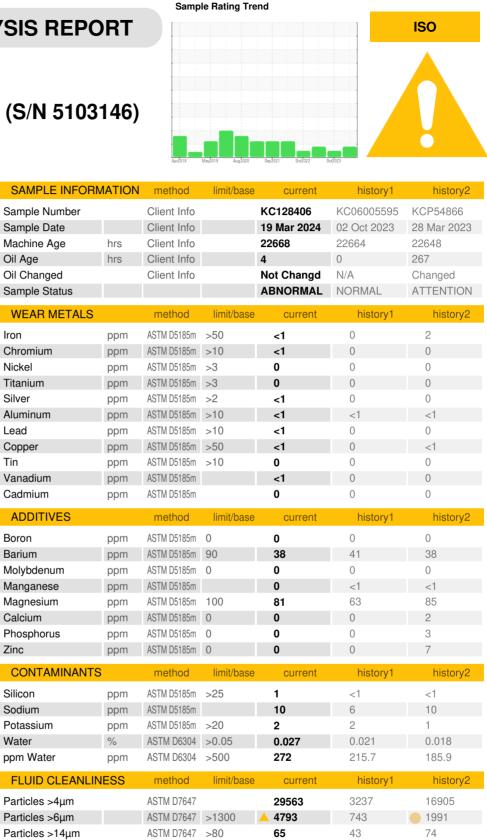

0.32

14

2

0

19/17/13

history1

14

1


0


0.33


21/18/13


history2















OIL ANALYSIS REPORT

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------------------|------------|---------------------|------------------|-----------------|------------------|------------------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |
| | | | | | | |
| FLUID PROPERT | IES | method | limit/base | current | history1 | history2 |
| FLUID PROPERT Visc @ 40°C | IES cSt | method ASTM D445 | limit/base 45 | current 44.5 | history1 44.7 | history2 44.2 |
| | cSt | | | | | |
| Visc @ 40°C | cSt | ASTM D445 | 45 | 44.5 | 44.7 | 44.2 |

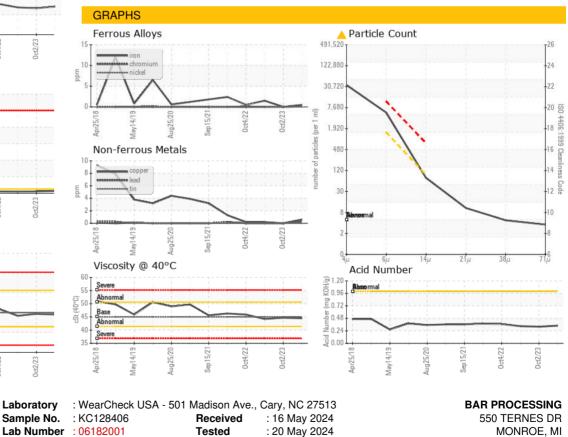

: 20 May 2024 - Don Baldridge



Certificate L2367 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

T: F:

Contact/Location: Service Manager - BARMONKCP

US 48162

Contact: Service Manager