

### **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# KAESER 3098966

#### Component Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	NATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA014481		
Sample Date		Client Info		14 May 2024		
Machine Age	hrs	Client Info		99999		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead		ASTM D5185m	>10	0		
	ppm	ASTM D5185m	>50	8		
Copper	ppm	ASTM D5185m		-		
Tin	ppm		>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	0		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	20265		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.007		
ppm Water	ppm	ASTM D6304	>500	75		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		745		
Particles >6µm		ASTM D7647	>1300	167		
Particles >14µm		ASTM D7647	>80	7		
Particles >21µm		ASTM D7647	>20	3		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/10		
FLUID DEGRADA	TION_	method	limit/base	current	history1	history2
	mg KOH/g	ASTM D8045	1.0	0.49		
Acid Number (AN)	iiiy i∖∪⊓/ÿ	A0 HVI D0040	1.0	0.43		



## **OIL ANALYSIS REPORT**

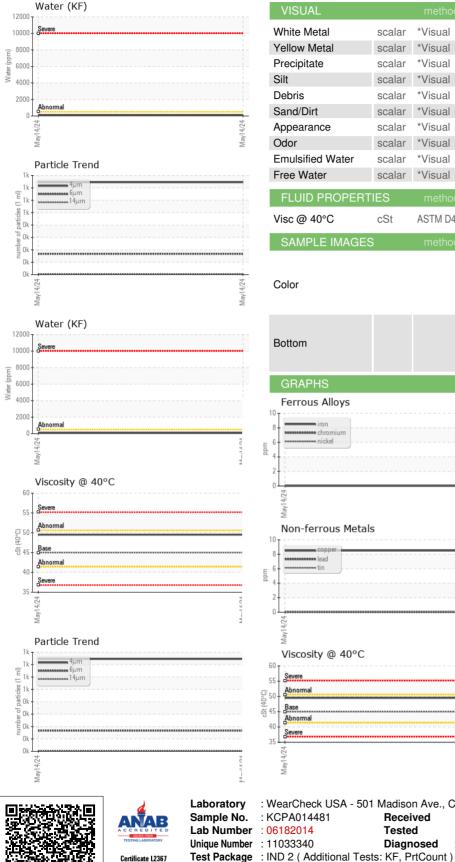

NONE NONE White Metal \*Visual scalar Yellow Metal \*Visual NONE NONE scalar NONE Precipitate scalar \*Visual NONE scalar \*Visual NONE NONE \*Visual NONE NONE scalar Sand/Dirt NONE NONE scalar \*Visual NORML NORML Appearance scalar \*Visual \*Visual NORML NORML scalar \*Visual **Emulsified Water** scalar >0.05 NEG Free Water scalar \*Visual NEG FLUID PROPERTIES 49.5 Visc @ 40°C cSt ASTM D445 45 SAMPLE IMAGES no image no image no image no imade GRAPHS Ferrous Alloys Particle Count 491,52 122,880 30.720 7,680 Mav14/24 4406 per 1,920 :1999 Cle Non-ferrous Metals 480 120 14 30 Mav14/24 21µ 28 Viscosity @ 40°C Acid Number (B/H0) MOX 0.96 Abnorma Ê 0.72 - e 0.48 Abnorma Acid Ni 0.24 0.00 May14/24 174 Mav1 : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **GOOD SAMARITAN HOSPITAL** : KCPA014481 Received : 16 May 2024 2425 SAMARITAN DR Tested : 20 May 2024 SAN JOSE, CA Diagnosed : 20 May 2024 - Don Baldridge US 95124

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: TOM SANPAULO - GOOSANCA

Page 2 of 2

T:

F:

Contact: TOM SANPAULO

tom.sanpaulo2@hcahealthcare.com