


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

7607369 (S/N 1140)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug202.	2 Mar ² 023	Feb 2024 Ma	y2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017801	KCP36698	KCPA001214
Sample Date		Client Info		09 May 2024	09 Feb 2024	20 Mar 2023
Machine Age	hrs	Client Info		17625	16022	9885
Oil Age	hrs	Client Info		4603	10436	0
Oil Changed		Client Info		Not Changd	Not Changd	N/A
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	0
Aluminum	ppm	ASTM D5185m	>10	0	1	0
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	5	5	7
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	3	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	0	2	3
Calcium	ppm	ASTM D5185m	2	0	0	<1
Phosphorus	ppm	ASTM D5185m		0	<1	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		13546	14757	19573
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		2	0	0
Potassium	ppm	ASTM D5185m	>20	<1	1	<1
Water	%	ASTM D6304	>0.05	0.007	0.007	0.007
ppm Water	ppm	ASTM D6304	>500	73	71	72.9
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1868	7278	578
Particles >6µm		ASTM D7647	>1300	530	2245	114
Particles >14µm		ASTM D7647	>80	20	156	9
Particles >21µm		ASTM D7647	>20	3	38	2
Particles >38µm		ASTM D7647	>4	1	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/11	20/18/14	16/14/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.43	0.46	0.44



OIL ANALYSIS REPORT

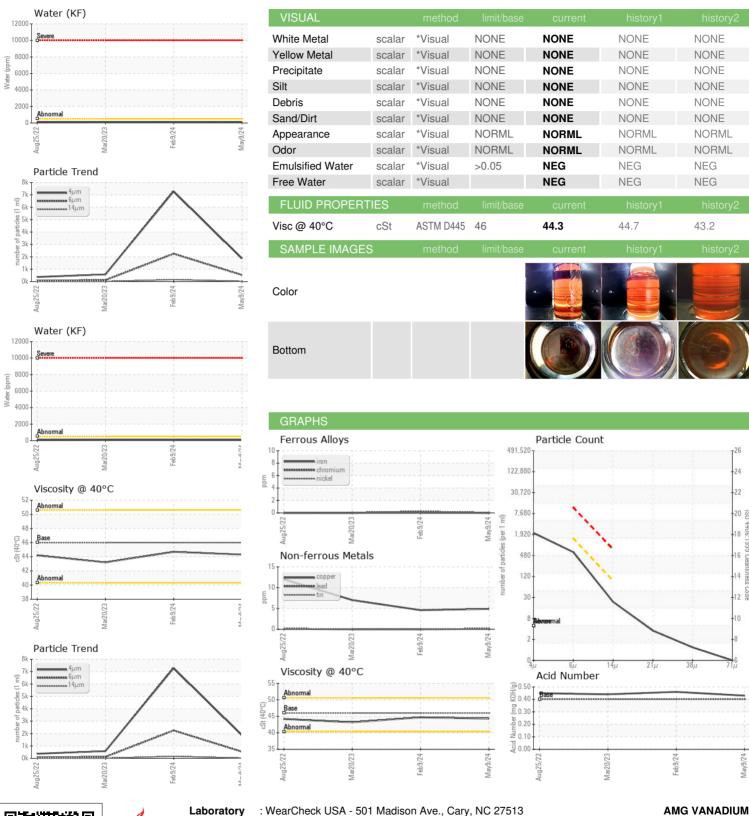





Certificate 12367

Laboratory

Sample No. Lab Number

: 06182016 Unique Number : 11033342

: KCPA017801

Received **Tested** Diagnosed

: 20 May 2024 Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 20 May 2024 - Don Baldridge

: 16 May 2024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F:

3400 E POINTE DR

Contact: Service Manager

ZANESVILLE, OH

US 43701

T: