

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 9335498 (S/N 1870)

Component Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125030		
Sample Date		Client Info		08 May 2024		
Machine Age	hrs	Client Info		1112		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	<1		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm		>50	3		
Tin	ppm		>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	19		
Molybdenum	ppm	ASTM D5185m	00	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	39		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m	L	0		
Zinc	ppm	ASTM D5185m		0		
			11 11 11	-		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		15		
Potassium	ppm	ASTM D5185m	>20	9		
Water	%	ASTM D6304	>0.05	0.024		
ppm Water	ppm	ASTM D6304	>500	241		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5617		
Particles >6µm		ASTM D7647	>1300	<mark> </mark> 1721		
Particles >14µm		ASTM D7647	>80	26		
Particles >21µm		ASTM D7647	>20	2		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/18/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34		




OIL ANALYSIS REPORT

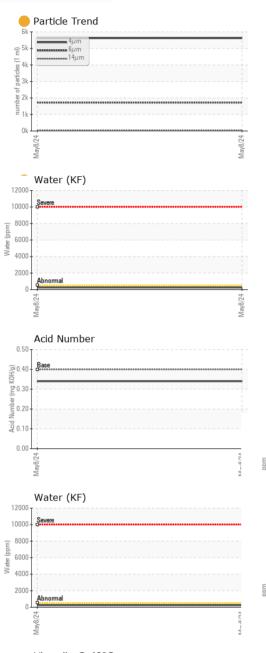



Certificate 12367

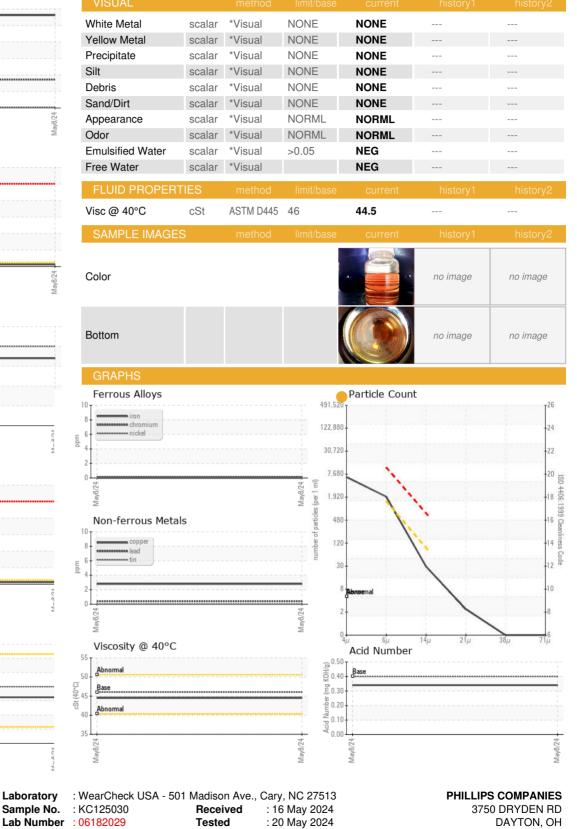

: 20 May 2024 - Don Baldridge



Report Id: PHIDAY [WUSCAR] 06182029 (Generated: 05/20/2024 13:17:09) Rev: 1

Laboratory

Unique Number : 11033355

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2

Diagnosed

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - PHIDAY Page 2 of 2

US 45439

T:

F:

Contact: Service Manager